


## Information Guide

### Pool Enclosure Site Plan Requirements:

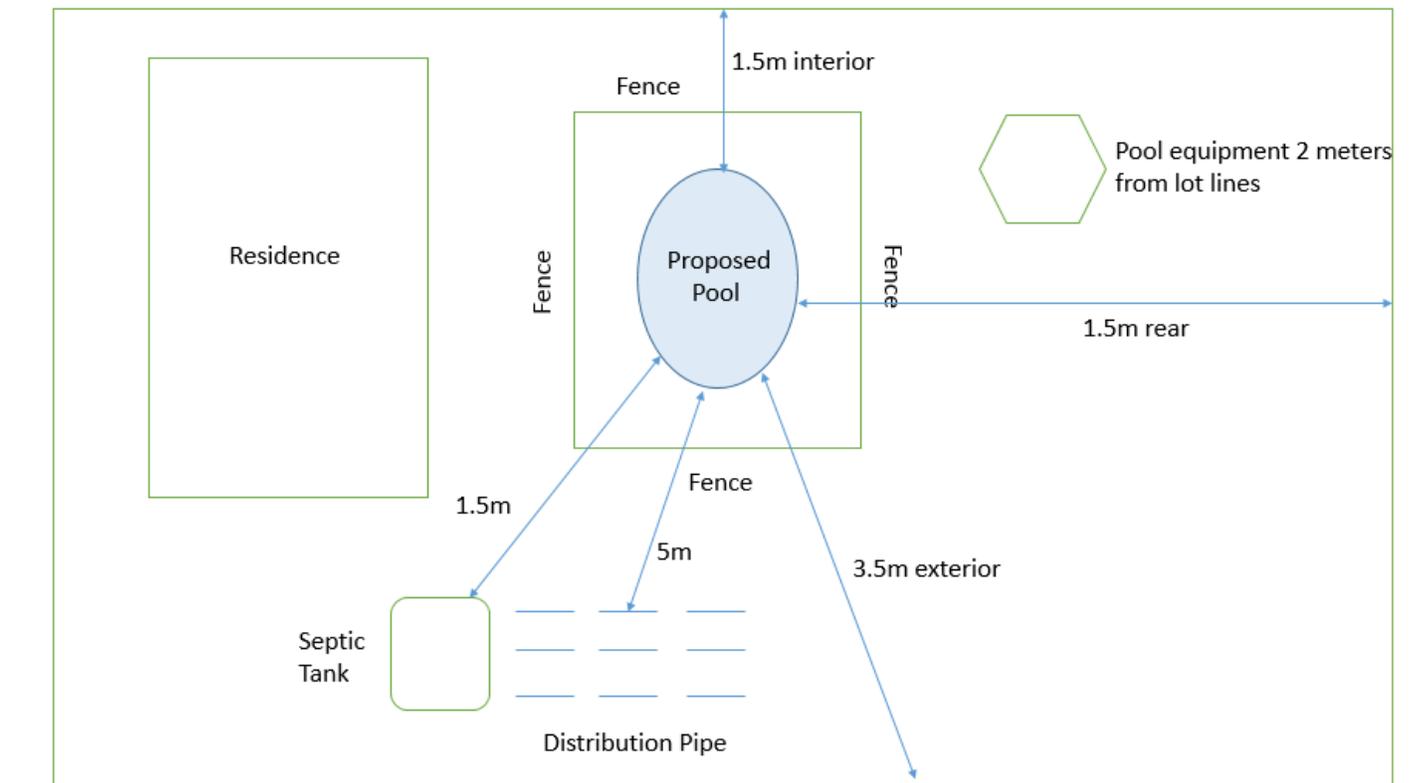

*\*measured from the water's edge of swimming pool*

Outdoor swimming pool pumps, filters, and heaters or any accessory building or structure containing such equipment are permitted in the **interior, rear, and exterior side yards**, provided they are set back a minimum of **2 meters** from any lot line.

### Gates:

- Be self-closing and equipped with a self-latching and locking device placed at the top and on the inside of the gate so the device latches when the gate is in the closed position;
- Operate on hinges sufficient to support the gate either open and unlatched or closed and latched

### Hot Tubs:

- In the case of an outdoor swimming pool that is a hot tub, spa or whirlpool the outdoor swimming pool enclosure is not required provided the hot tub, whirlpool or spa is equipped with a substantial cover, capable of holding 90.72kg (200 lbs.), which is fitted to the hot tub, whirlpool or spa and is equipped with a locking device.
- Not to be directly accessible from a door of a building unless the door is equipped with a locking device.


## Inspections Required:

Once issued, all pool enclosure permits require a Final inspection. The permit package must be on site at the time of inspection. A final grading certificate is required prior to the Final inspection for properties located in a subdivision or for any property at the Township's discretion.

Inspection requests can be made by contacting the Township office by phone at 519-763-1226 ext 181, by email at [services@puslinch.ca](mailto:services@puslinch.ca) or through Cloudpermit.


## Fence Requirement Details:

All fences must be a minimum of 1.5 meters in height and located a minimum of 1.0 meters from any other fence, wall or structure which may facilitate climbing over the outdoor swimming pool enclosure.

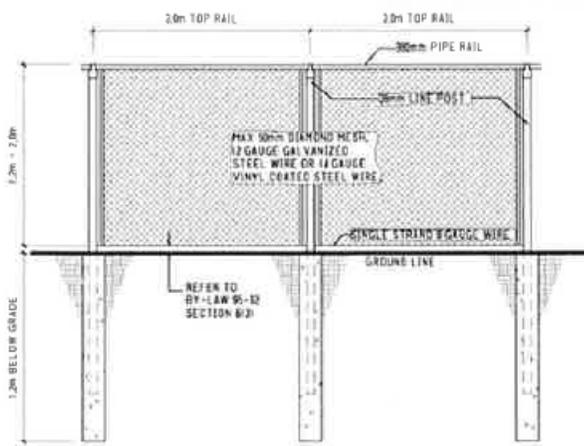

**TYPICAL CHAIN LINK FENCE DETAIL**

- Have a mesh with openings not greater than 38 millimeters (1.5 inches);
- Be supported by minimum 38 millimeters (1.5 inches) galvanized steel posts spaced not more than 2.5 meters (8 feet 2 inches) apart, firmly embedded into the ground; and
- Have top and bottom rails firmly fastened to the upright posts, made of a minimum 32 millimeters (1.25 inches) steel pipe, provided that in place of the bottom rail there may be substituted a steel tension rod

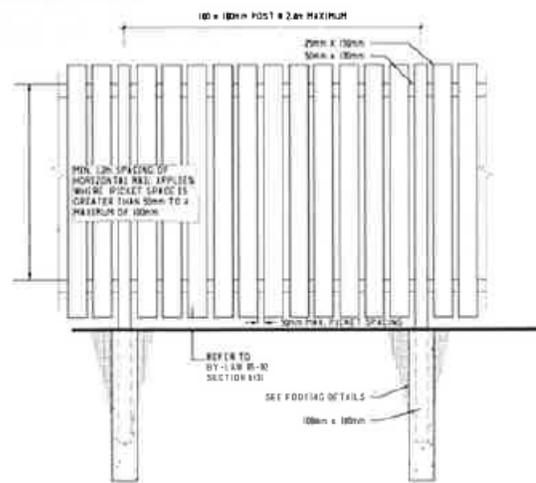

**TYPICAL WOOD FENCE DETAIL**

- Have vertical boarding not less than 19 millimeters by 89 millimeters (1 inch by 4 inches) and shall have no openings on the exterior face with a dimension greater than 100 millimeters (4 inches);
- Be supported by posts at least 89 millimeters (4 inches by 4 inches) square, or 89 millimeters (4 inches) in diameter, spaced not more than 2.5 meters (8 feet 2 inches) apart. Such posts shall be firmly embedded into the ground and that portion of the post below grade shall be treated with a wood preservative; and
- Have top and bottom rails of at least 38 millimeters by 89 millimeters (2 inches by 4 inches), and spaced to provide a minimum clearance of 1.0 metre (3 feet 3 inches) between the rails