



Affidavit

Township of Puslinch
7404 Wellington County Rd 34, Puslinch, ON N0B 2J0
(519) 763-1226

Cloudpermit application number
CA-3523001-P-2025-2

Applicant, Property owner, Payer		
Last name Schram	First name Nadine	Corporation or partnership
Street address 19 Water St	Unit number	Lot / Con.
Municipality Puslinch	Postal code N0B2J0	Province Ontario
Other phone	Mobile phone [REDACTED]	
Fax	Email [REDACTED]	

Subject Land Information		
Address	Legal description	Roll number
19 WATER ROAD PV (Primary)	PLAN 61M203 LOT 95	2301000006166150000

Sworn Declaration of Applicant

Complete in the presence of a Commissioner for taking affidavits

I, Nadine Schram, solemnly declare that the information required under Schedule 1 to Ontario Regulation 545/06 and provided by the Applicant is accurate and that the information contained in the documents that accompany this application is accurate, and I make this solemn declaration conscientiously believing it to be true, and knowing that it is of the same force and effect as if made under oath and by virtue of the Canada Evidence Act.

Signature of Applicant (sign in the presence of a Commissioner for taking affidavits)
[REDACTED]

Signature of Commissioner for taking affidavits [REDACTED]	Municipality Township of Puslinch	Day, month, year Jan 9 2025
---	--------------------------------------	--------------------------------

Place an imprint of your stamp below

**Monika Alyse Famcombe, a Commissioner, etc.,
Province of Ontario, for the Corporation of the
Township of Puslinch.
Expires February 14, 2027.**

Affidavit and signatures


Applicant

The Nadine Schram, Applicant is required to agree to erect and maintain a sign on the subject lands and to permit Township employees/representatives to enter the lands for site visits. The sign will be provided to the applicant for posting on the property by Township planning staff along with instructions on how and where to post the sign. The sign must be posted at least 10 days prior to the Committee of Adjustment meeting date for the application and must remain on the property until the 20 day appeal period is expired.

Notice with respect to collection of personal information

Personal information on this form is collected under the authority of the Planning Act. The information is used for the purpose of processing this application and administering the legislation and is maintained in accordance with the Municipal Freedom of Information and Protection of Privacy Act. Questions regarding the collection of this information may be directed to the Township Clerk's office.

The Township of Puslinch is committed to providing accessible formats and communication supports for people with a disability. If another format would work better for you, please contact the Township Clerk's office for assistance.

 Digitally signed on 2025-01-09, 4:13:17 p.m. EST by Nadine Schram.

Send correspondence to	
Send correspondence to <input checked="" type="checkbox"/> Owner(s) <input type="checkbox"/> Agent <input type="checkbox"/> Others	
Who to send the Invoice to <input checked="" type="checkbox"/> Owner <input type="checkbox"/> Agent <input type="checkbox"/> Other	

Provide a description of the "entire" property			
Concession		Lot	Registered Plan Number
Area in Hectares		Area in Acres	Depth in Meters
Depth in Feet	Frontage in Meters	Frontage in Feet	Width of road allowance (if known)

Reason for Application	
Please indicate the Section of the Planning Act under which this application is being made <input checked="" type="checkbox"/> Section 45(1) relates to a change to a by-law standard (e.g. setbacks, frontage, height, etc.) <input type="checkbox"/> Section 45(2) relates to a change to or expansion of an existing legal non- conforming use	
What is the nature and extent of the relief that is being applied for? Relief from reduced setback to detached garage of 0m from 0.6m	Why is it not possible to comply with the provisions of the by-law? Existing concrete pad where previous sheds were built before ownership was taken over. Previous sheds have been removed and new shed placed on existing concrete pad.

What is the current Official Plan and zoning status?	
Official Plan Designation N/A	Zoning Designation RUR (sp86)
What is the access to the subject property? <input type="checkbox"/> Provincial Highway <input type="checkbox"/> Continually maintained municipal road <input type="checkbox"/> Seasonally maintained municipal road <input checked="" type="checkbox"/> Other <input type="checkbox"/> Continually maintained county road	If other please specify Private
What is the name of the road or street that provides access to the subject property? Wellington Rd 34 E	If access is by water only, please describe the parking and docking facilities used or to be used and the approximate distance of these facilities from the subject land to the nearest public road.

Existing and Proposed Service		
Indicate the applicable water supply and sewage disposal:		
Private Well	<input checked="" type="checkbox"/> Existing	<input type="checkbox"/> Proposed
Communal Water	<input checked="" type="checkbox"/> Existing	<input type="checkbox"/> Proposed
Provincial Water Taking Permit	<input type="checkbox"/> Existing	<input type="checkbox"/> Proposed
Private Septic	<input type="checkbox"/> Existing	<input type="checkbox"/> Proposed
Communal Septic	<input checked="" type="checkbox"/> Existing	<input type="checkbox"/> Proposed
Other Provincial Waste Water System	<input type="checkbox"/> Existing	<input type="checkbox"/> Proposed
How is storm drainage provided? *		
<input checked="" type="checkbox"/> Storm Sewers <input type="checkbox"/> Ditches <input type="checkbox"/> Swales <input type="checkbox"/> Other means		

Existing Subject and Abutting Property Land Uses, Buildings and their Locations	
What is the existing use of the subject property? Residential single family dwelling	What is the existing use of the abutting properties? Residential single family dwelling

Provide the following details for all existing buildings on the subject land		
Main Building Height in Meters N/A	Main Building Height in Feet N/A	Percentage Lot Coverage in Meters 31%
Percentage Lot Coverage in Feet N/A	Number of Parking Spaces 4	Number of Loading Spaces n/a
Number of Floors 1	Total Floor Area in Square Meters 115.57	Total Floor Area in Square Feet 1244
Ground Floor Area (Exclude Basement) in Square Meters 115.57	Ground Floor Area (Exclude Basement) in Square Feet 1244	

Provide the following details for all buildings proposed for the subject land		
Main Building Height in Meters 2.65m	Main Building Height in Feet N/A	Percentage Lot Coverage in Meters 32.9%
Percentage Lot Coverage in Feet 32.9%	Number of Parking Spaces 2	Number of Loading Spaces 0
Number of Floors 1	Total Floor Area in Square Meters 8.4m2	Total Floor Area in Square Feet n/a
Ground Floor Area (Exclude Basement) in Square Meters 8.4m2	Ground Floor Area (Exclude Basement) in Square Feet n/a	

What is the location of all buildings existing and proposed for the subject property? (specify distances from front, rear and side lot lines)

Front Yard in Meters N/a	Front Yard in Feet 8 ft	Rear Yard in Meters N/a
Rear Yard in Feet 8ft	Side Yard (interior) in Meters 0m	Side Yard (interior) in Feet n/a
Side Yard (Exterior) in Meters n/a	Side Yard (Exterior) in Feet n/a	

What are the dates of acquisition and construction of subject property and building property

Date of acquisition of subject property June 9 2023	Date of construction of buildings property 2004	How long have the existing uses continued on the subject property? always
Has the owner previously applied for relief in respect of the subject property? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No		

Other Related Planning Applications

Planning Application: Official Plan Amendment <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Planning Application: Zoning By-Law Amendment <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No
Planning Application: Plan of Subdivision <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Planning Application: Consent (Severance) <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No
Planning Application: Site Plan <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Planning Application: Minor Variance <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No

Minor Variance Application must be commissioned

Please confirm the following <input checked="" type="checkbox"/> I understand that prior to the Minor Variance Application being deemed complete it must be commissioned by all registered owners or the agent responsible for the application.
--

SMALL STREAM

CONCRETE PAD
THAT HOUSED
2 OLD SHEDS
10 X24
WANTING TO
PUT ONE BUILDING
INSTEAD OF 2

DECK 10 X43

9X10
SHED

5'3" X 53' SIDE YARD

48'

HOUSE

24'

DRIVE WAY

12'9"X40

15'X21' FRONTAGE

PORCH
8'2" X6'3"

15'X14 FRONTAGE

ROAD

PROPERTY LINE

PROPERTY LINE

PROPERTY LINE

PROPERTY LINE




UTILITY SHED PLANS

ONTARIO - CANADA



PORTABLE BUILDINGS

WIND CHART

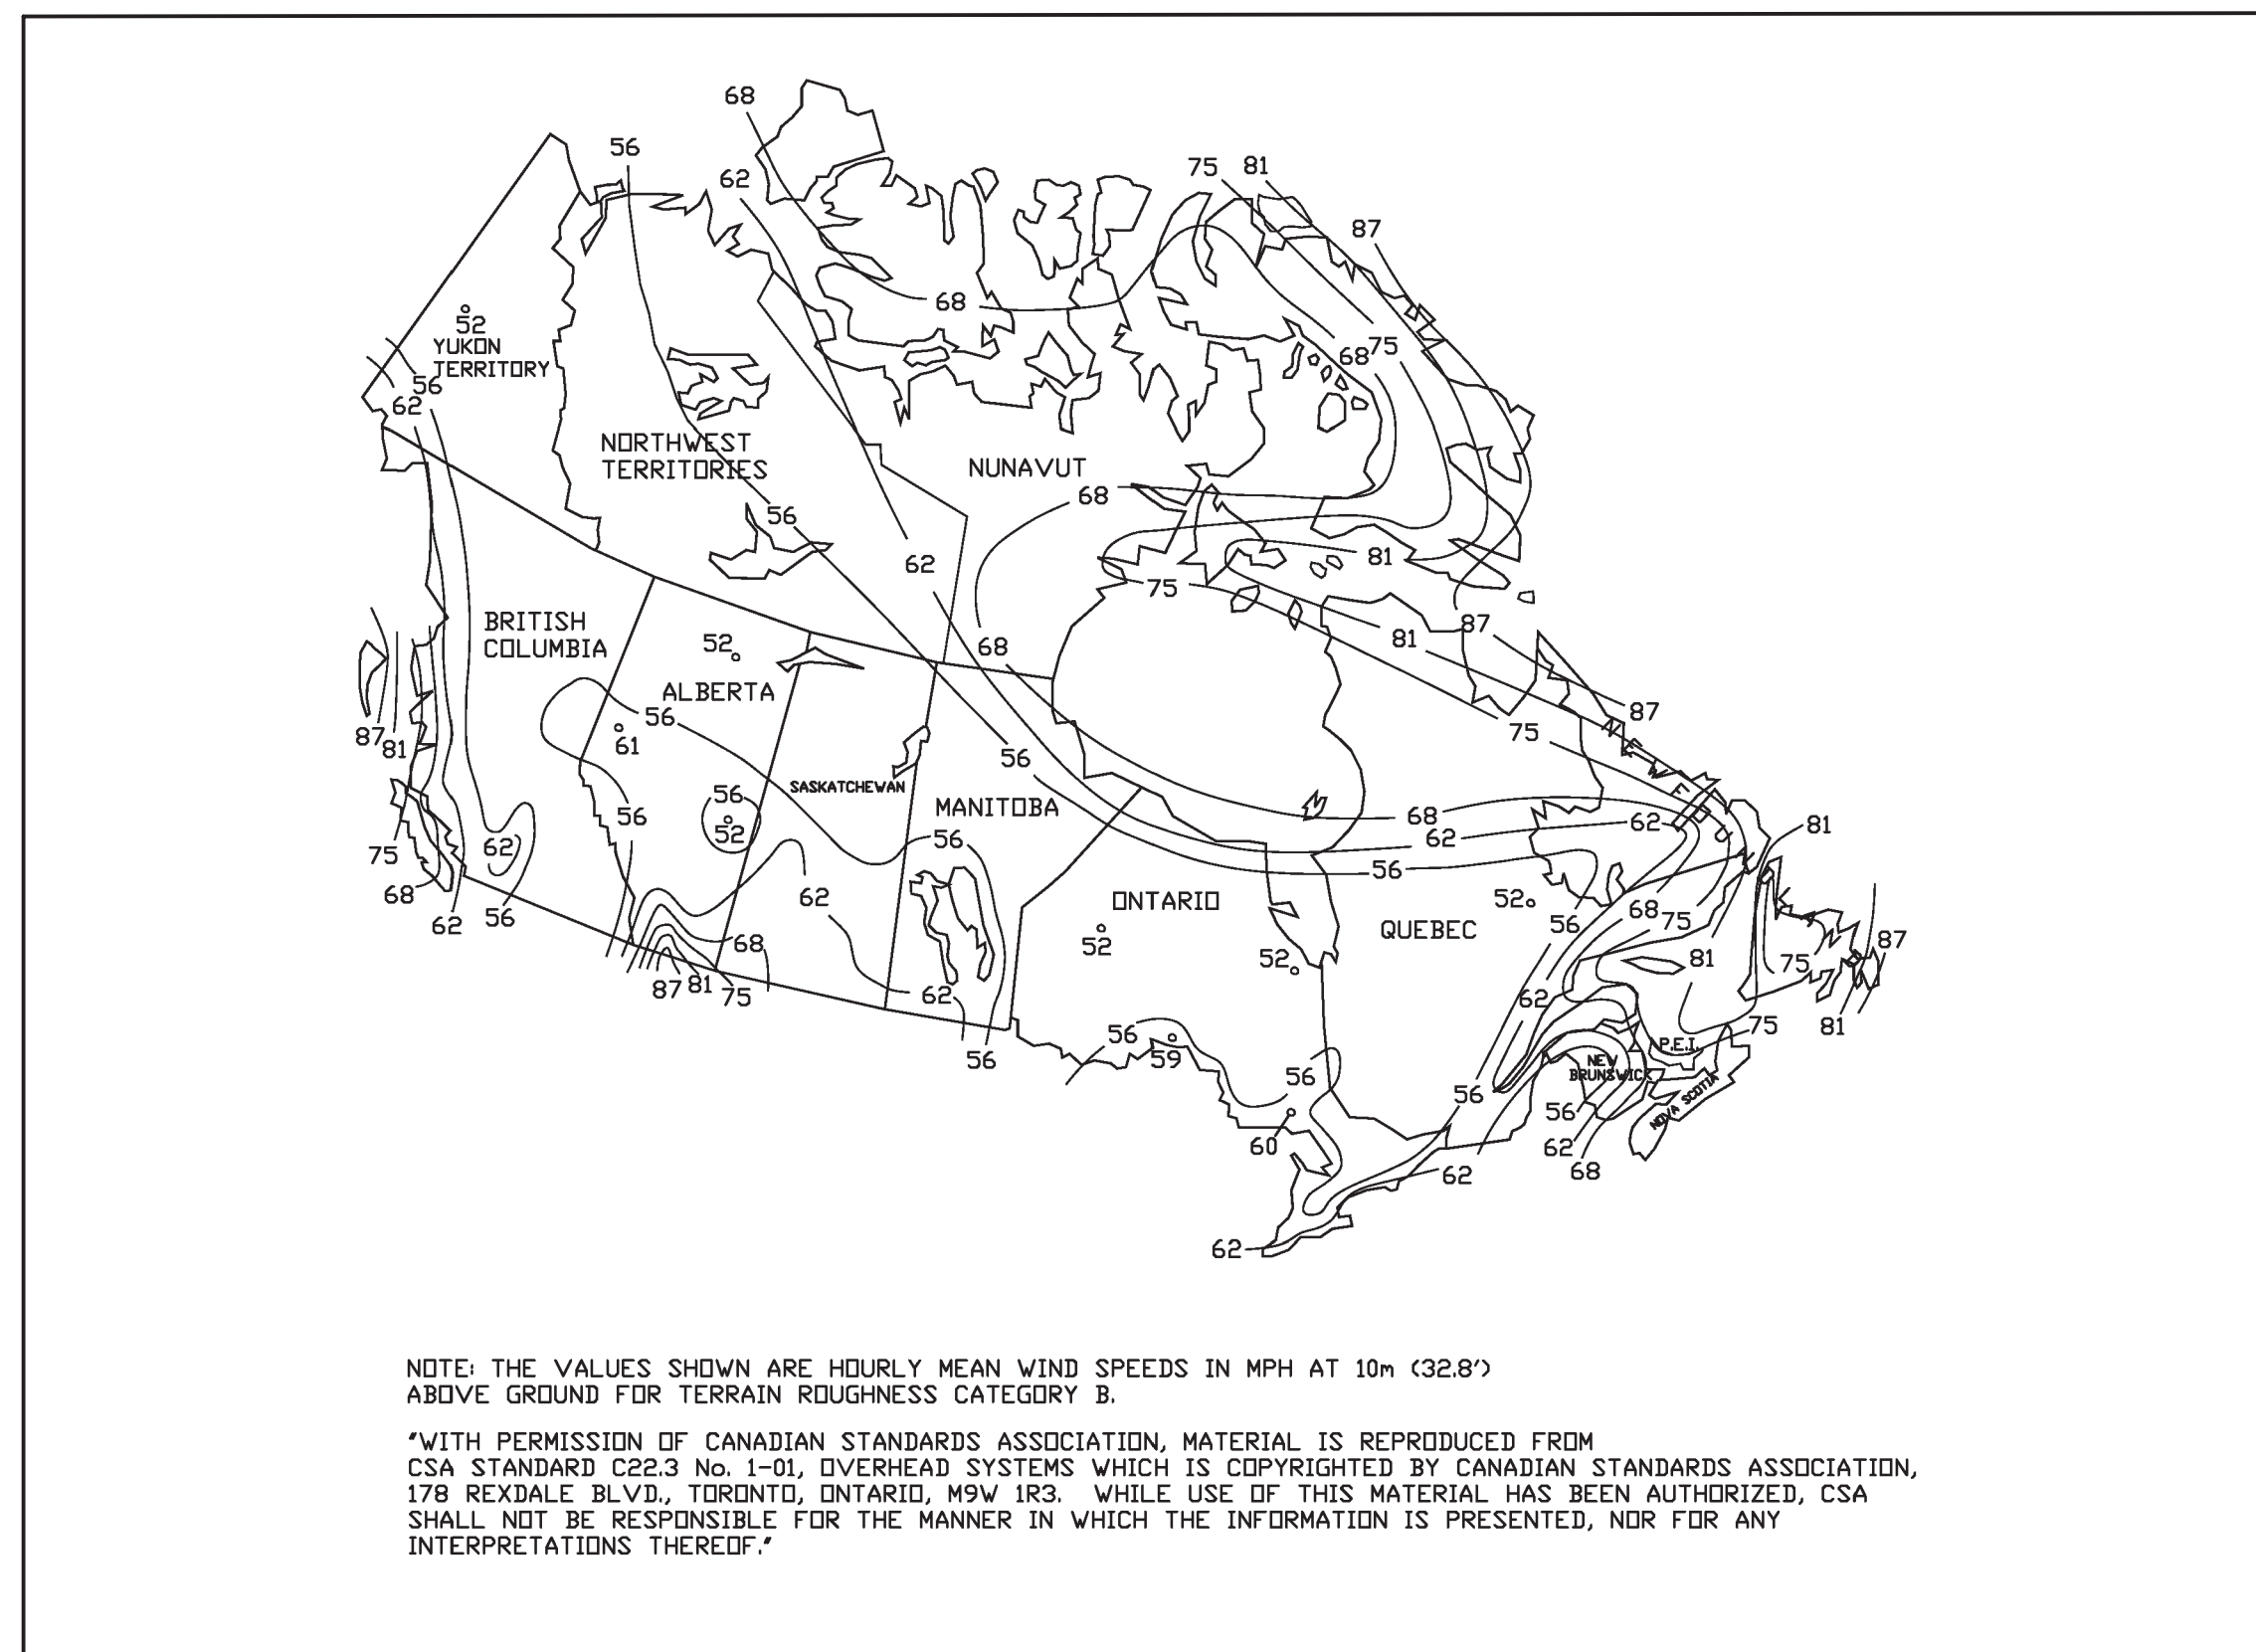

*WITH PERMISSION OF CANADIAN STANDARDS ASSOCIATION, MATERIAL IS REPRODUCED FROM CSA STANDARD C22.3 No. 1-01, OVERHEAD SYSTEMS WHICH IS COPYRIGHTED BY CANADIAN STANDARDS ASSOCIATION, 179 REXDALE BLVD., TORONTO, ONTARIO, M9W 1R3. WHILE USE OF THIS MATERIAL HAS BEEN AUTHORIZED, CSA SHALL NOT BE RESPONSIBLE FOR THE MANNER IN WHICH THE INFORMATION IS PRESENTED, NOR FOR ANY INTERPRETATIONS THEREOF.

GENERAL NOTES:

- NATIONAL BUILDING CODE OF CANADA 2020 AND PROVINCIAL CODE OF ONTARIO AND ALL SUPPLEMENTS AND REVISIONS/ERRATA.
- ALL MATERIALS AND LABOR SHALL BE IN ACCORDANCE WITH THE ABOVE CODE AND ALL OTHER APPLICABLE LOCAL CODES AT THE TIME OF MANUFACTURE.
- WRITTEN DIMENSIONS SHALL TAKE PRECEDENCE OVER SCALED DIMENSIONS.
- THE FOUNDATION PLAN IS A SEPARATE SET OF PLANS FOR APPROVAL BY LOCAL MUNICIPALITIES.
- EXTERIOR DIMENSIONS CAN VARY BETWEEN LIMITS SHOWN @ 2'-0" o/c BUT MEMBER SPACING SHALL NOT EXCEED LIMITS AS INDICATED.
- ALL THE FOLLOWING LUMBER SHALL BE PRESSURE TREATED IN ACCORDANCE WITH AWPA USE CATEGORY UC4B (GROUND CONTACT, HEAVY DUTY) SKIDS.
- ALL THE FOLLOWING LUMBER SHALL BE PRESSURE TREATED IN ACCORDANCE WITH AWPA USE CATEGORY UC3B (EXTERIOR ABOVE GROUND, UNCOATED OR POOR WATER RUNOFF), FLOORS JOISTS, PLYWOOD FLOOR DECKING, AND EXTERIOR RATED WOOD STRUCTURAL PANEL SIDING. TREATED SOUTHERN YELLOW PINE MAY BE USED AS AN APPROVED MATERIAL (SEE PAGE 11 OF DRAWINGS FOR APPROVAL LETTER).
- LP PROSTRUCT SUB-FLOORING 1/2" MAY BE USED IN LIEU OF PRESSURE TREATED PLYWOOD FLOORING.
- P.T. PLYWOOD FLOORING NOT REQUIRED WHERE THE BOTTOM OF THE FLOORING IS OVER 18" ABOVE GROUND.
- ALL FASTENERS AND CONNECTORS IN CONTACT WITH PRESSURE TREATED WOOD SHALL BE HOT DIPPED GALVANIZED (G185) OR STAINLESS STEEL.
- FOR ROOFS WITH ASPHALT SHINGLES AND A SLOPE BETWEEN 2 TO 12 AND 4 TO 12 SHALL HAVE A DOUBLE UNDERLAYMENT APPLICATION AS REQUIRED IN ACCORDANCE TO NBCC 2020.
- ASPHALT SHINGLES SHALL CONFORM TO NBCC 2020.
- FASTENERS FOR ASPHALT SHINGLES SHALL CONFORM TO NBCC 2020.
- TIE-DOWNS SHALL MEET THE REQUIREMENTS OF ALL APPLICABLE CODES.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING ALL EXISTING CONDITIONS.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR DELIVERY AND PLACEMENT OF LAWN STORAGE UNIT TO INSURE THE INTEGRITY OF THE BUILDING AND ITS COMPONENT PARTS.
- NO FIELD REVISIONS TO ANY STRUCTURAL COMPONENT OR DEVIATION FROM THESE DRAWINGS SHALL BE MADE.
- THE OWNER AND THE CONTRACTOR SHALL HOLD HARMLESS THE ENGINEER FROM AND AGAINST ALL LIABILITY CLAIMS, DAMAGES, LOSSES AND EXPENSES INCLUDING LEGAL FEES ARISING OUT OF OR RESULTING FROM ERROR OR OMISSIONS IN THE PERFORMANCE OF THE WORK BY THE CONTRACTOR.
- SECTIONS AND DETAILS ON THE DRAWINGS ARE INTENDED TO BE TYPICAL AND SHALL APPLY AT ALL SIMILAR LOCATIONS, UNLESS OTHER SECTIONS AND DETAILS ARE SPECIALLY REFERENCED.
- REFER TO SUPPLIED FASTENING SCHEDULE FOR FASTENING BASE ON CONNECTION AND LOCATION OF MEMBERS AS PER 2020 BUILDING CODE TABLE 2304.9.1 UNLESS NOTED OTHERWISE.
- BUILDINGS HAVE BEEN DESIGNED FOR LP SMARTSIDE PREVISION PANEL SIDING, LP SMARTSIDE PRECISION LAP SIDING SHALL NOT BE USED.
- FASTENERS IN LP SMARTSIDE PRECISION PANEL SIDING MUST NOT BE INSTALLED IN PANEL SIDING GROOVES IN THE FIELD OF THE PANEL SIDING OR WHEN THE PANEL SIDING GROOVES OCCUR AT CUT EDGES OF THE PANEL SIDING.
- REFER TO THE ICC-ES EVALUATION REPORT ESR-1301 FOR ADDITIONAL DATA AND SPECIFICATIONS OF LP SMARTSIDE PRECISION PANEL SIDING. MINNESOTA PRODUCT APPROVAL 9190.5 & 9190.6
- MAX OPENING WIDTHS MUST COMPLY WITH DESIGN RATIOS AS PER ANSI/AF&PA SDPWS-2008. BUILDING HAVE DESIGNED TO HAVE ONLY OPENINGS WITH MAX WIDTHS EQUAL TO THOSE IN THE ENDWALL SHEAR WALL CHART.
- THE DESIGN OF THESE BUILDING MEETS CNRC-NRC (CANADA NATIONAL RESEARCH COUNCIL), AND THE (PROVINCIAL BUILDING CODE).
- BUILDING HAVE BEEN DESIGNED TO HAVE ANCHORS DIRECTLY ATTACHED TO ALL FOUR CORNERS OR THE BUILDING TO RESIST TENSION FORCES FROM LATERAL WIND LOADS, THIS DESIGN CONSIDERATION MUST BE MADE BY INSTALLER WHEN ATTACHING ANCHORING SYSTEM TO BUILDING.
- UNLESS NOTED OTHERWISE, ATTACH ALL MANUFACTURED PRODUCTS IN ACCORDANCE WITH MANUFACTURERS SPECIFICATIONS.

NOTES:

THIS BUILDING DOES NOT HAVE RUNNING WATER OR SANITATION SERVICES. THIS BUILDING IS DESIGNED AS A UTILITY SHED TO STORE LAWN EQUIPMENT SUCH AS WHEEL BARROWS GARDENING SUPPLIES, FLOWER POTS, AD CARDBOARD BOXED WITH VARIOUS SMALL ITEMS.

SITE INSTALLED ITEMS:

- NOTE THAT THIS LIST DOES NOT NECESSARILY LIMIT THE ITEMS OF WORK AND MATERIALS THAT MAY BE REQUIRED FOR A COMPLETE INSTALLATION. ALL SITE RELATED ITEMS ARE SUBJECT TO LOCAL JURISDICTIONAL APPROVAL.
- THE COMPLETE FOUNDATION SUPPORT AND TIE-DOWN SYSTEM.
 - RAMPS, STAIRS, AND GENERAL ACCESS TO THE BUILDING IF NECESSARY.
 - GUTTERS AND DOWNSPOUTS ON ALL BUILDINGS WITH EAVES OF LESS THAN 6 INCHES HORIZONTAL PROJECTION EXCEPT FOR GABLE END RAKES.
 - ANCHORS & PADS ARE OPTIONAL, TO BE DETERMINED BY LOCAL CONDITIONS AND BUILDING PROFESSIONALS.

DESIGN CRITERIA:

- WIND VELOCITY 1/50 kPa. Column Div B App C
75 mph = 14.4 psf
- BUILDING CATEGORY I
- WIND EXPOSURE C
- INT. PRESSURE COEFFICIENT ±0.18
- ENCLOSURE CLASSIFICATION ENCLOSED
- BASED ON HEIGHT 15 FEET
- OVERHANG NO
- FLOOR DESIGN LIVE LOAD 50 PSF
FLOOR DESIGN DEAD LOAD 4 PSF
- ROOF DESIGN LIVE LOAD 20 PSF
ROOF DESIGN DEAD LOAD 7 PSF
- WALL DESIGN DEAD LOAD 3 PSF
- SNOW LOAD S=0.8 (0.8SS+SR) Ss<4.4kpa
IF Ss>4.4, (67 psf) SPECIAL ORDER.
TRUSSES/ RAFTERS AT 12" FOR SNOW BETWEEN 67 & 85 PSF
- CONSTRUCTION TYPE V B
- BUILDING OCCUPANCY = U
- FIRE RATING EXT. WALLS 0
- ALLOWABLE NUMBER OF FLOORS 1
- THE CONTRACTOR / MANUFACTURER MUST COMPLY WITH THE FOLLOWING CODES AND ALL OF THEIR AMENDMENTS / SUPPLEMENTS.

CANADA CODE SUMMARY

LATEST BUILDING CODE
2020 NBCC

SHEET LIST

SHEET NUMBER	SHEET TITLE
C-1	COVER SHEET
C-2	FASTENING SCHEDULE / WIND LOADING / SHEARWALL CHART
A-1	FRAMING PLANS & DETAILS
A-2	FRAMING PLANS & DETAILS
A-3	SECTIONS
A-4	PLANS & DETAILS
A-5	TYPICAL DETAILS
A-6	TYPICAL DETAILS
A-7	OPTIONAL PORCH DETAILS
A-8	ANCHORING DETAILS & SCHEDULES
A-9	ANCHORING SPEC SHEETS
A-10	TRUSS DETAILS

AREA FOR APPROVAL STAMPS

PROJECT: UTILITY SHED

COVER SHEET & GENERAL NOTES

DON VAN GERVE, P.E.
SPECIALTY STRUCTURAL ENGINEER



ENGINEERING SERVICES PROVIDED FOR:
PREMIER PORTABLE BUILDINGS
317 EAST STATE LINE ROAD
SOUTH FULTON, TN 38257
WWW.PREMIERBUILDINGS.US

REVISION	DESCRIPTION	DATE	BY
▲			
▲			
▲			
▲			

DATE: 6.30.24
PROJECT NO.: 18285
DRAWING BY: JH
CHK BY: DVG
DWG NO.:

C-1

FASTENING SCHEDULE (2304.9.1 MBC)

CONNECTION	FASTENING	LOCATION
1. JOIST TO SILL OR GIRDER	3 - 8d COMMON (2½"x0.131") 3 - 3"x0.131" NAILS 3 - 3" 14 GAGE STAPLES	TOE-NAIL
2. BRIDGING TO JOIST	2 - 8d COMMON (2½"x0.131") 2 - 3"x0.131" NAILS 2 - 3" 14 GAGE STAPLES	TOE-NAIL EACH END
3. SOLE PLATE TO JOIST OR BLOCKING	16d (3½"x0.135") @ 16" o/c 3"x0.131" NAILS @ 8" o/c 3" 14 GAGE STAPLES @ 12" o/c	TYPICAL FACE NAIL
4. SOLE PLATE TO JOIST OR BLOCKING @ BRACED WALL PANEL	3 - 16d (3½"x0.135") @ 16" o/c 4 - 3"x0.131" NAILS @ 16" o/c 4 - 3" 14 GAGE STAPLES @ 16" o/c	BRACED WALL PANELS
5. TOP PLATE TO STUD	2 - 16d (3½"x0.162") 3 - 3"x0.131" NAILS 3 - 3" 14 GAGE STAPLES	END NAIL
6. STUD TO SOLE PLATE	4 - 8d COMMON (2½"x0.131") 4 - 3"x0.131" NAILS 3 - 3" 14 GAGE STAPLES	TOE-NAIL
		END NAIL
7. DOUBLE STUDS	16d (3½"x0.135") @ 24" o/c 3"x0.131" NAILS @ 8" o/c 3" 14 GAGE STAPLES @ 8" o/c	FACE NAIL
8. DOUBLE TOP PLATES	16d (3½"x0.135") @ 16" o/c 3"x0.131" NAILS @ 12" o/c 3" 14 GAGE STAPLES @ 12" o/c	TYPICAL FACE NAIL
		LAP SPLICE
9. BLOCKING BETWEEN JOISTS OR TRUSSES TO TOP PLATE	3 - 8d COMMON (2½"x0.131") 3 - 3"x0.131" NAILS 3 - 3" 14 GAGE STAPLES	TOE-NAIL
10. TOP PLATES, LAPS AND INTERSECTIONS	2 - 16d (3½"x0.162") 3 - 3"x0.131" NAILS 3 - 3" 14 GAGE STAPLES	FACE NAIL
11. CONTINUOUS HEADER (2) PIECES	8 - 16d COMMON (3½"x0.162")	16" o/c ALONG EDGE
12. CONTINUOUS HEADER TO STUD	4 - 8d COMMON (2½"x0.131")	TOE-NAIL
13. BUILT-UP CORNER STUDS	16d (3½"x0.135") @ 24" o/c 3"x0.131" NAILS @ 16" o/c 3" 14 GAGE STAPLES @ 16" o/c	@ 24" o/c @ 16" o/c @ 16" o/c
14. DOUBLE TOP PLATES	20d (4"x0.192") @ 32" o/c 3"x0.131" NAILS @ 24" o/c 3" 14 GAGE STAPLES @ 24" o/c	FACE NAIL @ TOP & BOTTOM STAGGERED ON OPP. SIDES
		FACE NAIL @ ENDS AND AT EACH SPLICE
15. JOIST TO BAND JOIST	3 - 16d COMMON (3½"x0.162") 4 - 3"x0.131" NAILS 4 - 3" 14 GAGE STAPLES	FACE NAIL
16. WOOD STRUCTURAL PANELS AND PARTICLE BOARD SUBFLOOR, ROOF AND WALL SHEATHING (TO FRAMING)	½" AND LESS 6d ^J 2½"x0.113" NAIL ^L 1¼" 16 GAGE ^M 1½" TO ¾" 8d ^I OR 2½"x0.113" NAIL ^N 2" 16 GAGE ^O ¾" TO 1" 10d ^I OR 8d ^I 1½" TO 1¼" 10d ^I OR 8d ^I	SINGLE FLOOR (COMBINATION SUBFLOOR-UNDERLAYMENT TO FRAMING)
		SINGLE FLOOR (COMBINATION SUBFLOOR-UNDERLAYMENT TO FRAMING)
17. 29ga. STEEL SIDING (TO FRAMING)	½" OR LESS 6d ^I ¾" 8d ^I	NAILS @ 6" o/c IN FIELD AND 3" o/c ALONG ALL PANEL EDGES.
18. FIBERBOARD SHEATHING ⁹	½" NO. 11 GAGE ROOFING NAIL ^h 6d COMMON NAIL (2"x0.113") NO 16 GAGE STAPLE ^g	
		2½" NO. 11 GAGE ROOFING NAIL ^h 8d COMMON NAIL (2½"x0.131") NO 16 GAGE STAPLE ^g

SHEARWALL CHART

BUILDING WIDTH	OPENING WIDTHS IN ENDWALL	MAX. LENGTH OF BUILDING		
		19/32" T1-11 ¹	¾" LP SMARTSIDE PANEL ²	ALUMINUM OVER 7/16" OSB ⁴
8'-0"	3'-0" MAX.	24'-0"	20'-0"	24'-0"
10'-0"	3'-0" MAX.	30'-0"	30'-0"	30'-0"
	6'-0"		16'-0"	
11'-2"	3'-0" MAX.	36'-0"	36'-0"	36'-0"
	6'-0"		24'-0"	
	9'-0"		12'-0"	
14'-0"	3'-0" MAX.	40'-0"	40'-0"	40'-0"
	6'-0"		34'-0"	
16'-0"	3'-0" MAX.	40'-0"	40'-0"	40'-0"
	6'-0"		30'-0"	

- COMMON OR BOX NAIL ARE PERMITTED TO BE USED EXCEPT WHERE OTHERWISE STATED.
- NAILS SPACED @ 6" o/c AT EDGES, 12" AT INTERMEDIATE SUPPORTS EXCEPT 6" AT SUPPORTS WHERE SPANS ARE 48" OR MORE, FOR NAILING OF WOOD STRUCTURAL PANEL AND PARTICLE BOARD DIAPHRAGMS AND SHEAR WALLS, REFER TO SECTION 2305 FBC. NAILS FOR WALL SHEATHING ARE PERMITTED TO BE COMMON, BOX OR CASING.
- COMMON OR DEFORMED SHANK (6d - 2"x0.113"; 8d - 2½"x0.131"; 10d 3"x0.148").
- COMMON (6d - 2"x0.113"; 8d - 2½"x0.131"; 10d 3"x0.148").
- DEFORMED SHANK (6d - 2"x0.113"; 8d 2½"x0.131" 10d 3"x0.148").
- CORROSION-RESISTANT SIDING (6d - 1½"x0.106"; 8d 2½"x0.128") OR CASING (6d2"x0.099"; 8d 2 ½"x0.113") NAIL. FASTENERS SPACED 3" o/c AT EXTERIOR EDGES AND 6" o/c AT INTERMEDIATE SUPPORTS WHEN USED AS STRUCTURAL SHEATHING.
- CORROSION-RESISTANT ROOFING NAILS w/ 7/16" DIAMETER HEAD AND 1 ½" LENGTH FOR ½" SHEATHING AND 1 ¾" LENGTH FOR ¾" SHEATHING.
- CORROSION-RESISTANT STAPLES WITH NOMINAL 7/16" CROWN OR 1" CROWN AND 1 ¼" LENGTH FOR ½" SHEATHING AND 1 ½" LENGTH FOR ¾" SHEATHING. PANEL SUPPORTS @ 16" o/c(20" IF STRENGTH AXIS IS THE LONG DIRECTION OF THE PANEL, UNLESS OTHERWISE MARKED.)
- FOR ROOF SHEATHING APPLICATIONS, 8d NAILS (2½"x0.113") ARE THE MINIMUM REQUIRED FOR WOOD STRUCTURAL PANELS. STAPLES SHALL HAVE A MINIMUM CROWN WIDTH OF 7/16".
- FOR ROOF SHEATHING APPLICATIONS, FASTENERS SPACED 4" o/c AT EDGES, 8" o/c AT INTERMEDIATE SUPPORTS.
- FASTENERS SPACED 4" o/c AT EDGES, 8" o/c AT INTERMEDIATE SUPPORTS FOR SUBFLOOR AND WALL SHEATHING AND 3" o/c AT EDGES, 6" AT INTERMEDIATE SUPPORTS FOR ROOF SHEATHING.
- FASTENERS SPACED 4" o/c AT EDGES, 8" AT INTERMEDIATE SUPPORTS.
- 1 ½" T1-11 SHALL BE FASTENED USING 8d COMMON OR DEFORMED NAILS @ 6" o/c IN FIELD AND 3" o/c ALONG ALL PANEL EDGES.
- ¾" LP SMARTPANEL SHALL BE FASTENED USING 8d COMMON OR DEFORMED NAILS @ 6" o/c IN FIELD AND 3" o/c ALONG ALL PANEL EDGES.
- LIMITATIONS ON THE TOTAL OPENING DIMENSIONS SHALL BE BASED ON THE SHEAR WALL HEIGHT TO WIDTH RATION OF 3.5:1 AND SHALL NOT EXCEED (2/3) OF TOTAL LENGTH OF BUILDING. NAILING IN SIDEWALL USE 8d NAILS COMMON OR DEFORMED AT 6" EVERYWHERE WHEN TOTAL OPENING WIDTHS IN SIDE WALL ARE LESS THAN (2/3) OF TOTAL LENGTH OF BUILDING.
- 29ga. STEEL SIDING OVER 7/16" OSB FASTENED USING 8d COMMON OR DEFORMED NAILS @ 6" o/c IN FIELD AND 3" o/c ALONG ALL PANEL EDGES.





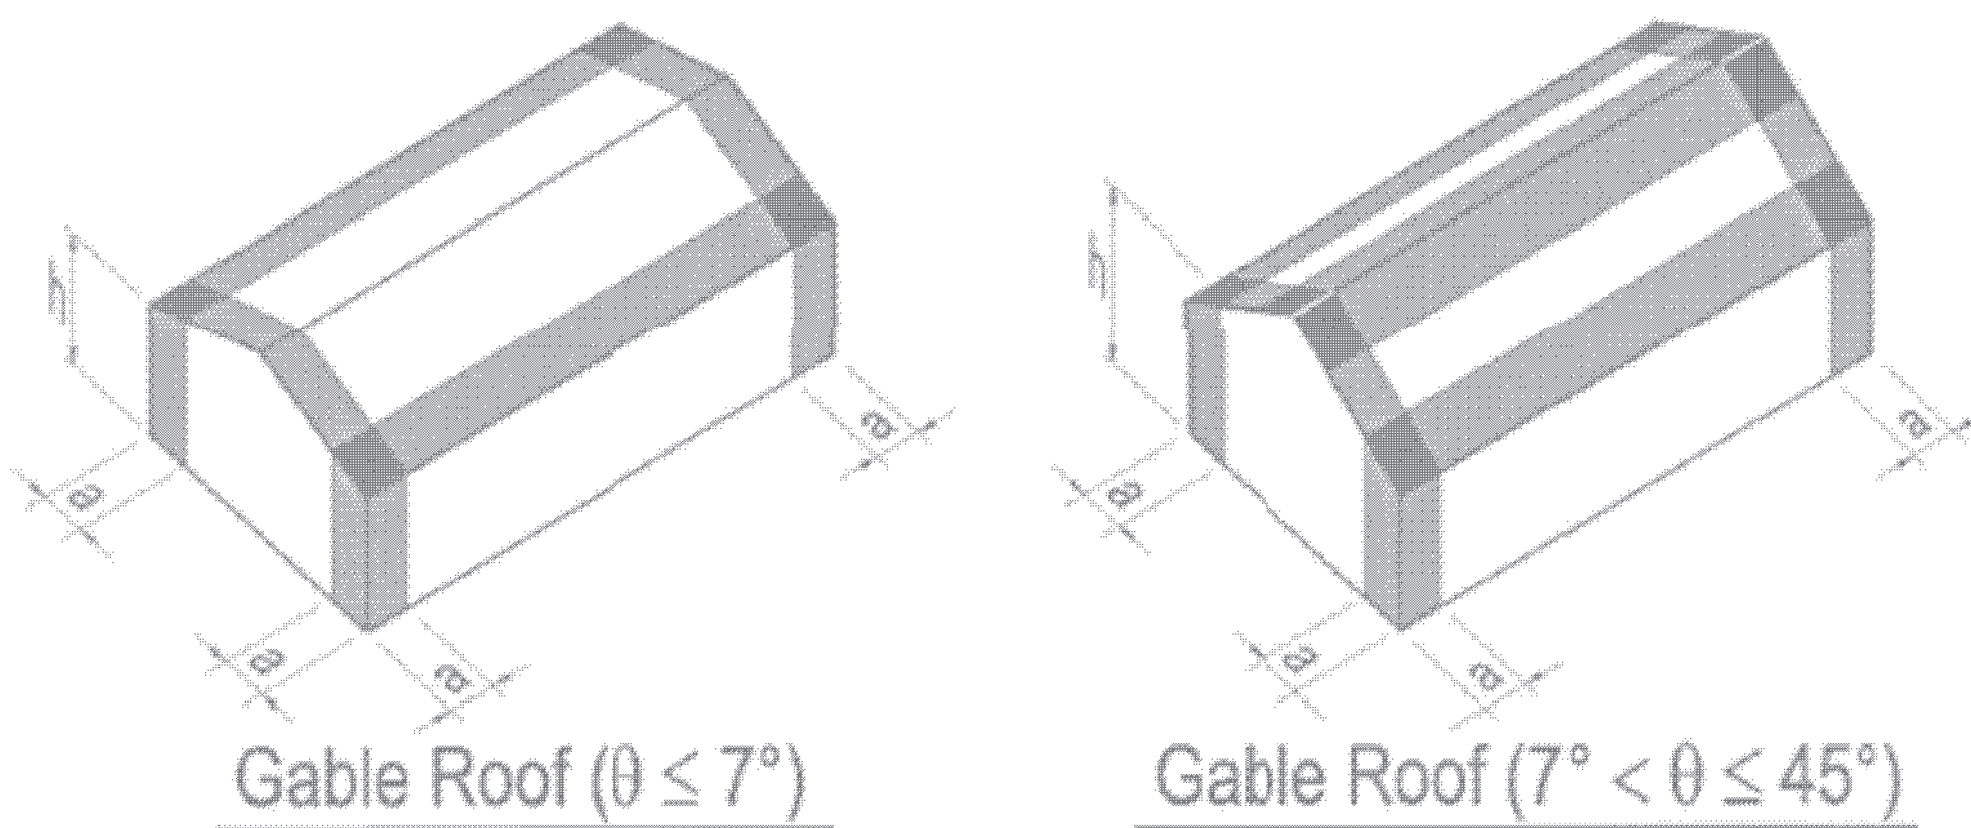


FIGURE 1609.6.2.2 COMPONENT AND CLADDING PRESSURE

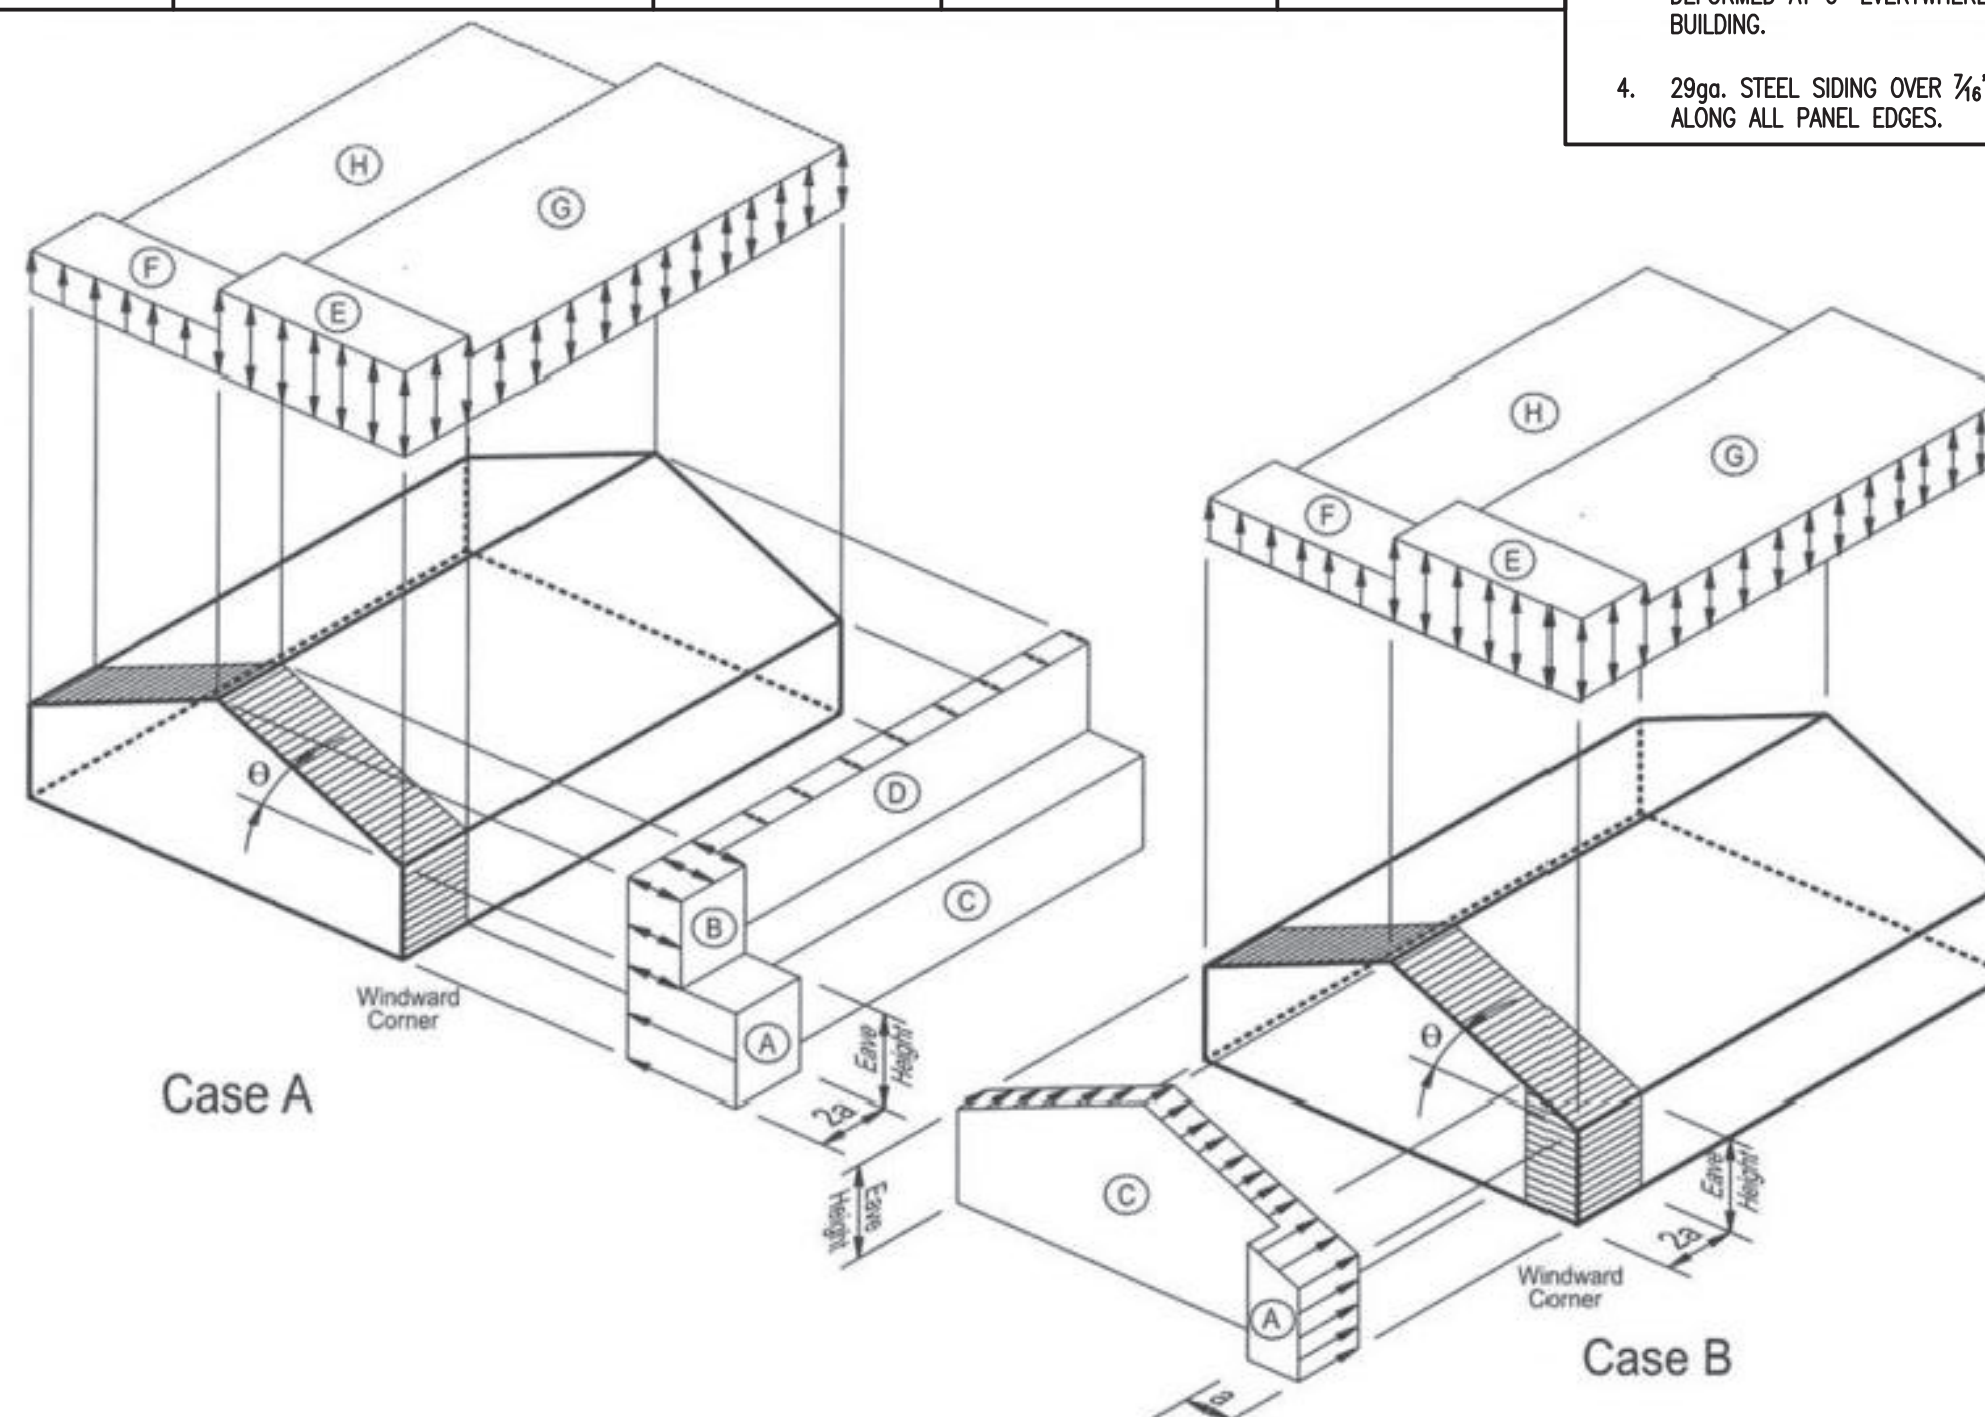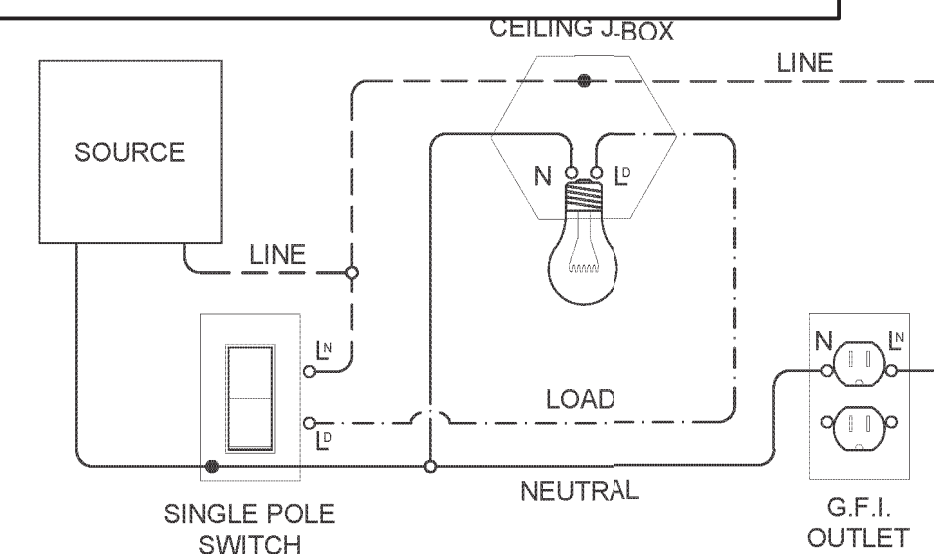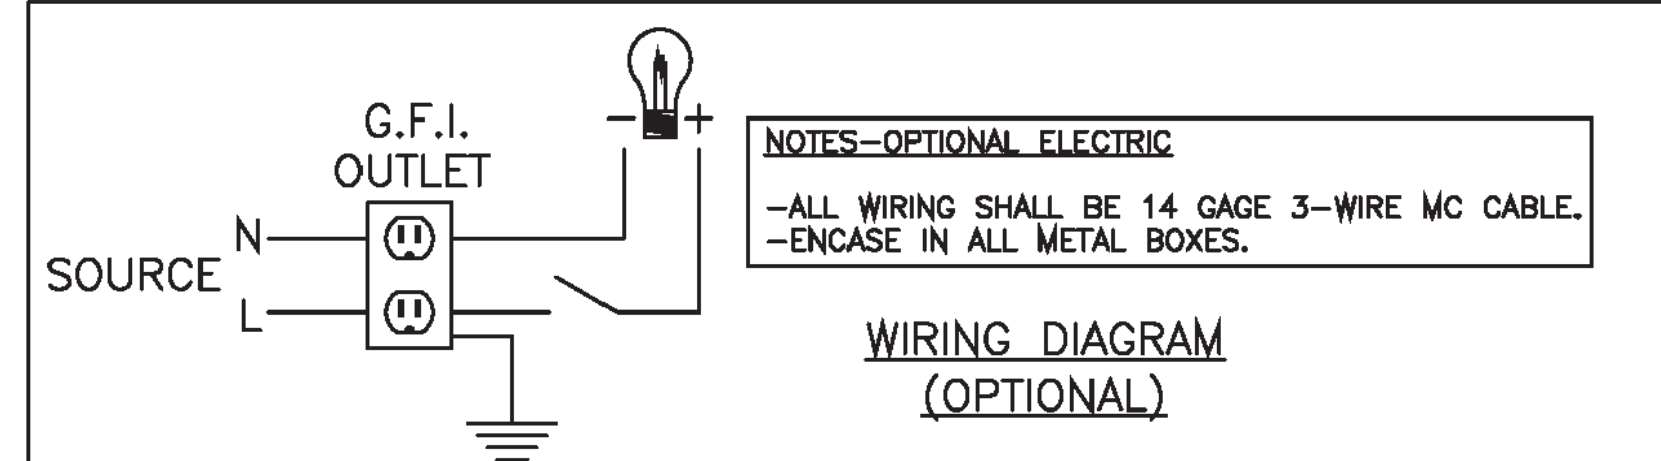

ELECTRICAL NOTES & OPTIONS:
 - AS PER NEX ARTICLE 330.30(B) SECURING OF MC TYPE CABLE, UNLESS OTHERWISE PROVIDED, CABLES SHALL BE SECURED AT INTERVALS NOT EXCEEDING 6FT. CABLES CONTAINING FOUR OR FEWER CONDUCTORS SIZED NO LARGER THAN 10 AWG SHALL BE SECURED WITHIN 12 IN. OF EVERY BOX, CABINET, FITTING, OR OTHER CABLE TERMINATION.
 - ALL WIRING SHALL BE 14 GAUGE 3-WIRE MC CABLE. -ENCASE IN ALL METAL BOXES.
 MAXIMUM NO. OF OUTLETS: 7
 MAXIMUM NO. OF LIGHTS: 8

ELECTRICAL WIRING DIAGRAM SCALE: NOT TO SCALE

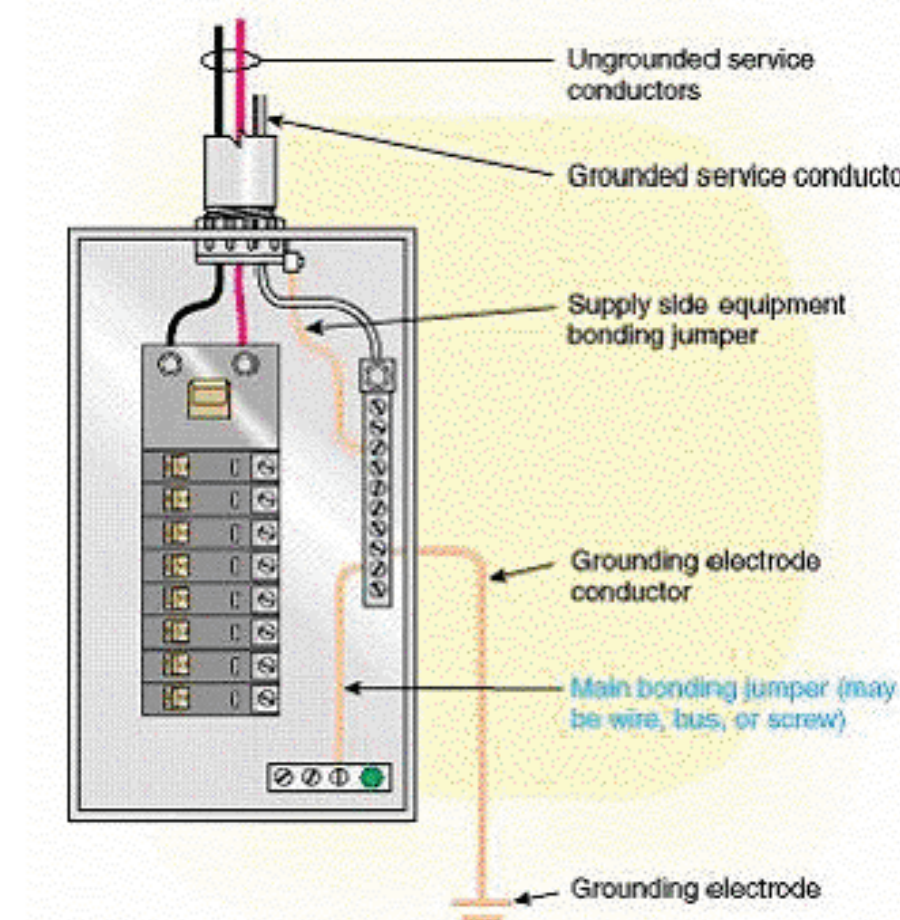

AREA FOR APPROVAL STAMPS

PROJECT: UTILITY SHED

FASTENING SCHEDULE / WIND LOADING


DON VAN GERVE, P.E.
SPECIALTY STRUCTURAL ENGINEER




ENGINEERING SERVICES PROVIDED FOR:
 PREMIER PORTABLE BUILDINGS
 317 EAST STATE LINE ROAD
 SOUTH FULTON, TN 38257
 WWW.PREMIERBUILDINGS.US

REVISION	DESCRIPTION	DATE	BY
▲			
▲			
▲			
▲			

DATE: 6.30.24
 PROJECT NO.: 18285
 DRAWING BY: JH
 CHK BY: DVG
 DWG NO.: C-2

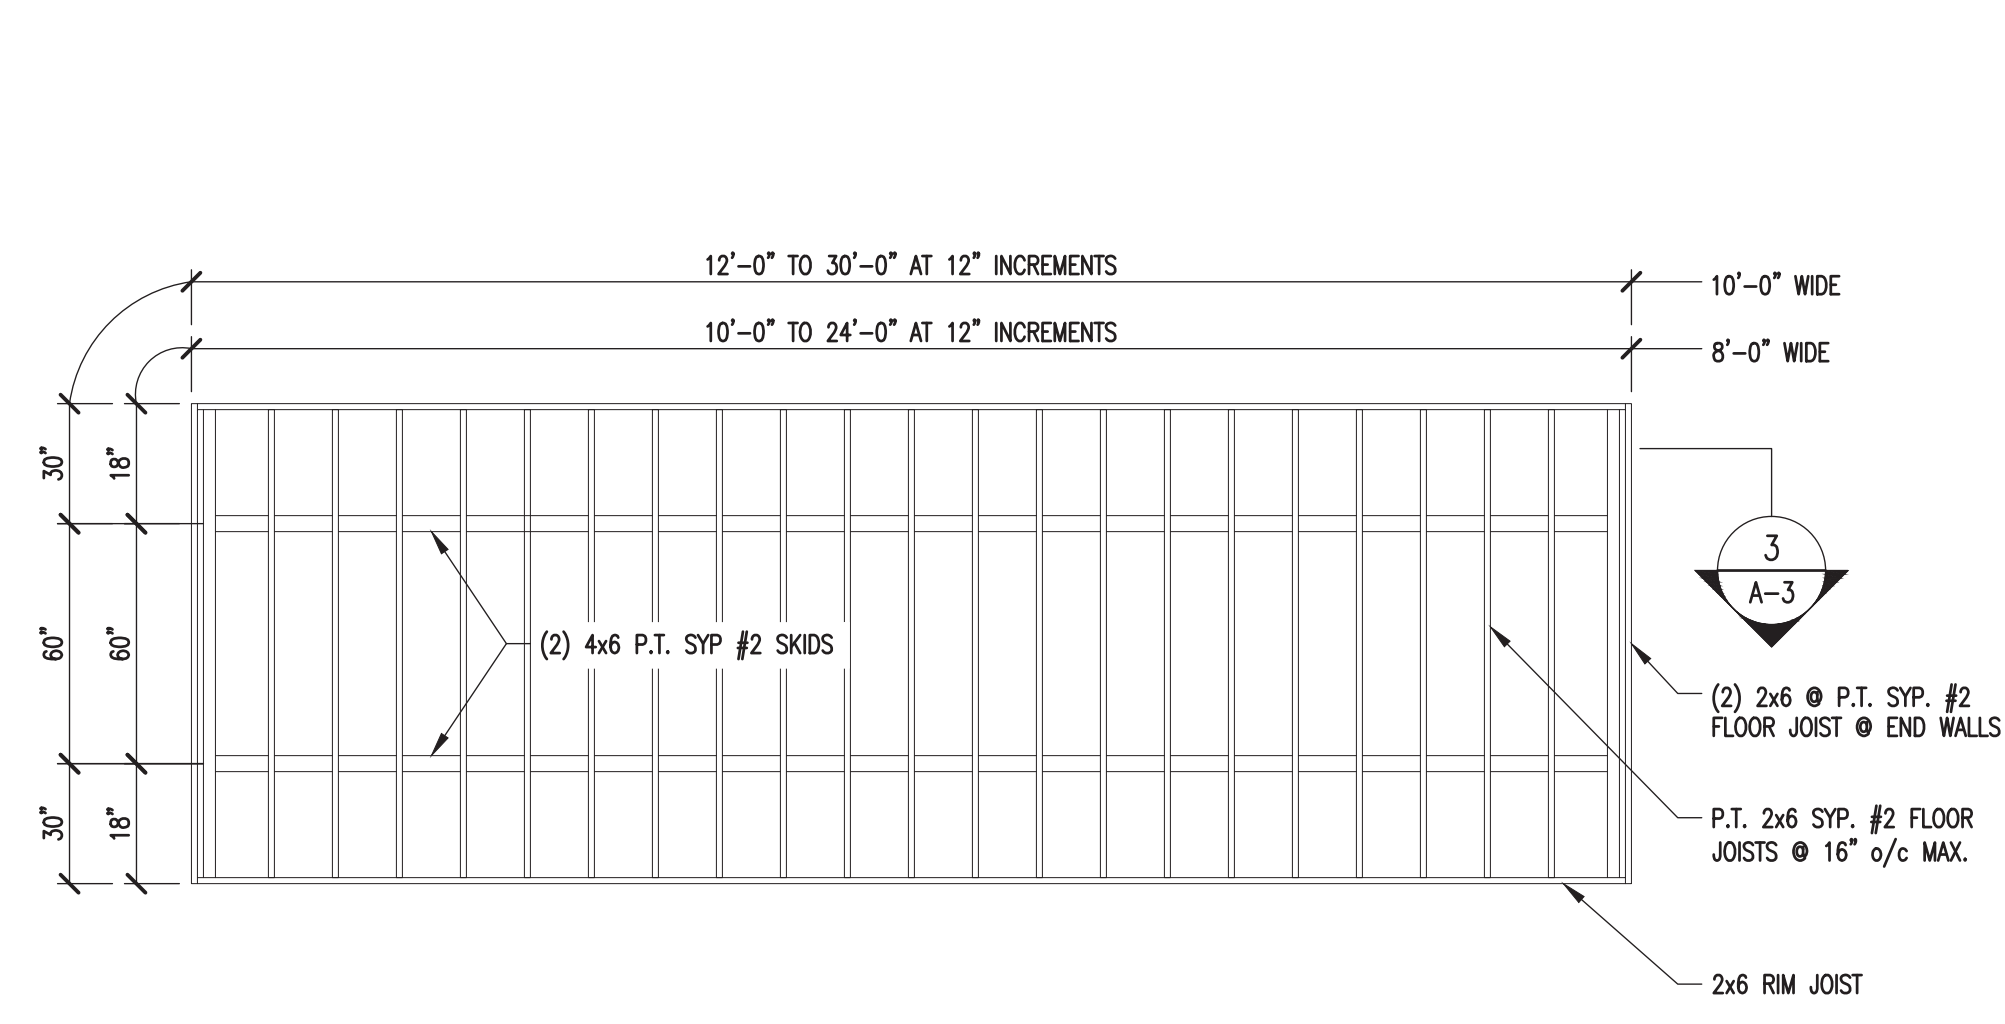


1
8'-0" & 10'-0" WIDE
FLOOR FRAMING PLAN
SCALE: 1/4"=1'-0" (DO NOT SCALE DRAWING)

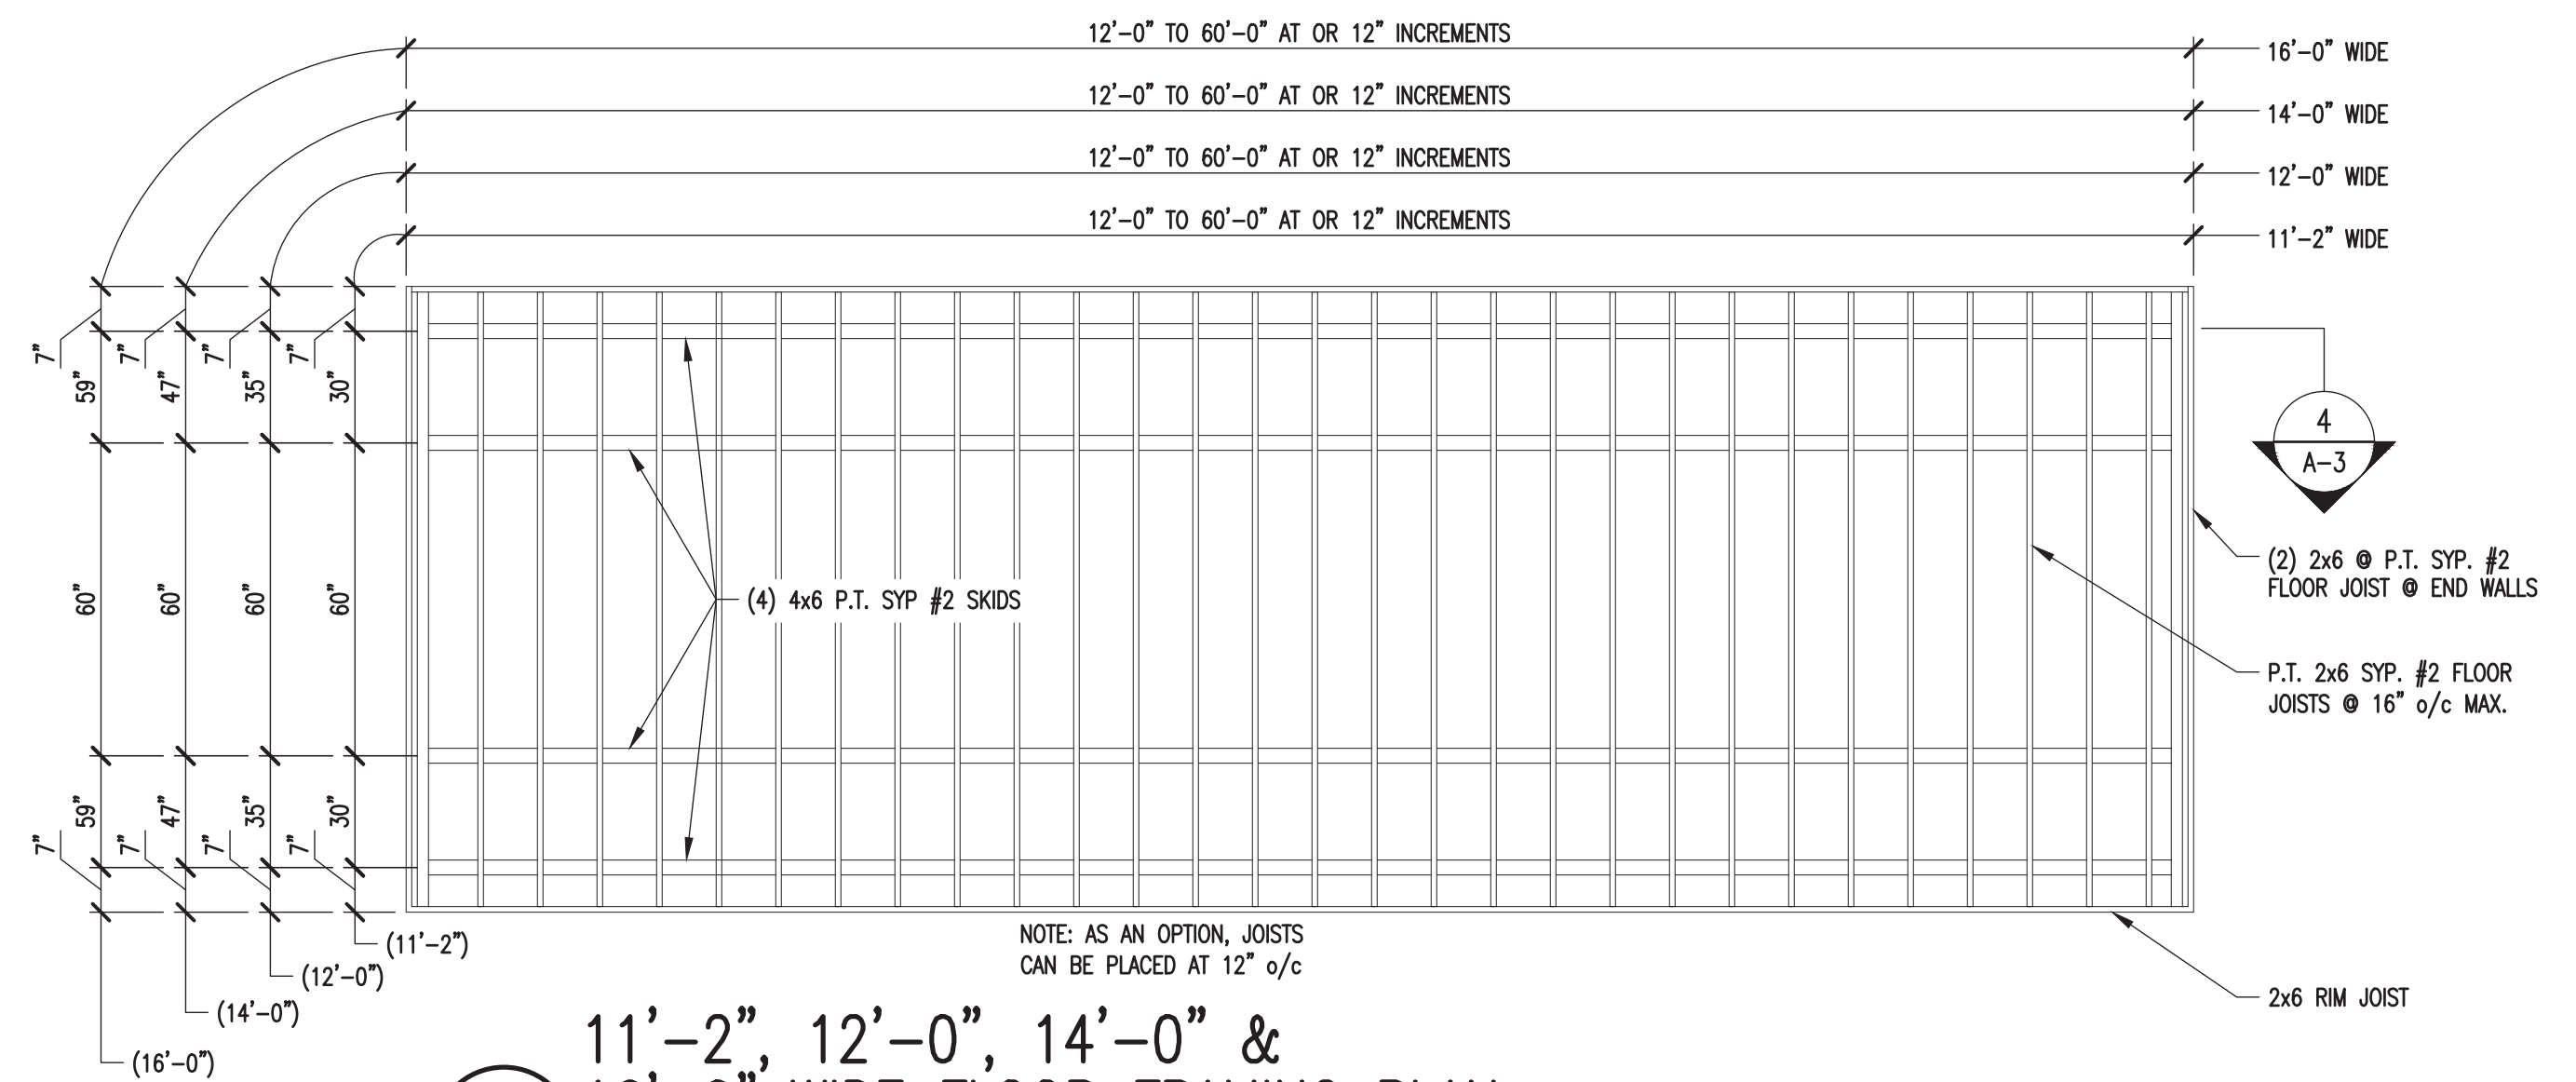


2
11'-2", 12'-0", 14'-0" &
16'-0" WIDE FLOOR FRAMING PLAN
SCALE: 1/4"=1'-0" (DO NOT SCALE DRAWING)


NOTE:
1. 2x6 STUD FRAMING MAY BE USED IN LIEU OF 2x4s (ALSO FOR ROOF TRUSSES AS WELL)

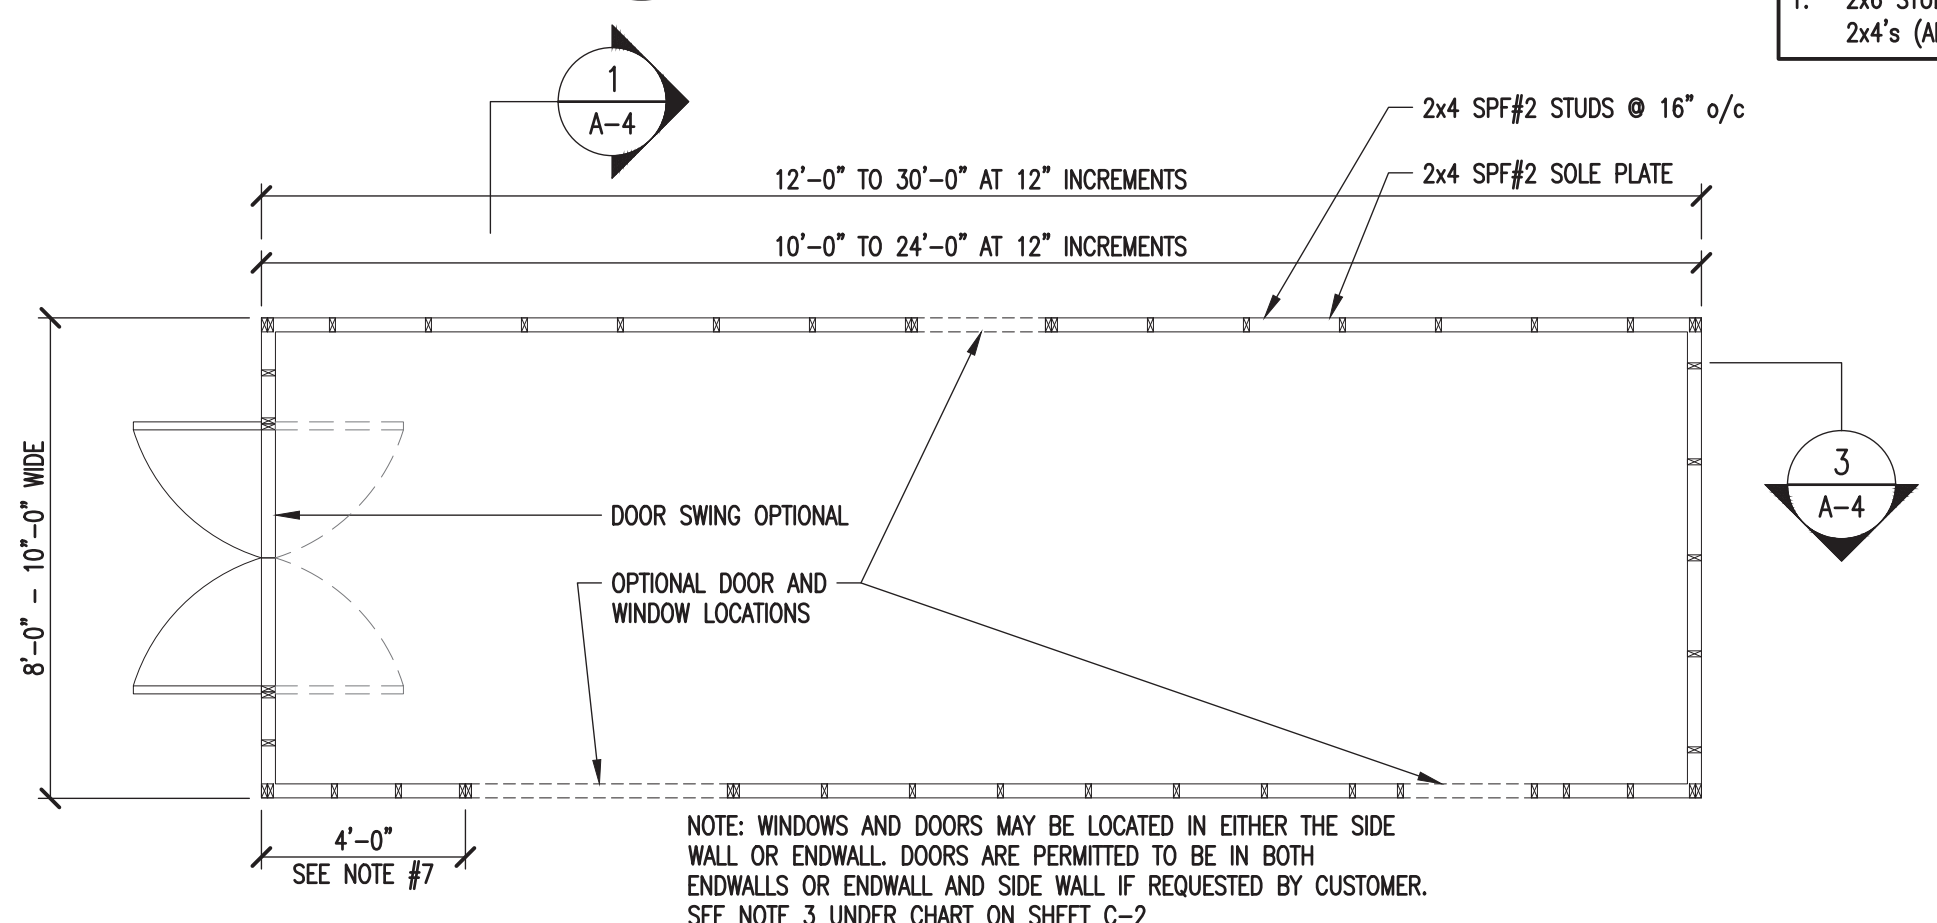


3
FLOOR DECK PLAN
SCALE: 1/4"=1'-0"

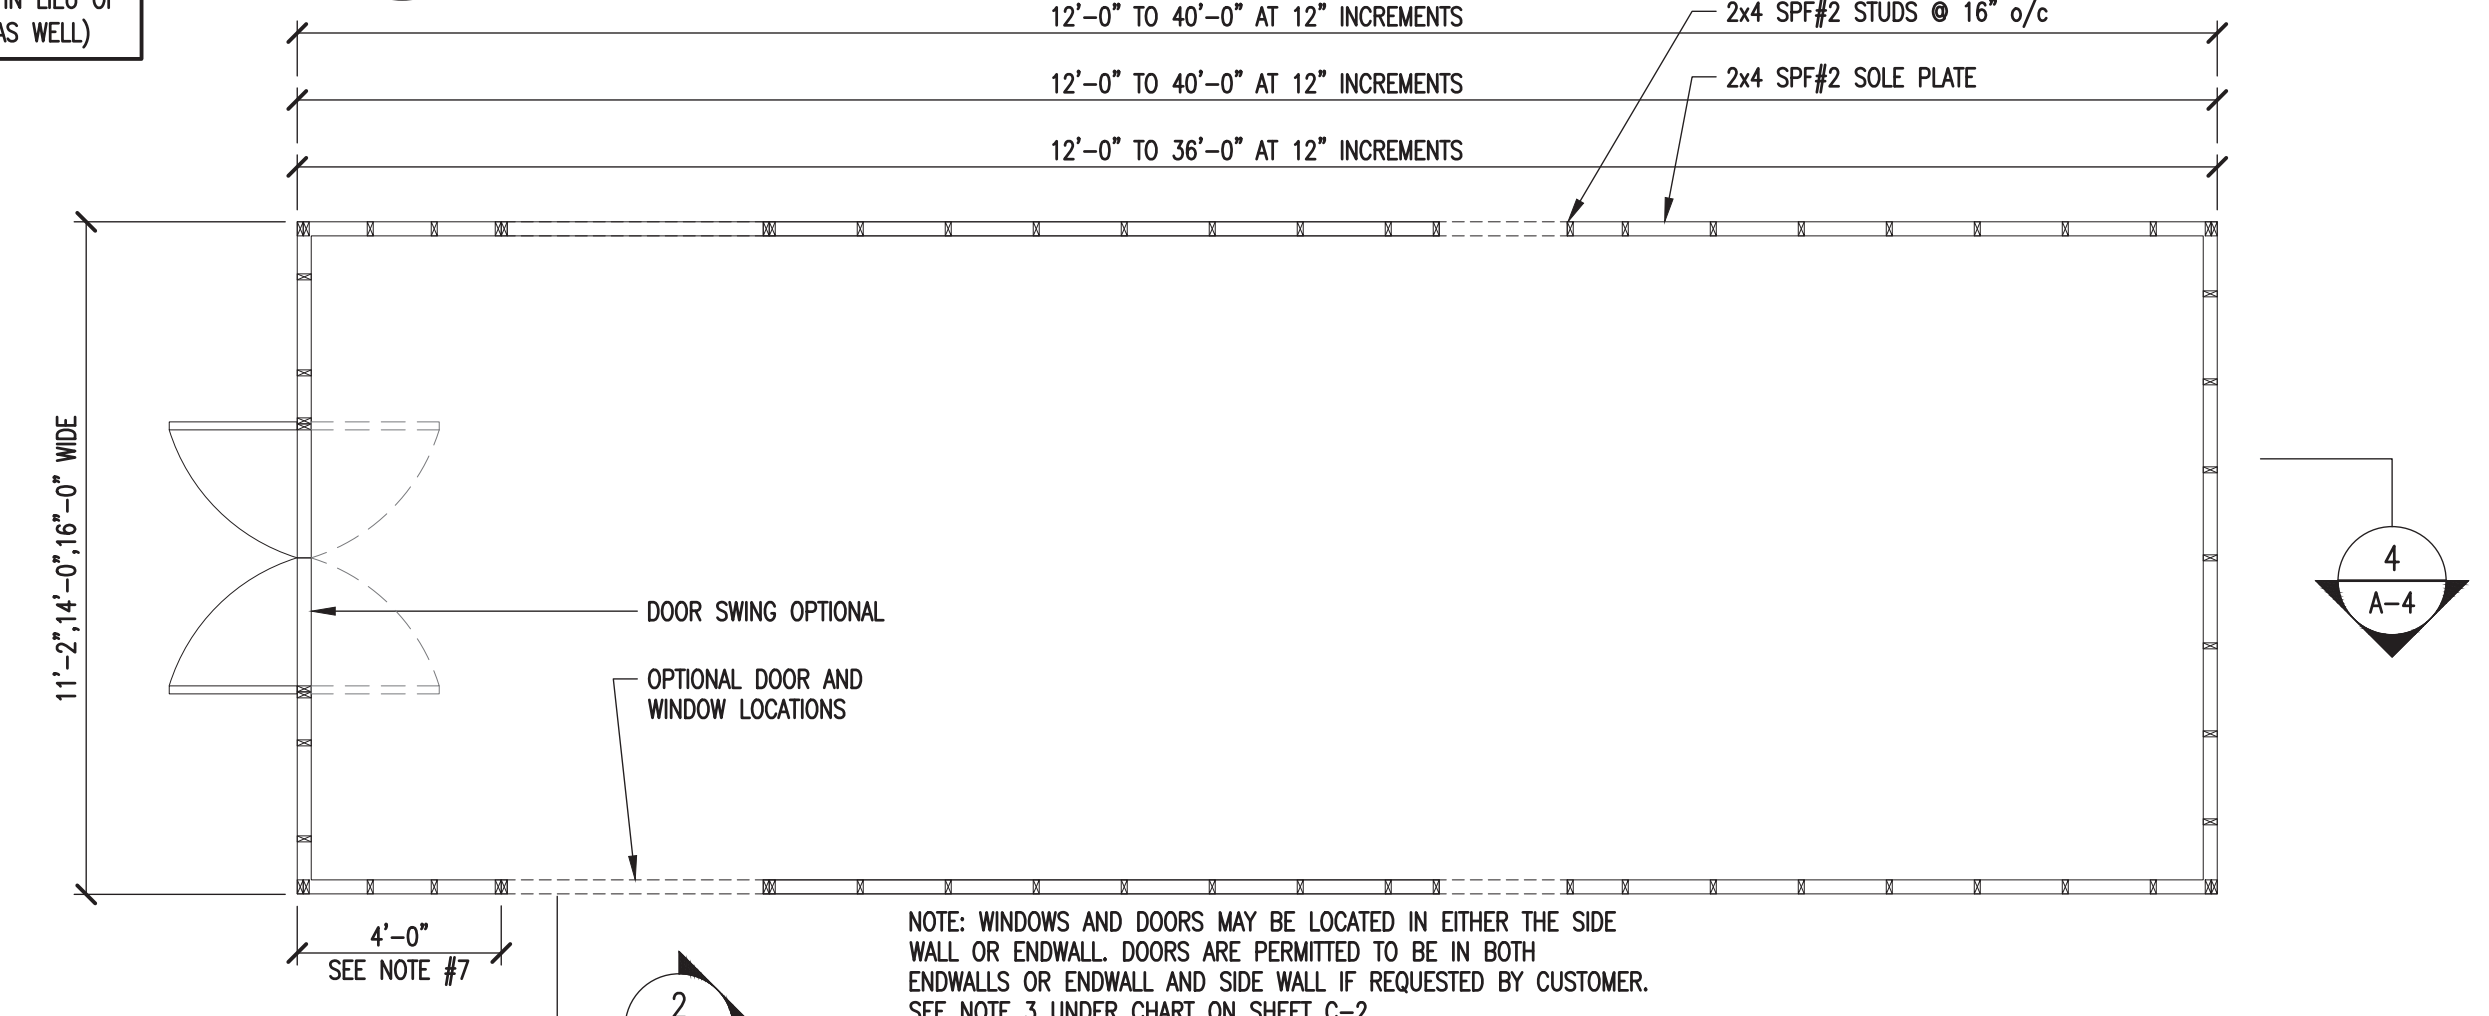


4
FLOOR DECK PLAN
SCALE: 1/4"=1'-0"

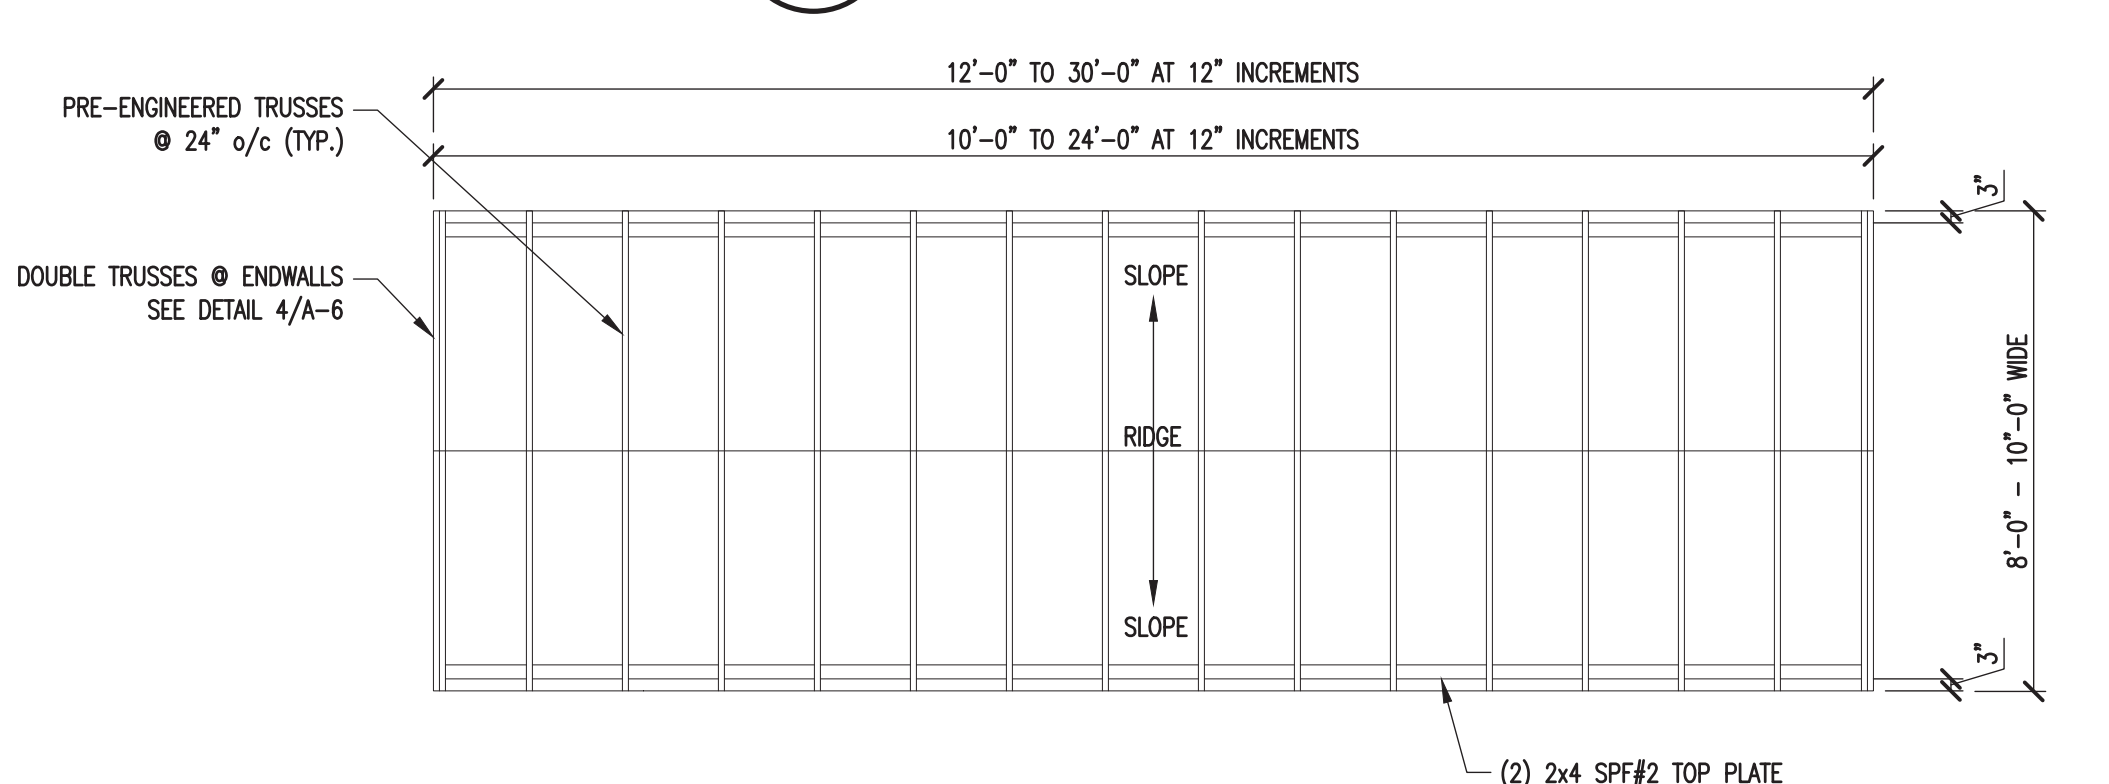

5
ROOF PLAN
SCALE: 1/4"=1'-0"

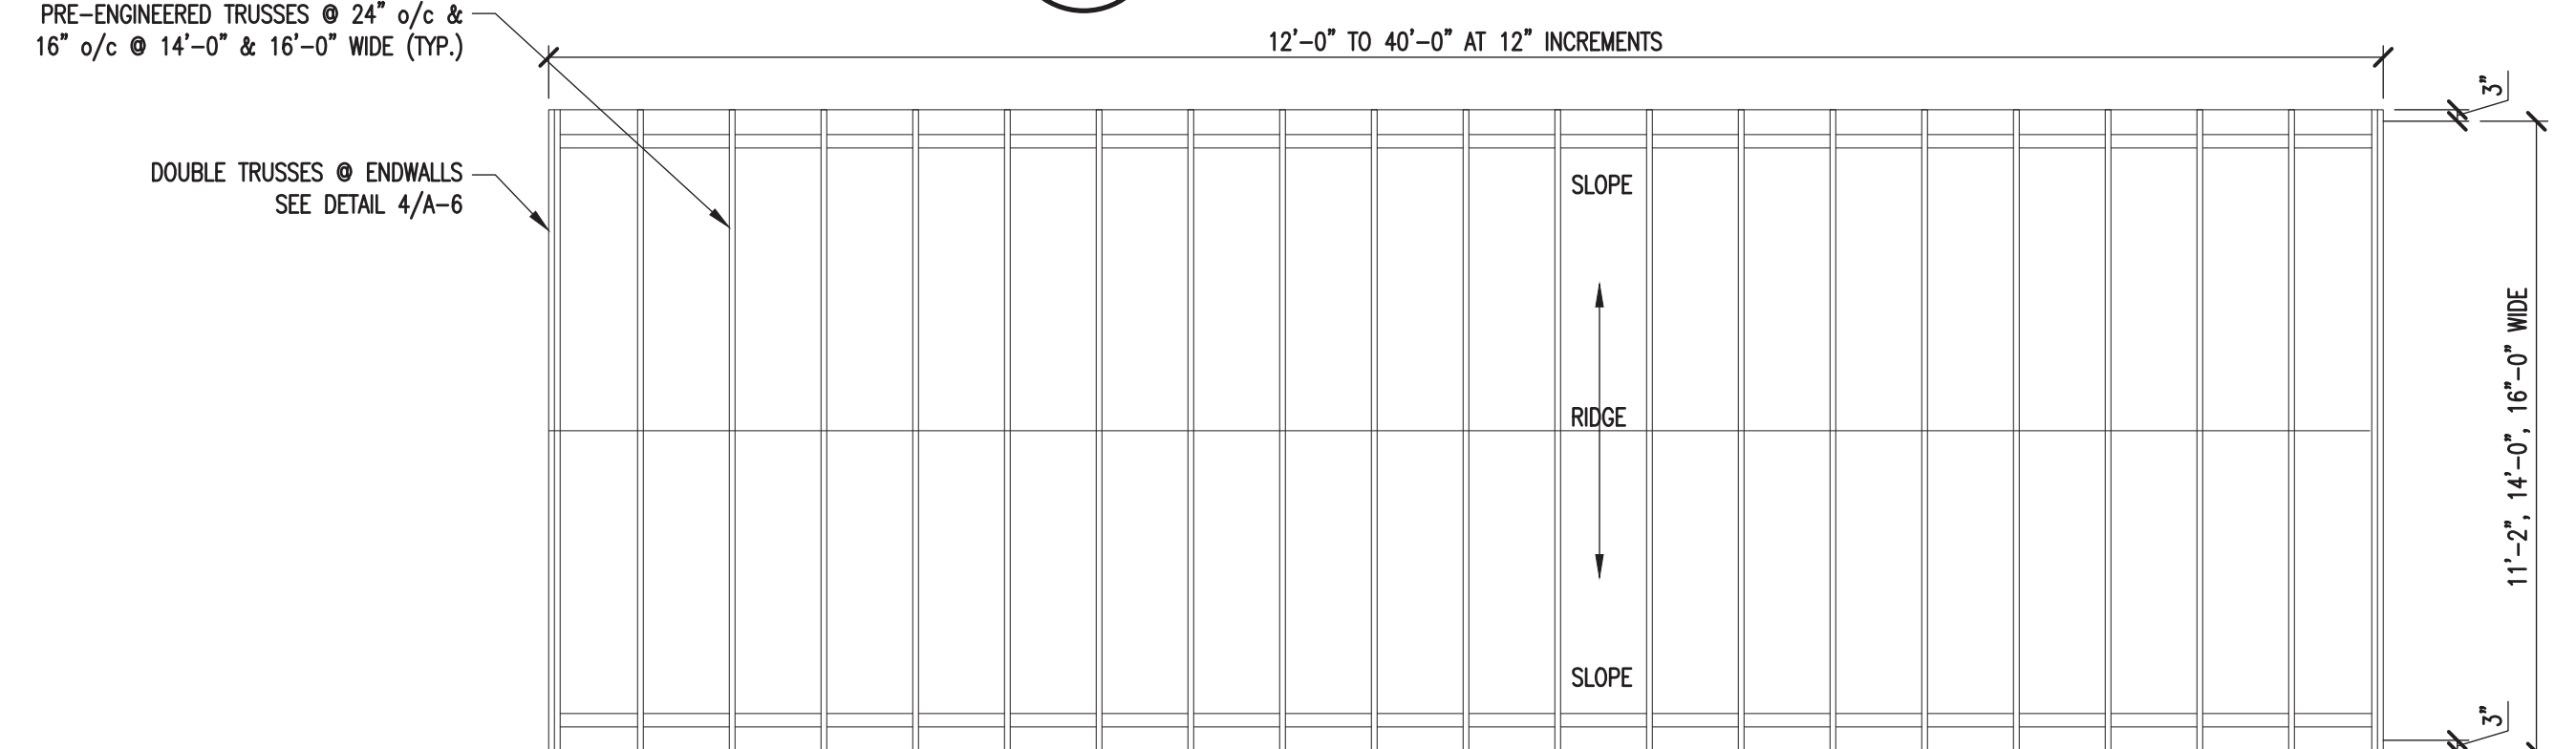


6
ROOF PLAN
SCALE: 1/4"=1'-0"

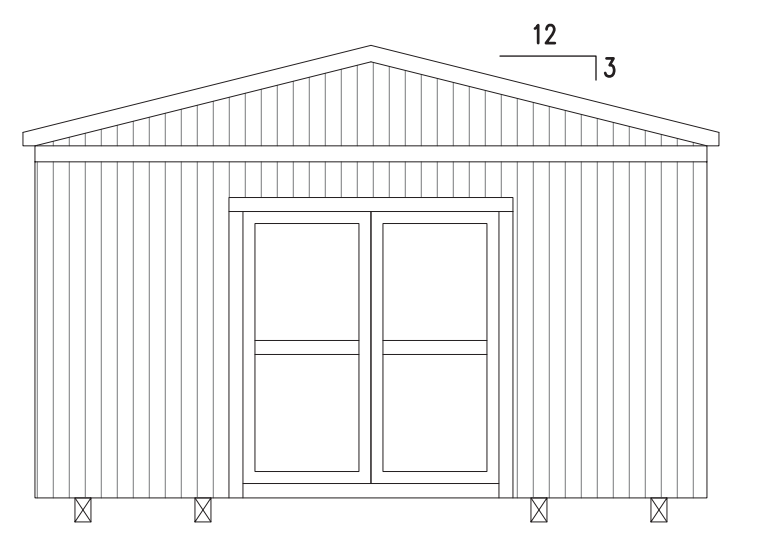


7
GABLE ENDWALL ELEVATION
SCALE: 1/4"=1'-0"

NOTE:
1. DOUBLE WALL STUDS SHALL BE FASTENED AS PER FASTENING SCHEDULE PROVIDED.
2. SEE 12/A-4 FOR CORNER STUD DETAIL. FOR ALL FASTENING NOT SHOWN, SEE FASTENING SCHEDULE ON SHEET C-2.
3. AS AN OPTION, STUDS CAN BE PLACED @ 16" o/c.
4. ALL BUILDING w/ TRUSSES AND STUDS 2'-0" o/c CAN ONLY USE SINGLE TOP PLATE.
5. STUDS SHALL FALL IN LINE w/ TRUSSES.
6. STUDS @ 16" o/c FOR FIRST 4' FOR ALL CORNERS.

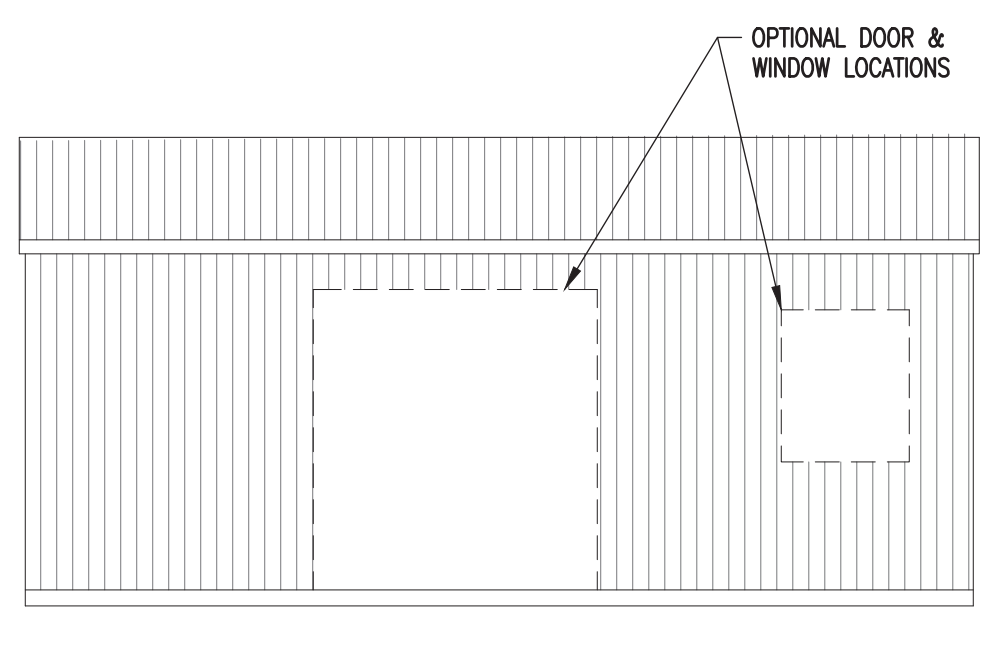


8
SIDEWALL ELEVATION
SCALE: 1/4"=1'-0"

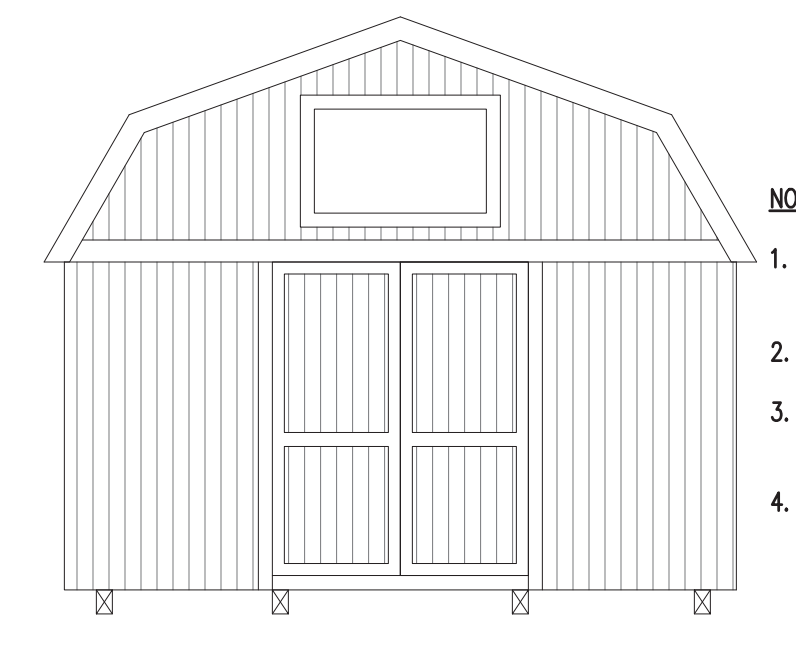

9
GAMBREL ENDWALL ELEVATION
SCALE: 1/4"=1'-0"

NOTE:
1. DOUBLE WALL STUDS SHALL BE FASTENED AS PER FASTENING SCHEDULE PROVIDED.
2. SEE 12/A-4 FOR CORNER STUD DETAIL.
3. FOR ALL FASTENING NOT SHOWN, SEE FASTENING SCHEDULE ON SHEET C-2.
4. AS AN OPTION, STUDS CAN BE PLACED @ 16" o/c.

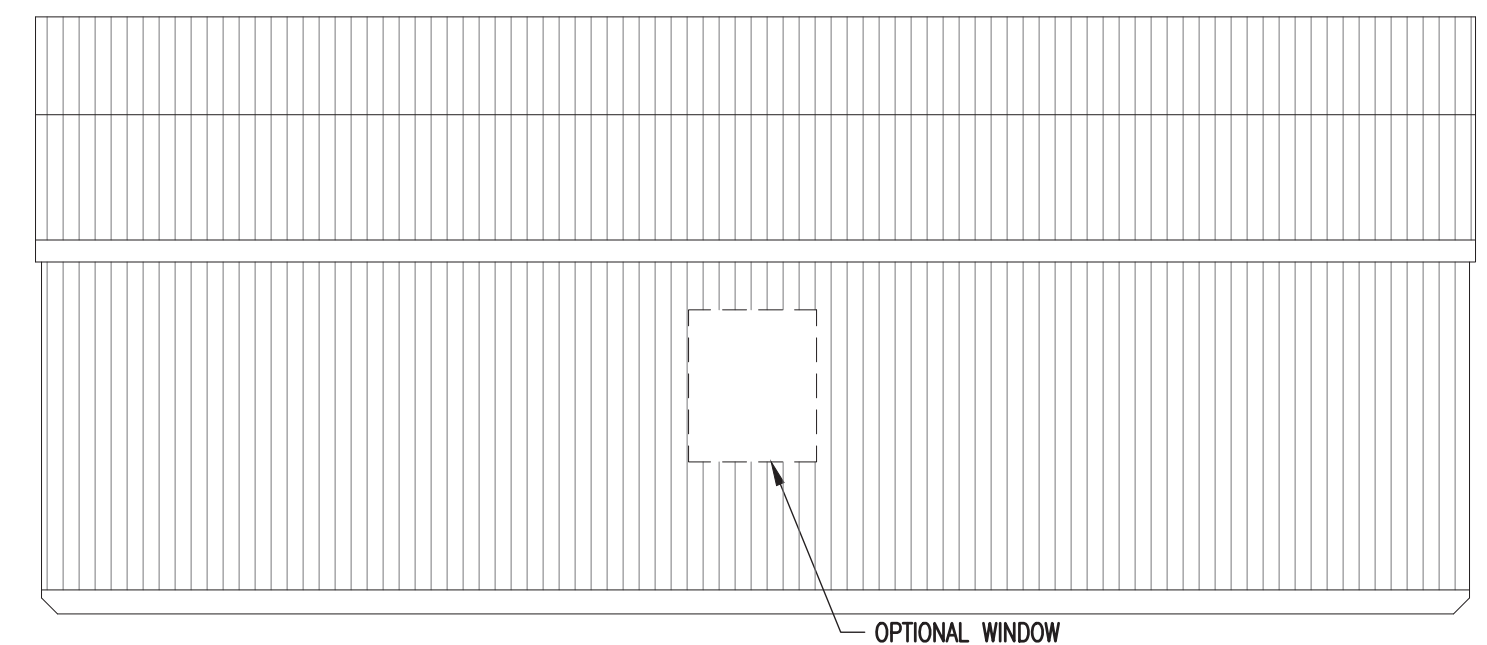

10
SIDEWALL ELEVATION
SCALE: 1/4"=1'-0"

PROJECT: UTILITY SHED


GABLE & GAMBREL SHEDS
FLOOR DECK FRAMING PLANS & DETAILS

DON VAN GERVE, P.E.
SPECIALTY STRUCTURAL ENGINEER


ENGINEERING SERVICES PROVIDED FOR:
PREMIER PORTABLE BUILDINGS
317 EAST STATE LINE ROAD
SOUTH FULTON, TN 38257
WWW.PREMIERBUILDINGS.US

REVISION	DESCRIPTION	DATE	BY
▲			
▲			
▲			
▲			


DATE: 6.30.24
PROJECT NO.: 18285
DRAWING BY: JH
CHK BY: DVG
DWG NO.: **A-1**

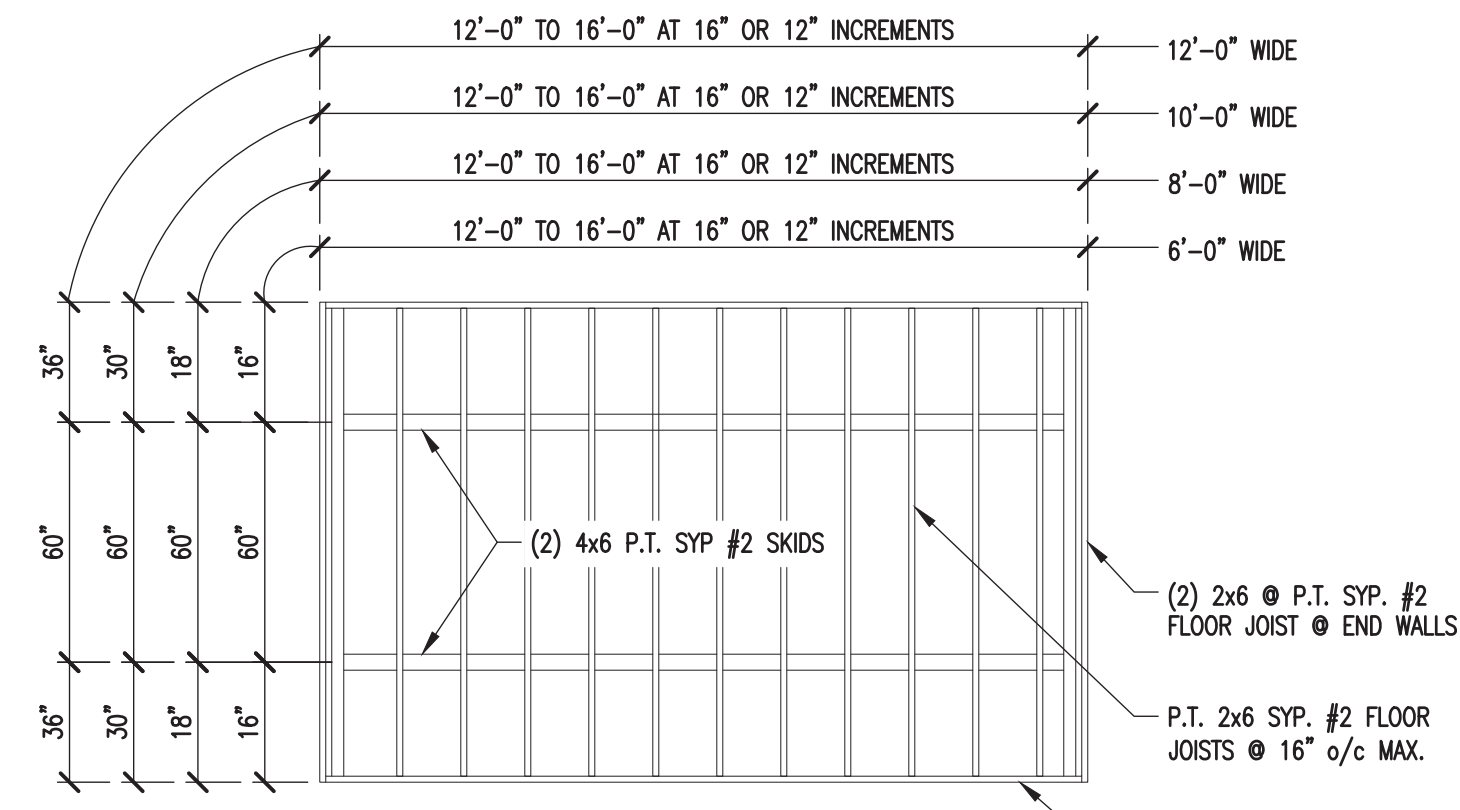


1 GARDEN SHED FLOOR FRAMING PLAN
A-2 SCALE: 1/4"=1'-0" (DO NOT SCALE DRAWING)

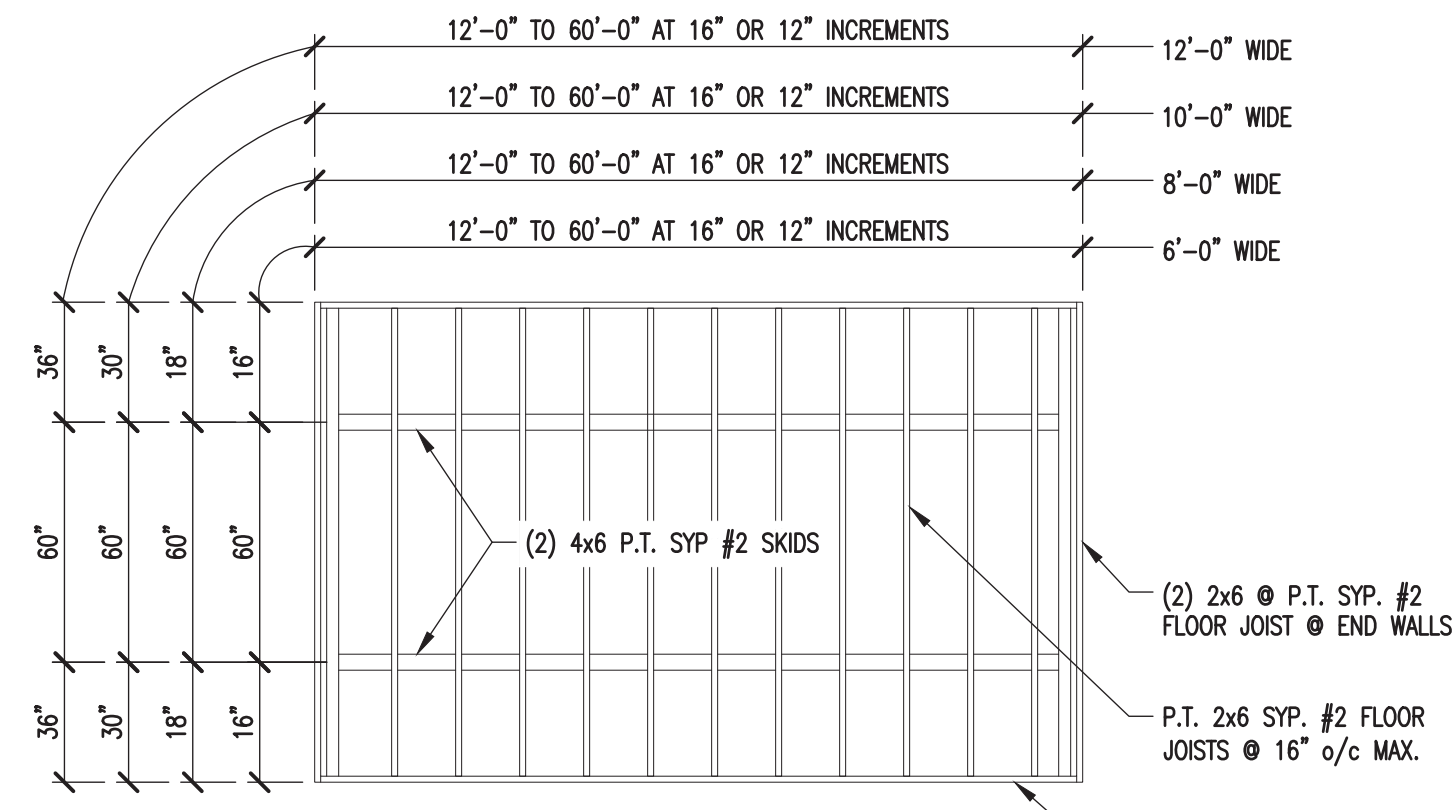

2 COTTAGE SHED FLOOR FRAMING PLAN
A-2 SCALE: 1/4"=1'-0" (DO NOT SCALE DRAWING)

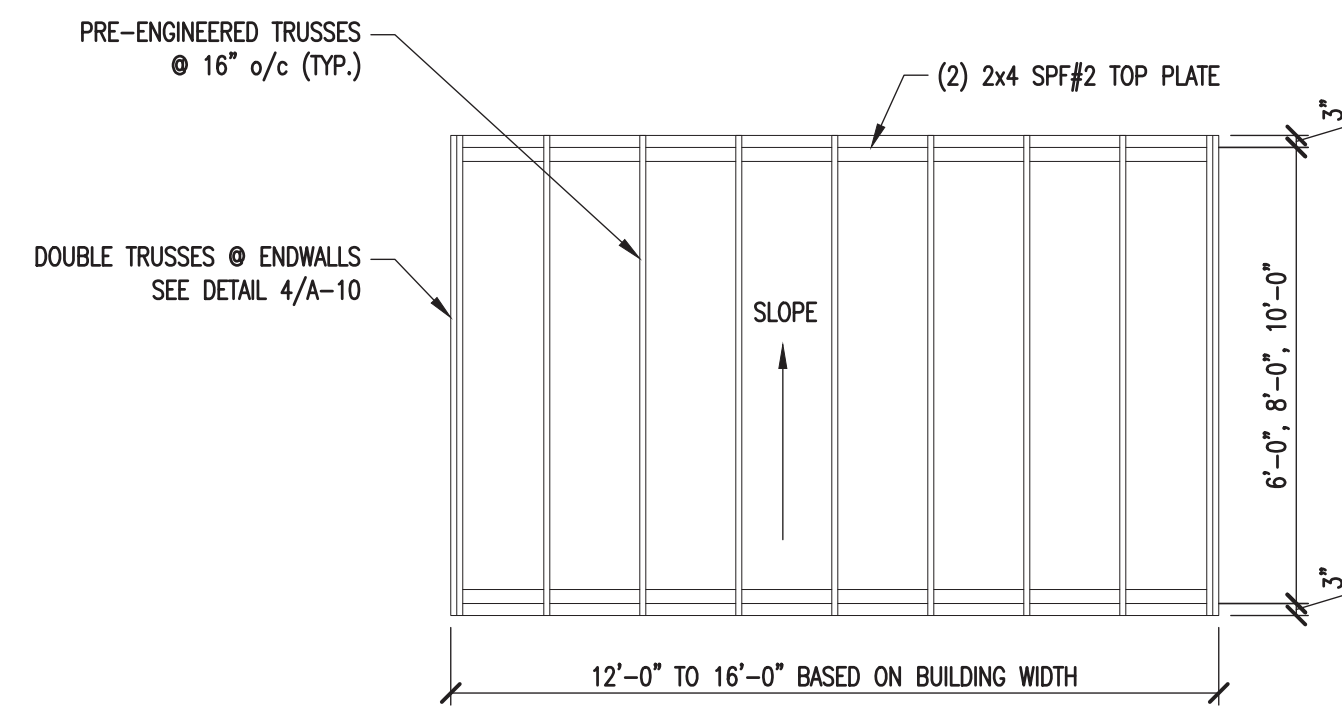


3 ROOF FRAMING PLAN
A-2 SCALE: 1/4"=1'-0"

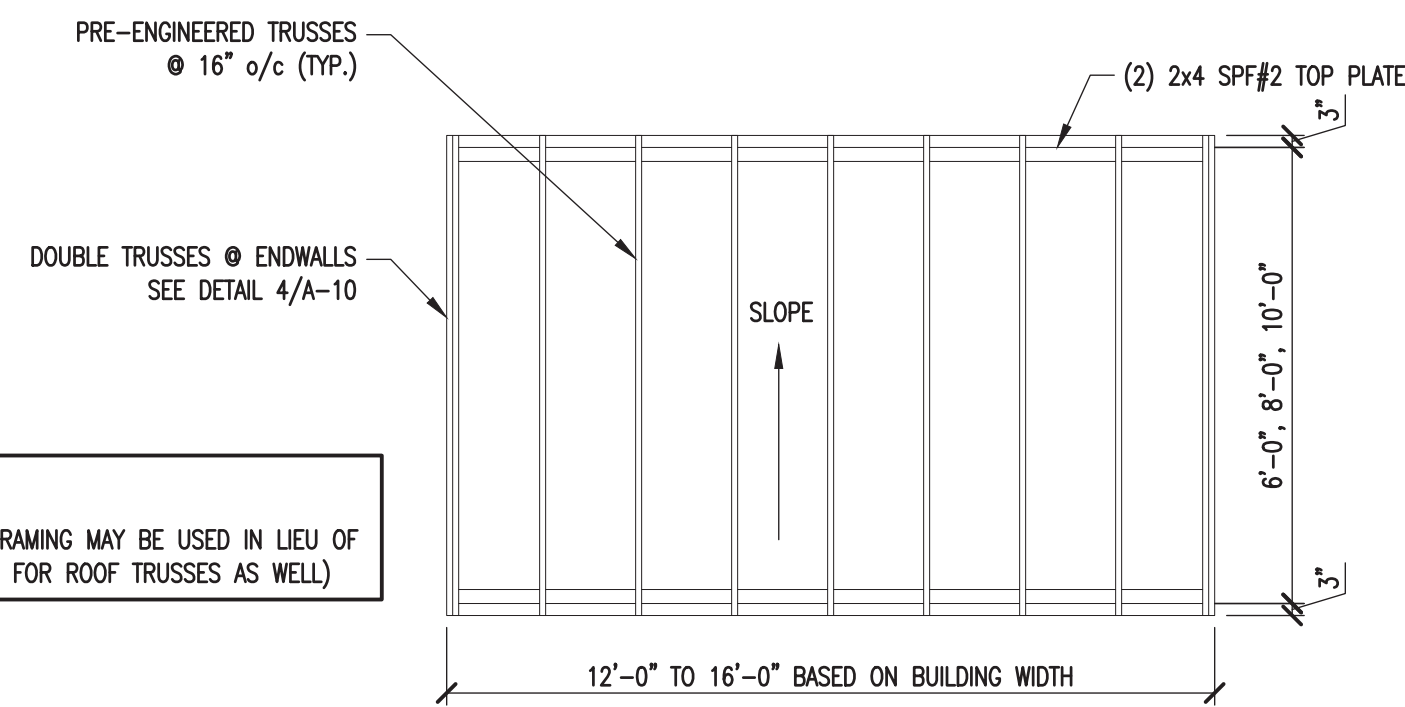


4 ROOF FRAMING PLAN
A-2 SCALE: 1/4"=1'-0"

NOTE:
1. 2x6 STUD FRAMING MAY BE USED IN LIEU OF 2x4's (ALSO FOR ROOF TRUSSES AS WELL)

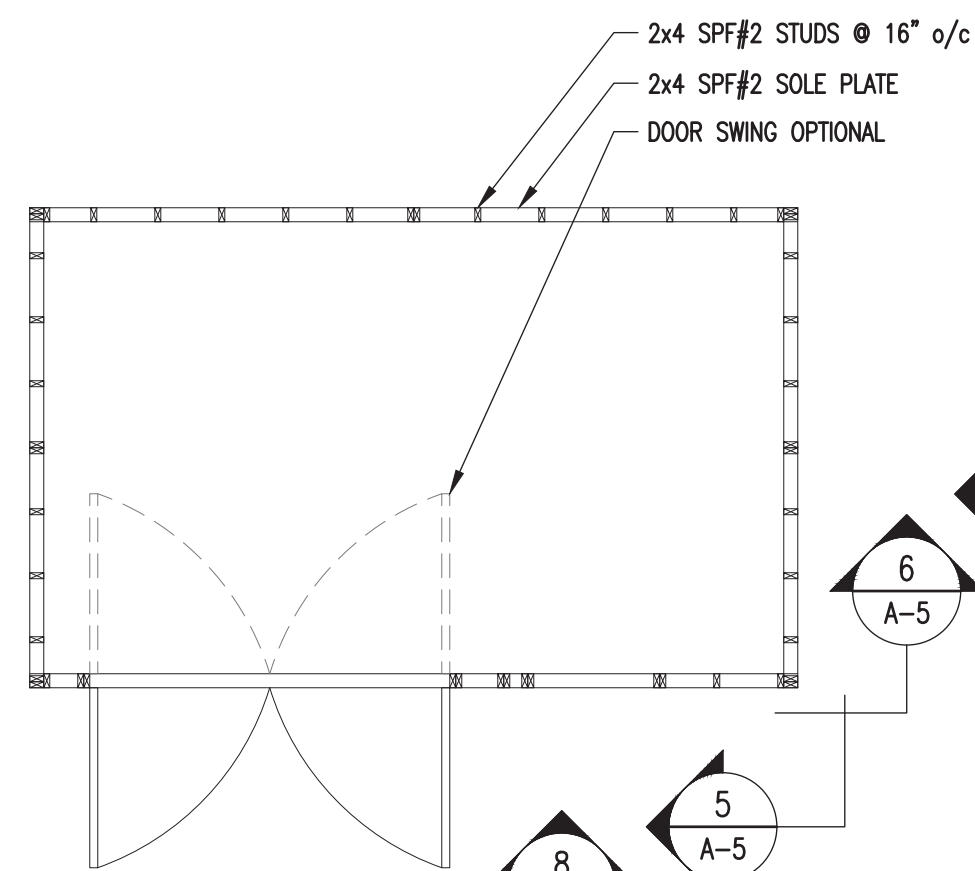


5 FLOOR DECK PLAN
A-2 SCALE: 1/4"=1'-0"

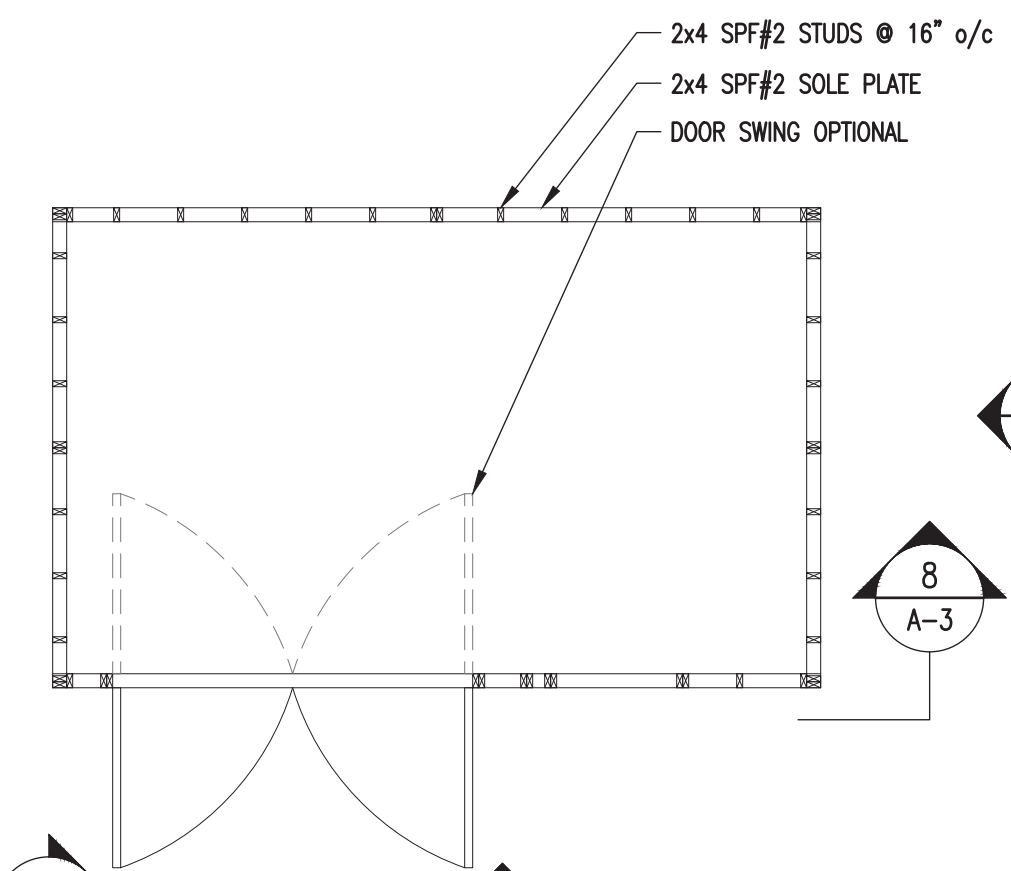


6 FLOOR DECK PLAN
A-2 SCALE: 1/4"=1'-0"


NOTE:
1. DOUBLE WALL STUDS SHALL BE FASTENED AS PER FASTENING SCHEDULE PROVIDED.
2. SEE 12/A-5 FOR CORNER STUD DETAIL.
3. FOR ALL FASTENING NOT SHOWN, SEE FASTENING SCHEDULE ON SHEET C-2.
4. AS AN OPTION, STUDS CAN BE PLACED @ 16" o/c.
5. ALL BUILDING W/ TRUSSES AND STUDS 2'-0" o/c CAN ONLY USE SINGLE TOP PLATE.
6. STUDS SHALL FALL IN LINE W/ TRUSSES.

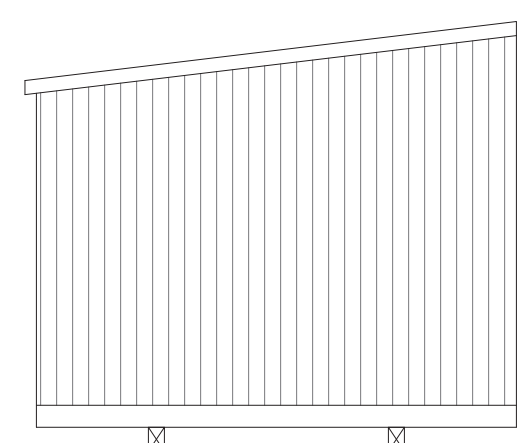


7 ENDWALL ELEVATION
A-2 SCALE: 1/4"=1'-0"

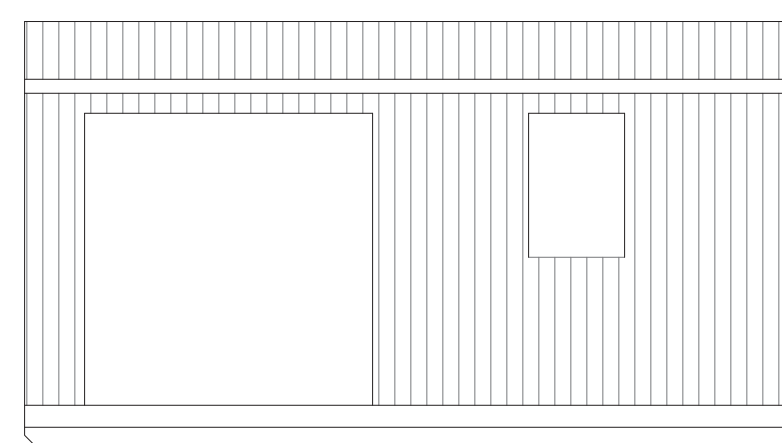


8 SIDEWALL ELEVATION
A-2 SCALE: 1/4"=1'-0"

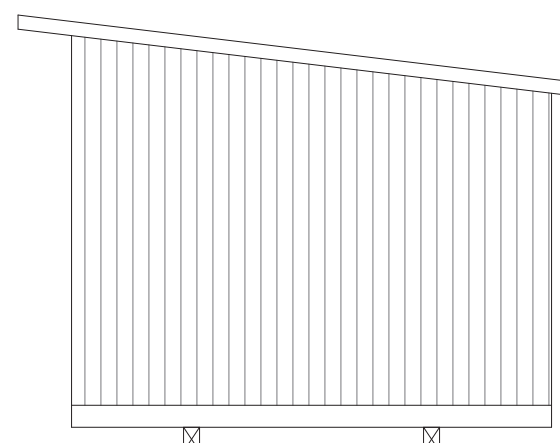


9 ENDWALL ELEVATION
A-2 SCALE: 1/4"=1'-0"

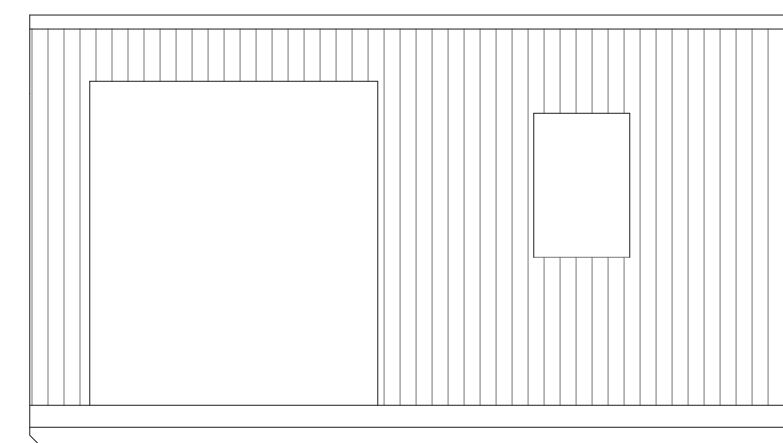


10 SIDEWALL ELEVATION
A-2 SCALE: 1/4"=1'-0"

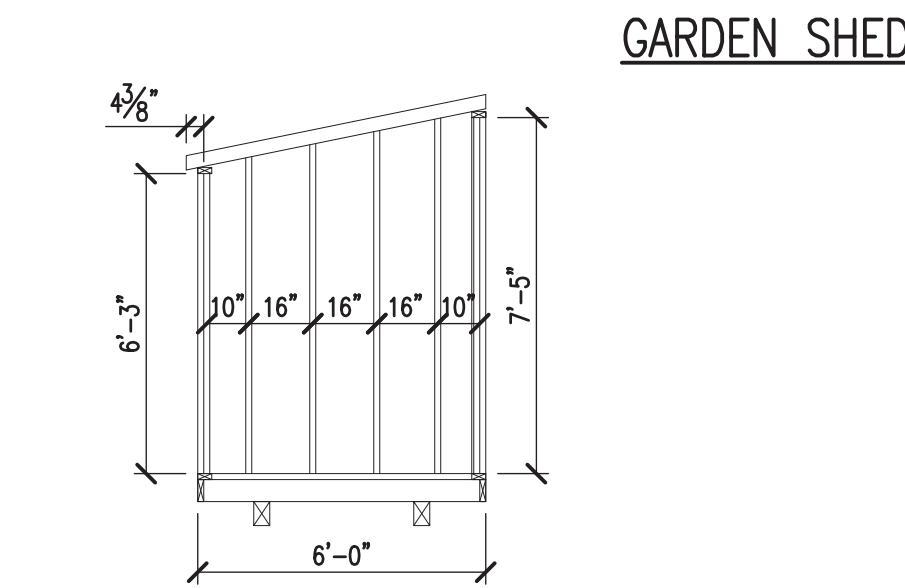


11 6'-0" WIDE ENDWALL ELEVATION
A-2 SCALE: 1/4"=1'-0"

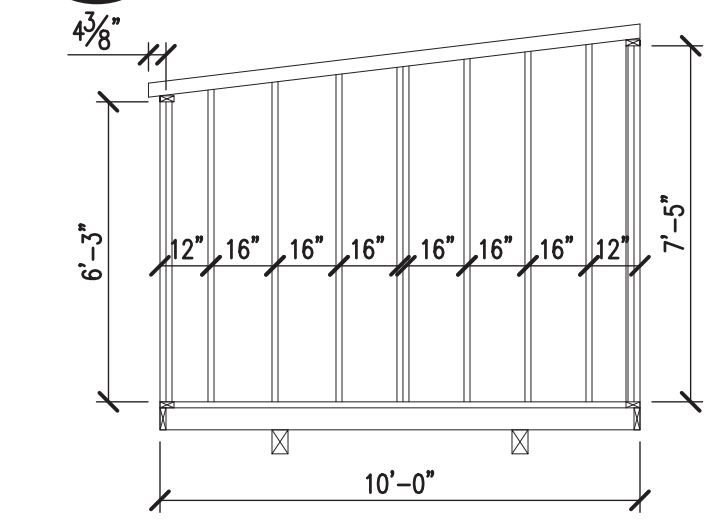


13 10'-0" WIDE ENDWALL ELEVATION
A-2 SCALE: 1/4"=1'-0"

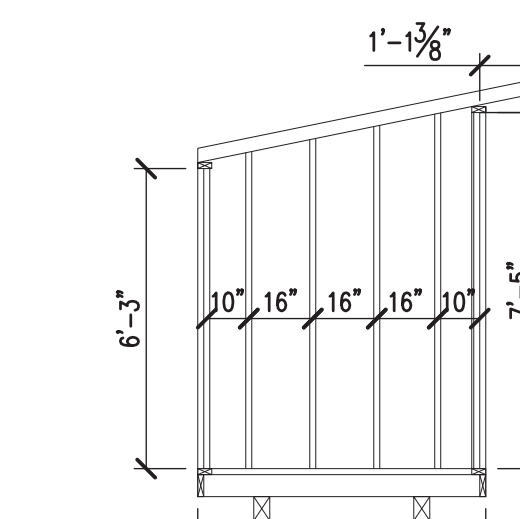


15 6'-0" WIDE ENDWALL ELEVATION
A-2 SCALE: 1/4"=1'-0"

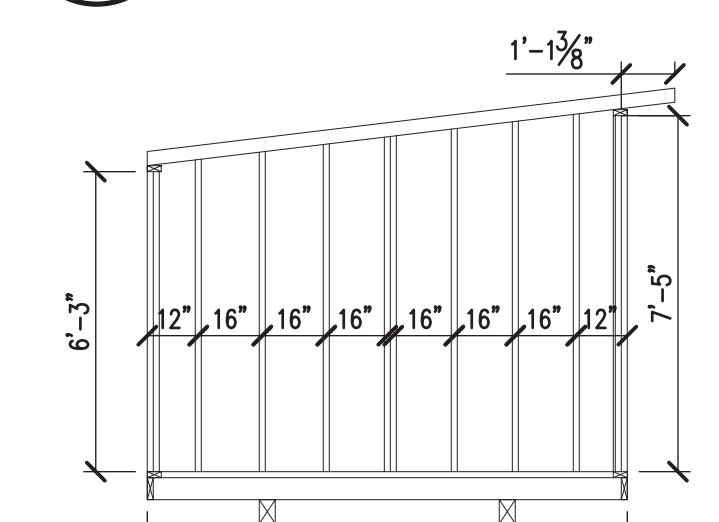


17 10'-0" WIDE ENDWALL ELEVATION
A-2 SCALE: 1/4"=1'-0"

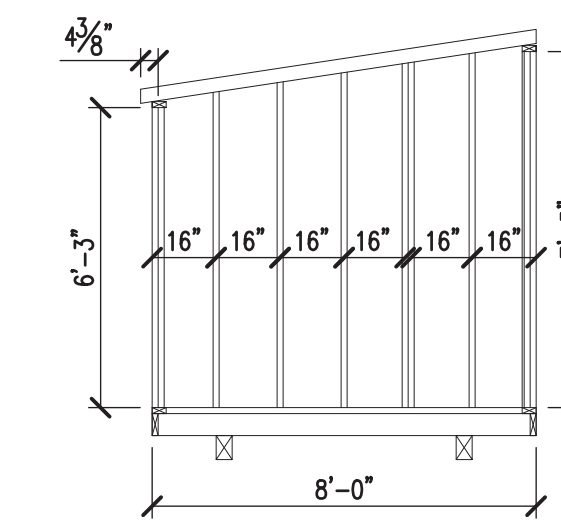


12 8'-0" WIDE ENDWALL ELEVATION
A-2 SCALE: 1/4"=1'-0"

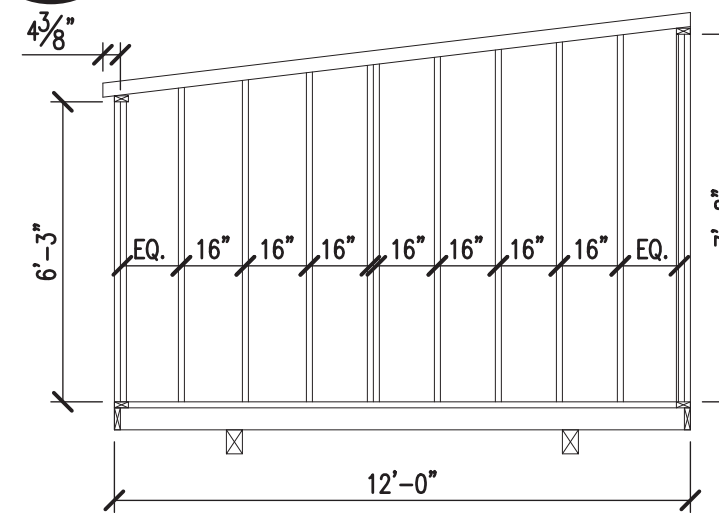

14 12'-0" WIDE ENDWALL ELEVATION
A-2 SCALE: 1/4"=1'-0"

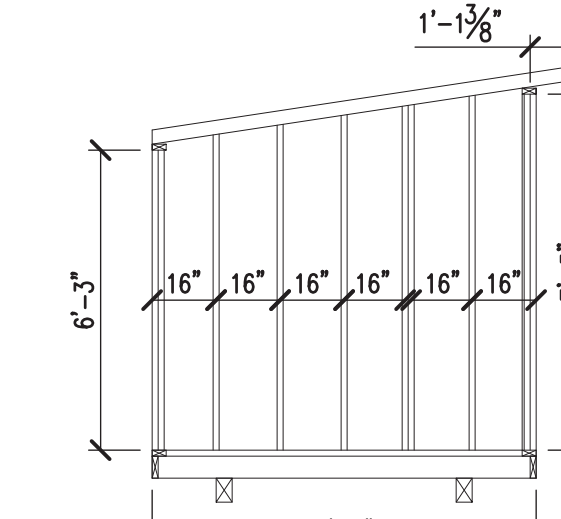

16 8'-0" WIDE ENDWALL ELEVATION
A-2 SCALE: 1/4"=1'-0"

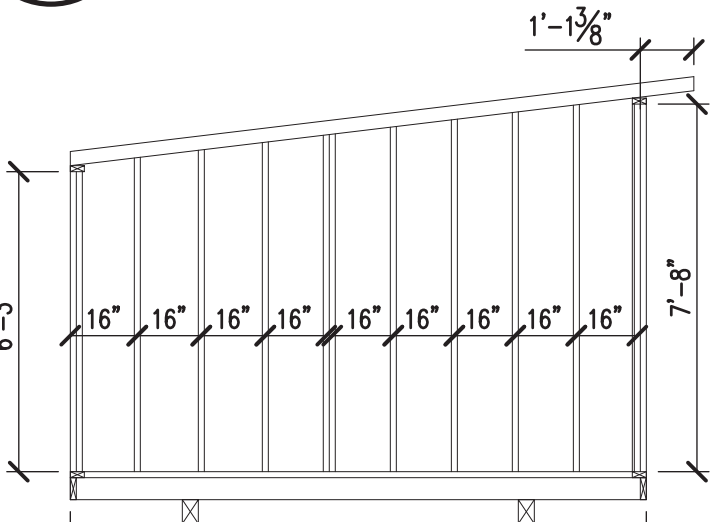

18 12'-0" WIDE ENDWALL ELEVATION
A-2 SCALE: 1/4"=1'-0"

PROJECT: UTILITY SHED

GARDEN & COTTAGE SHEDS
FLOOR DECK FRAMING PLANS & DETAILS

DON VAN GERVE, P.E.
SPECIALTY STRUCTURAL ENGINEER




ENGINEERING SERVICES PROVIDED FOR:
PREMIER PORTABLE BUILDINGS
317 EAST STATE LINE ROAD
SOUTH FULTON, TN 38257
WWW.PREMIERBUILDINGS.US

REVISION	DESCRIPTION	DATE	BY
▲			
▲			
▲			

DATE: 6.30.24
PROJECT NO.: 18285
DRAWING BY: JH
CHK BY: DVG

DWG NO.: **A-2**

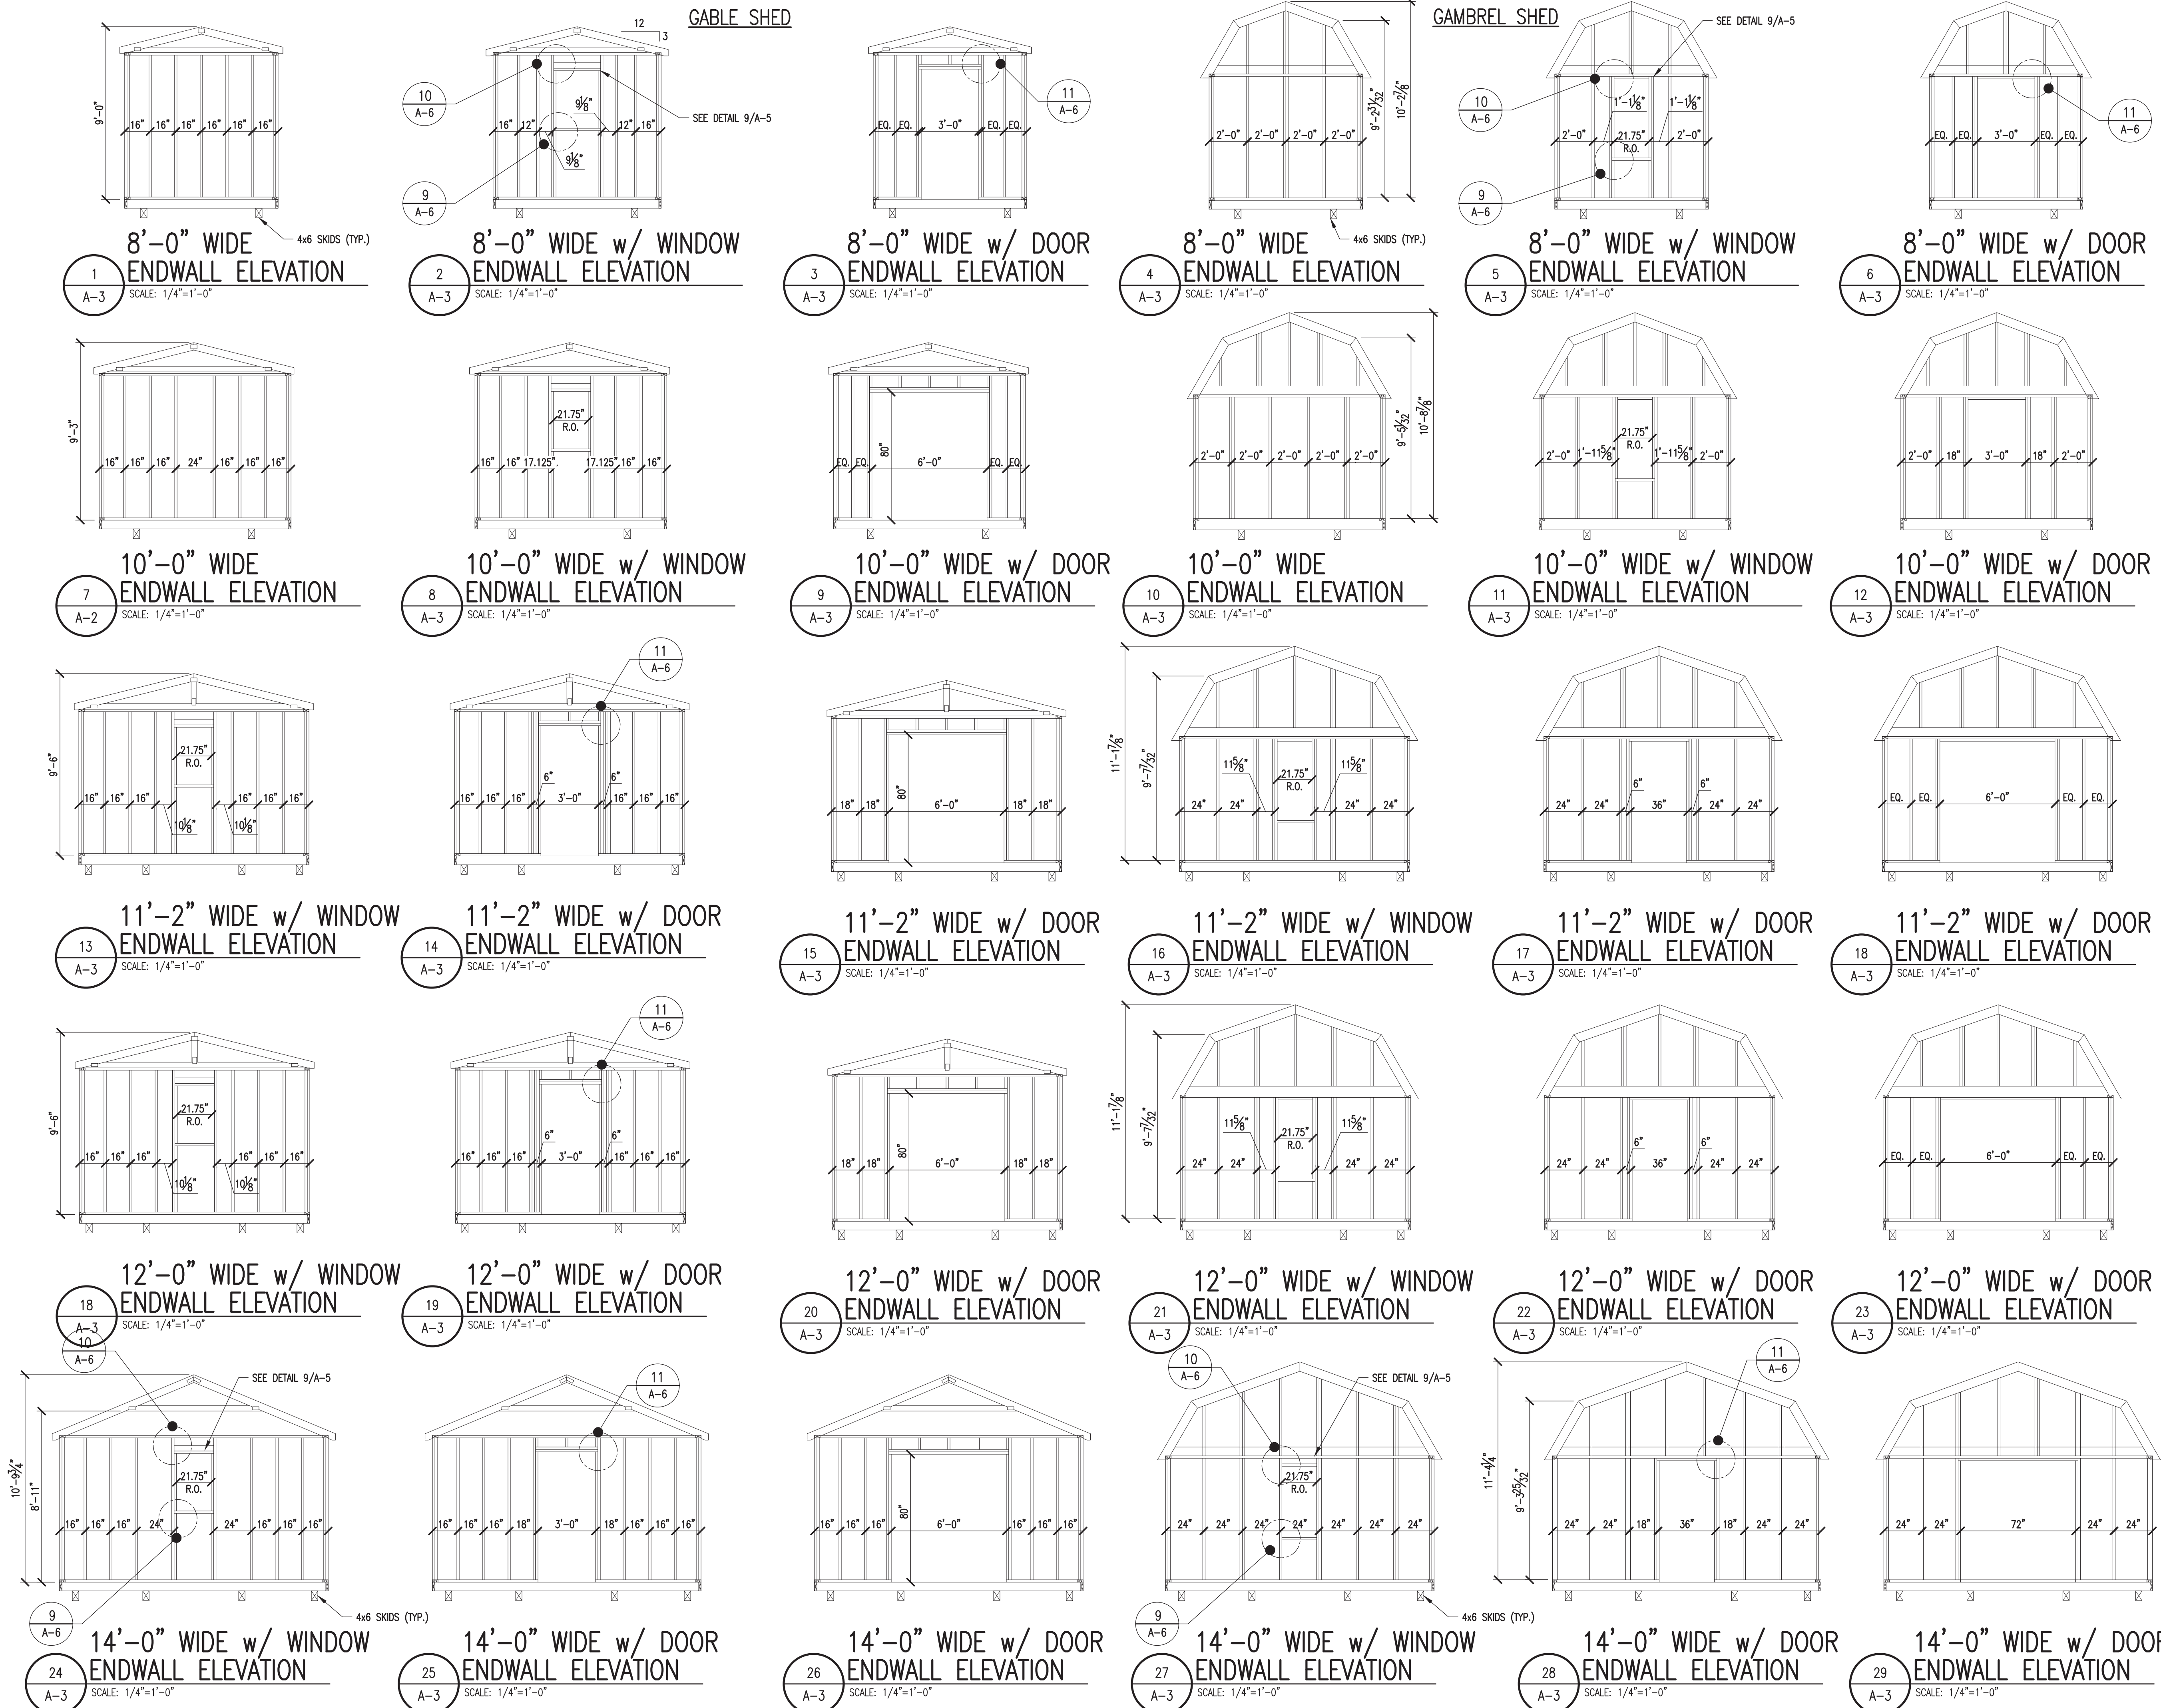

AREA FOR APPROVAL STAMPS



PROJECT: UTILITY SHED

SECTIONS

DON VAN GERVE, P.E.
SPECIALTY STRUCTURAL ENGINEER




ENGINEERING SERVICES PROVIDED FOR:
PREMIER PORTABLE BUILDINGS
317 EAST STATE LINE ROAD
SOUTH FULTON, TN 38257
WWW.PREMIERBUILDINGS.US


REVISION	DESCRIPTION	DATE	BY
▲			
▲			
▲			

DATE: 6.30.24
PROJECT NO.: 18285
DRAWING BY: JH
CHK BY: DVG
DWG NO.:


A-3

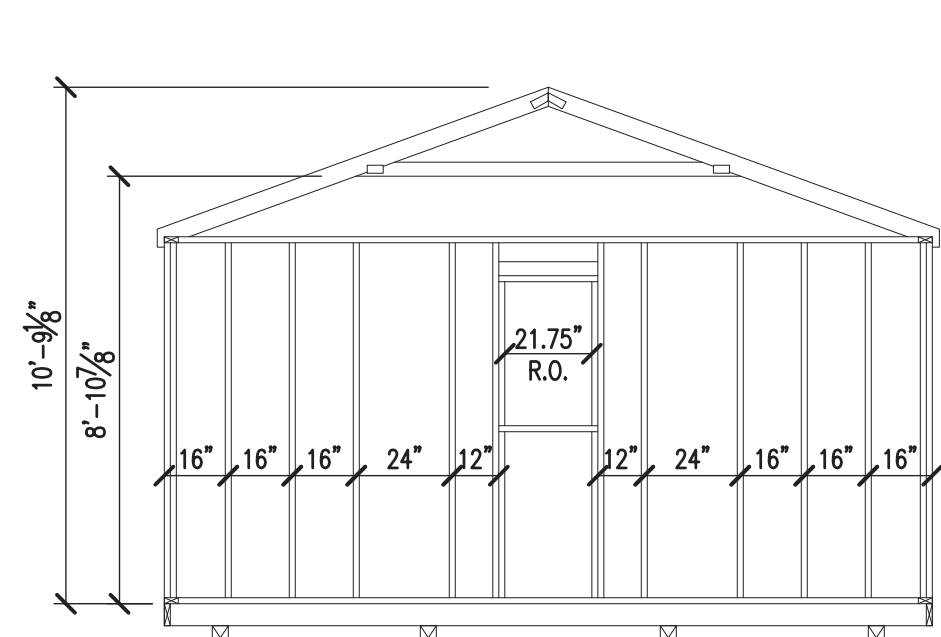


1
A-4
16'-0" WIDE w/ WINDOW
ENDWALL ELEVATION
SCALE: 1/4"=1'-0"

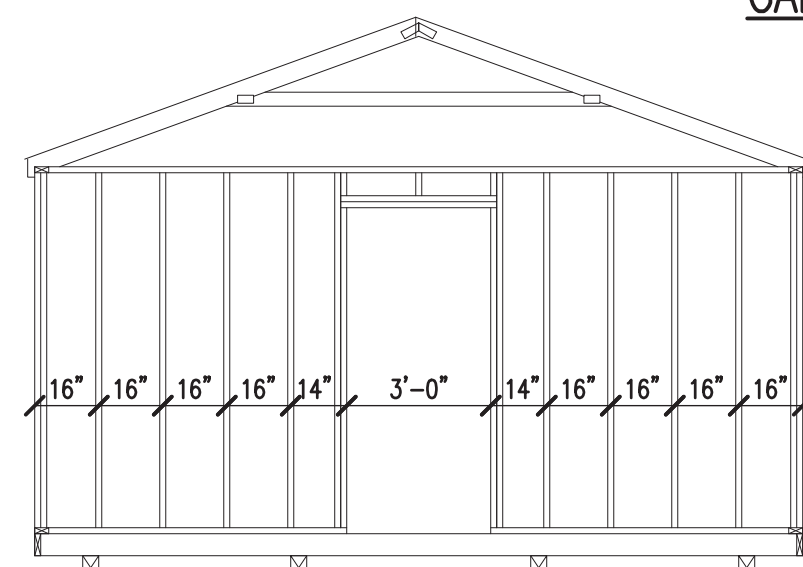


2
A-4
16'-0" WIDE w/ DOOR
ENDWALL ELEVATION
SCALE: 1/4"=1'-0"

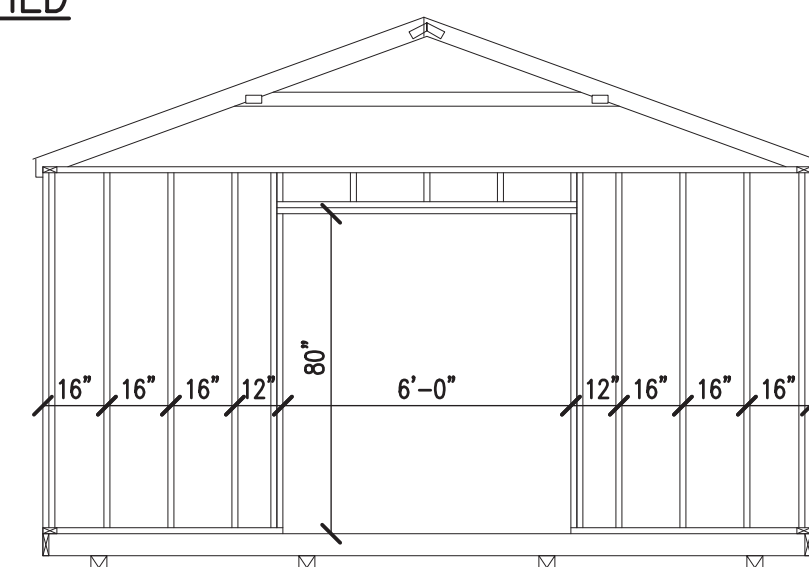


3
A-4
16'-0" WIDE w/ DOOR
ENDWALL ELEVATION
SCALE: 1/4"=1'-0"

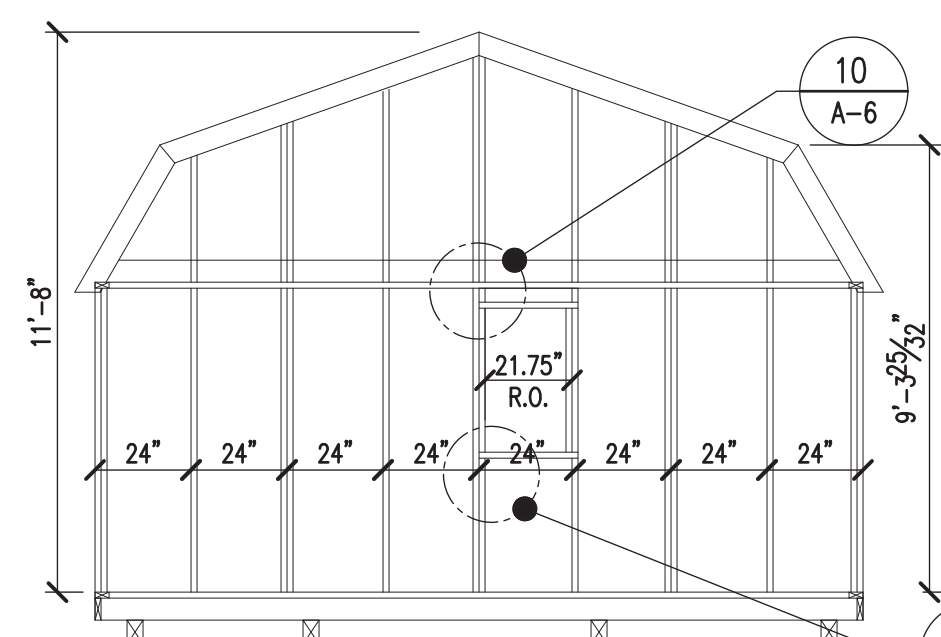


4
A-4
16'-0" WIDE w/ WINDOW
ENDWALL ELEVATION
SCALE: 1/4"=1'-0"

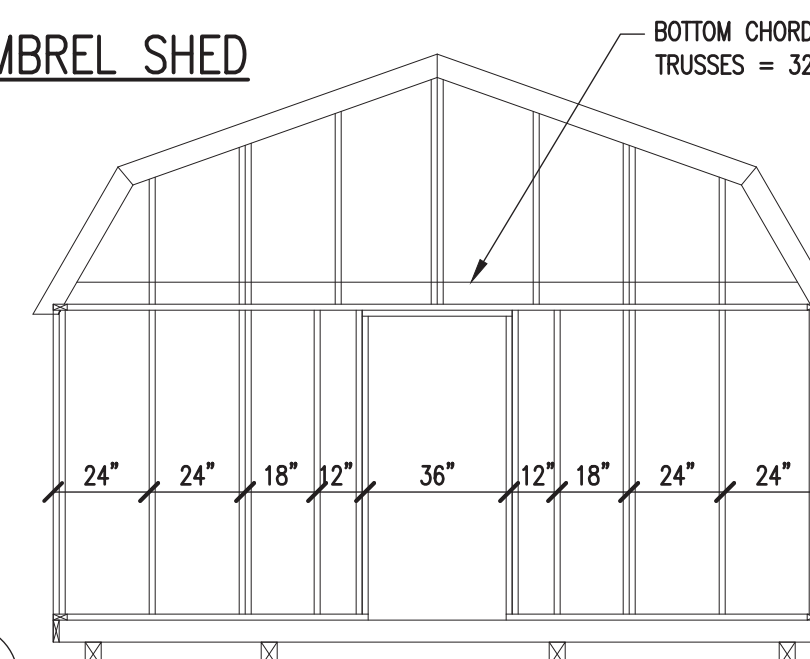


5
A-4
16'-0" WIDE w/ DOOR
ENDWALL ELEVATION
SCALE: 1/4"=1'-0"

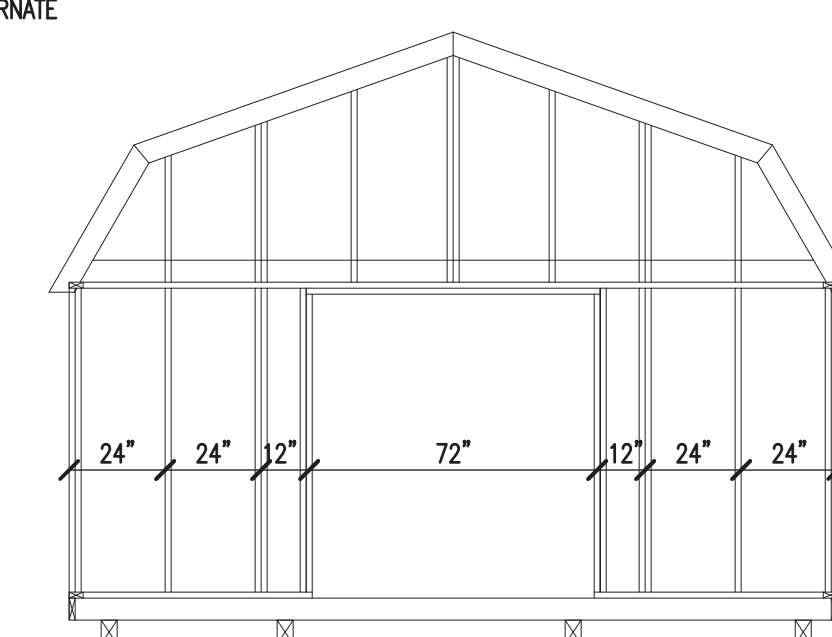


6
A-4
16'-0" WIDE w/ DOOR
ENDWALL ELEVATION
SCALE: 1/4"=1'-0"

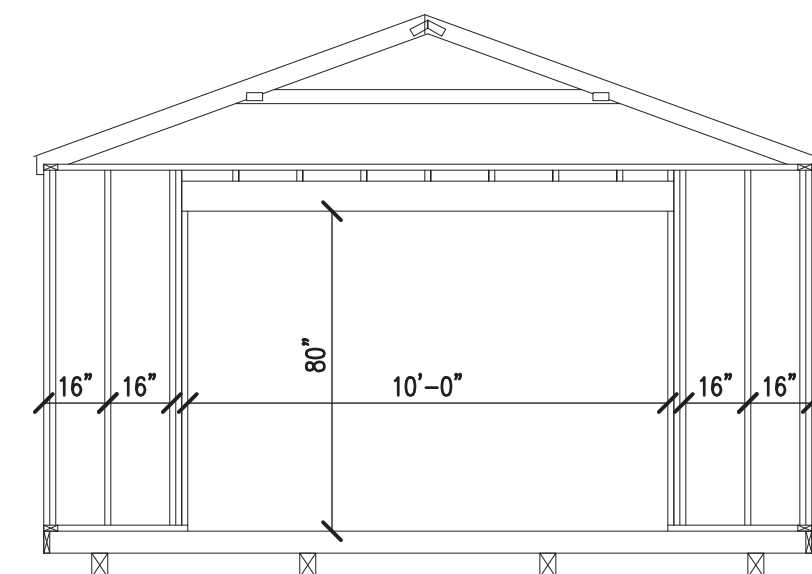


14
A-4
16'-0" WIDE w/ DOOR
ENDWALL ELEVATION
SCALE: 1/4"=1'-0"

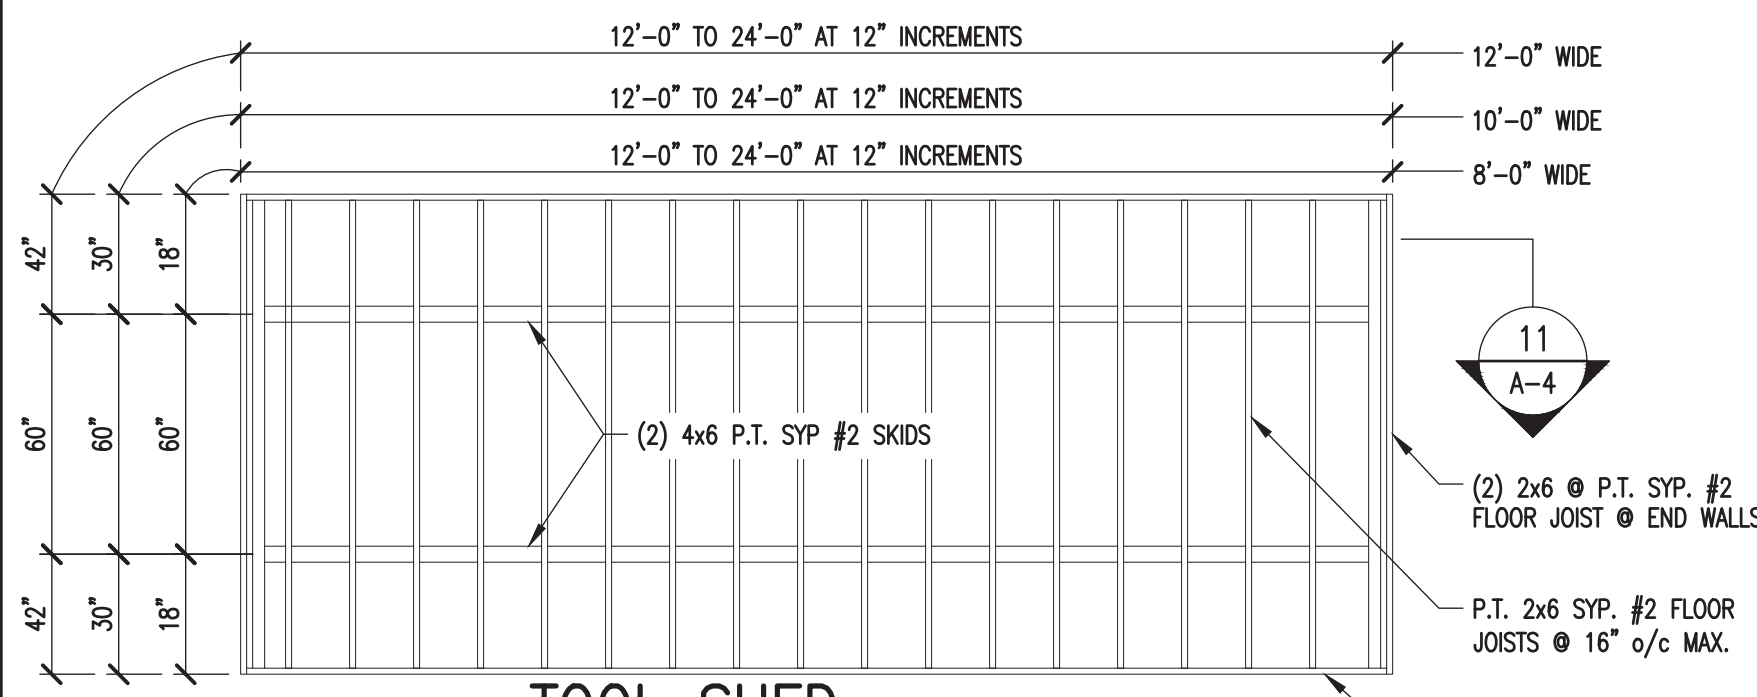

7
A-4
TOOL SHED
FLOOR FRAMING PLAN
SCALE: 1/4"=1'-0" (DO NOT SCALE DRAWING)

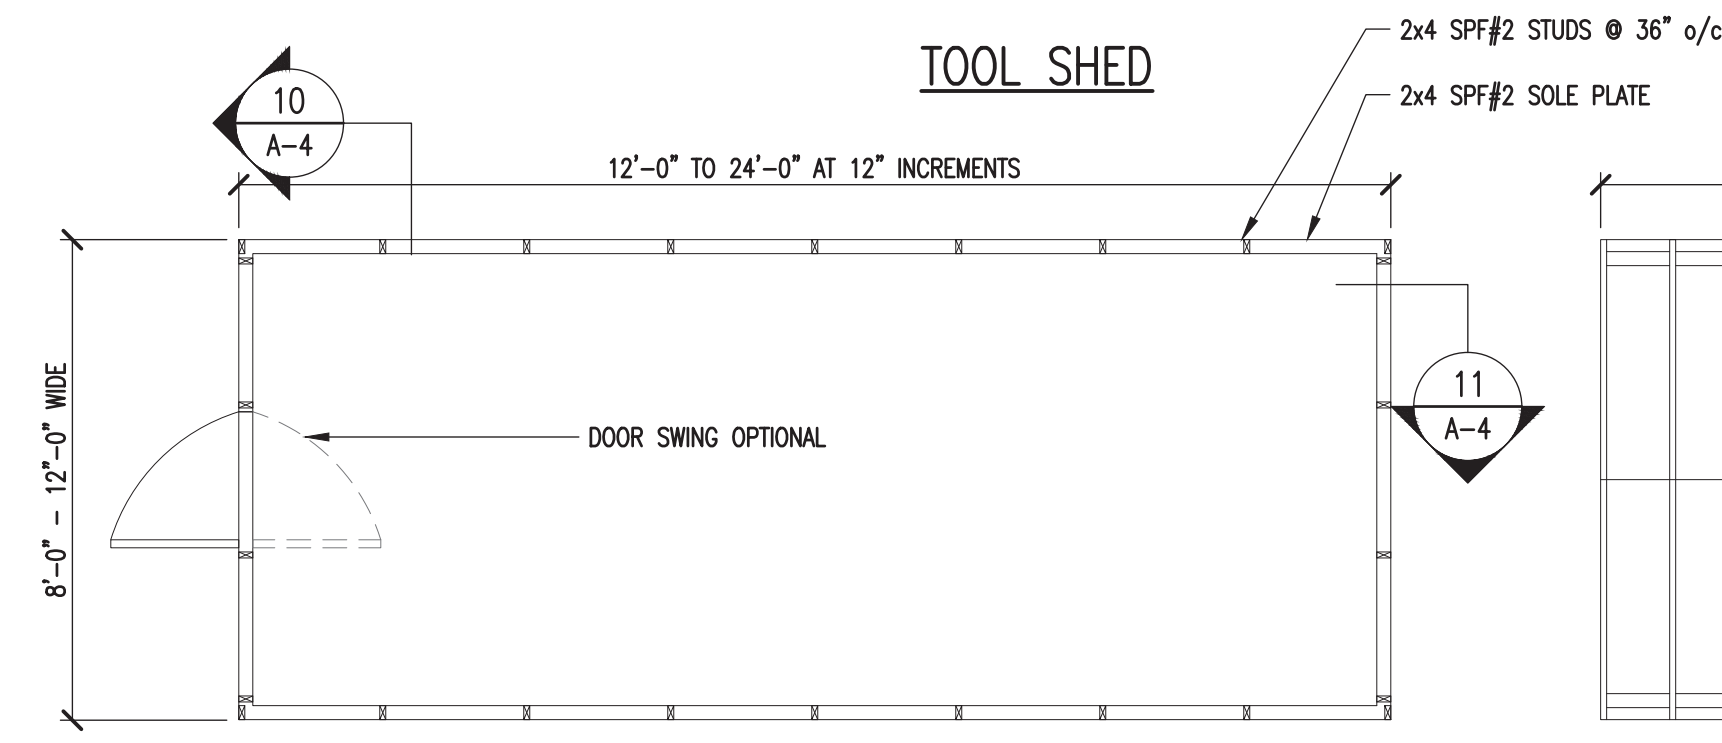


8
A-4
FLOOR DECK PLAN
SCALE: 1/4"=1'-0"

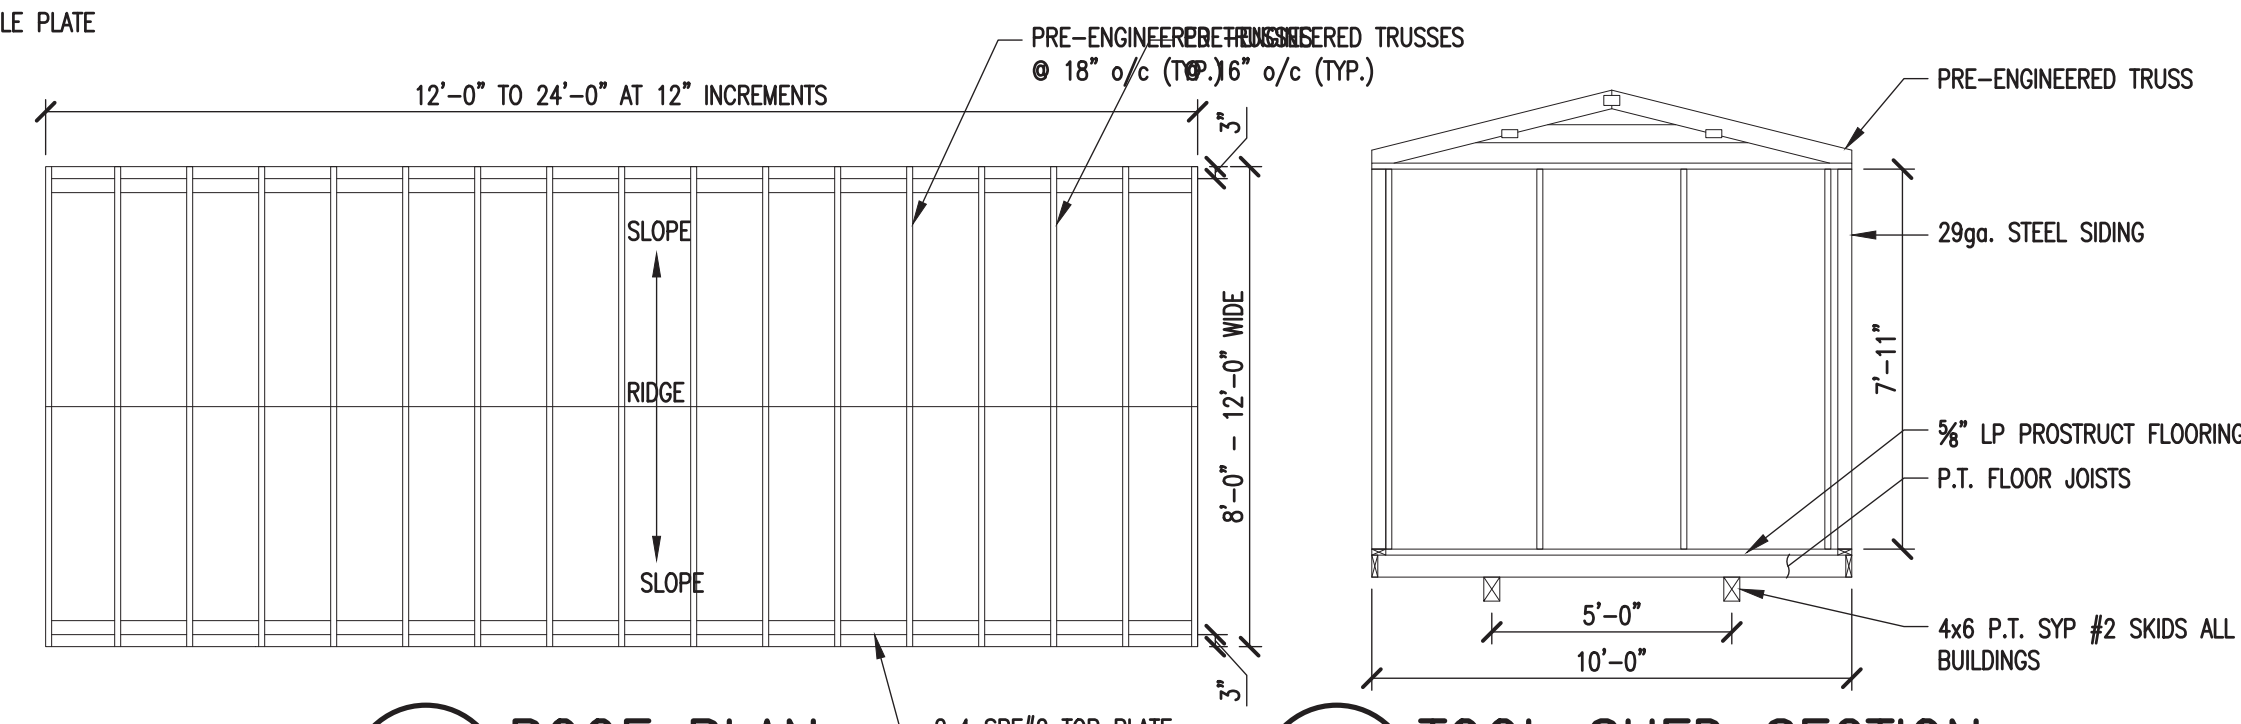


9
A-4
ROOF PLAN
SCALE: 1/4"=1'-0"


10
A-4
TOOL SHED SECTION
SCALE: 1/4"=1'-0"

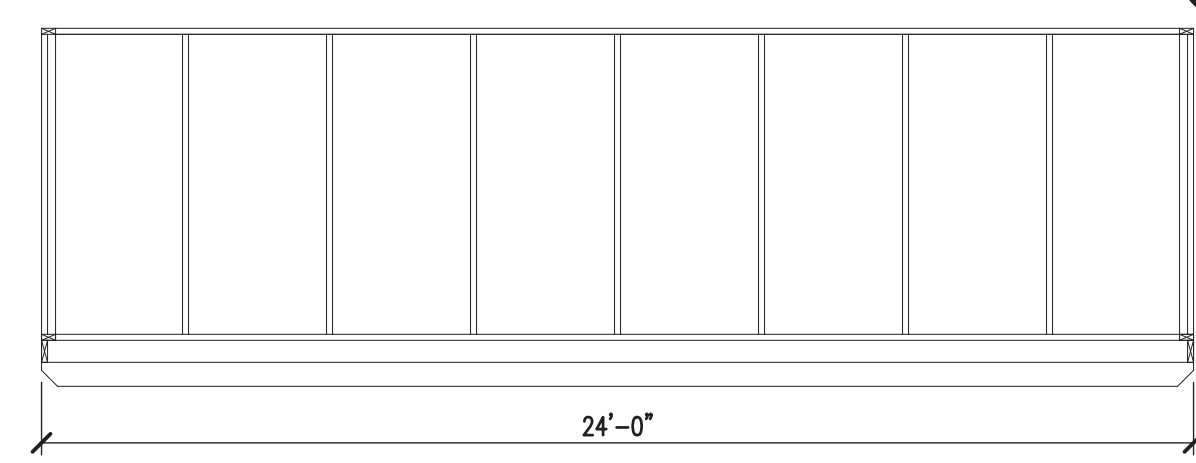

11
A-4
SIDE WALL FRAMING
SCALE: 1/4"=1'-0"

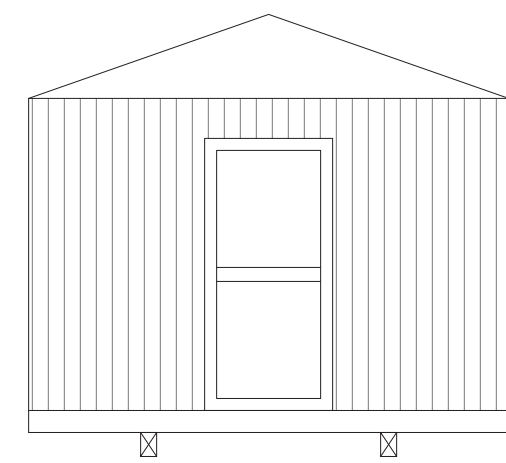

12
A-4
ELEVATION
SCALE: 1/4"=1'-0"

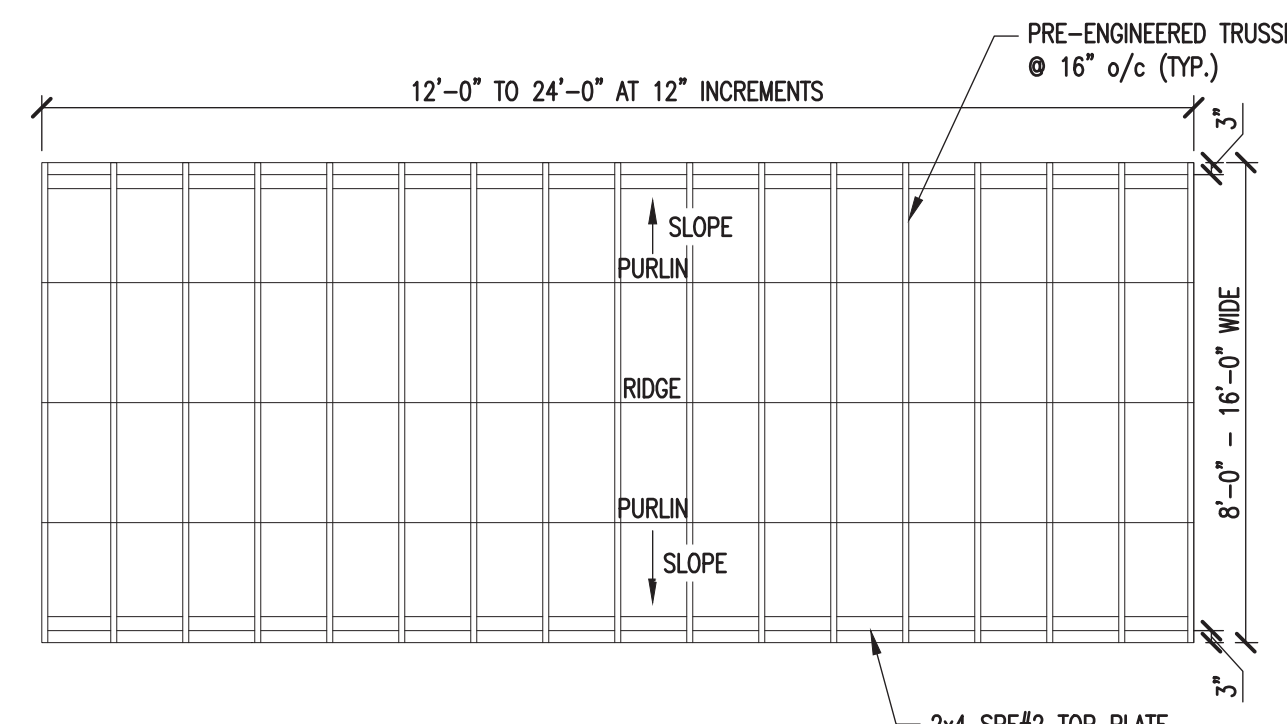

13
A-4
GAMBREL ROOF PLAN
SCALE: 1/4"=1'-0"

- NOTES:
1. SEE NOTES ON SHEETS A-1 & A-2 FOR ANY INFORMATION NOT SHOWN.
2. SEE FASTENING SCHEDULE FOR ALL FASTENING NOT NOTED ON THIS SHEET.

BOTTOM CHORD TRUSS OPTION:
LOAD = 62 PSF (1.333)(8FT/2)(1.5)=500LBS TENSION.
A (2x4) = 5.25IN²; FT = 95 PSI (OK)
ALTERNATE TRUSS WITH BOTTOM CHORD, SPACED 32" o/c,
OPTION A: TENSION = 1000LBS: FT=190 PSI (OK)

PROJECT: UTILITY SHED


SECTION CUTS
CRAFTSMAN & TOOL SHED

DON VAN GERVE, P.E.
SPECIALTY STRUCTURAL ENGINEER

ENGINEERING SERVICES PROVIDED FOR:
PREMIER PORTABLE BUILDINGS
317 EAST STATE LINE ROAD
SOUTH FULTON, TN 38257
WWW.PREMIERBUILDINGS.US


REVISION	DESCRIPTION	DATE	BY
▲			
▲			
▲			

DATE: 6.30.24
PROJECT NO.: 18285
DRAWING BY: JH
CHK BY: DVG
DWG NO.: A-4

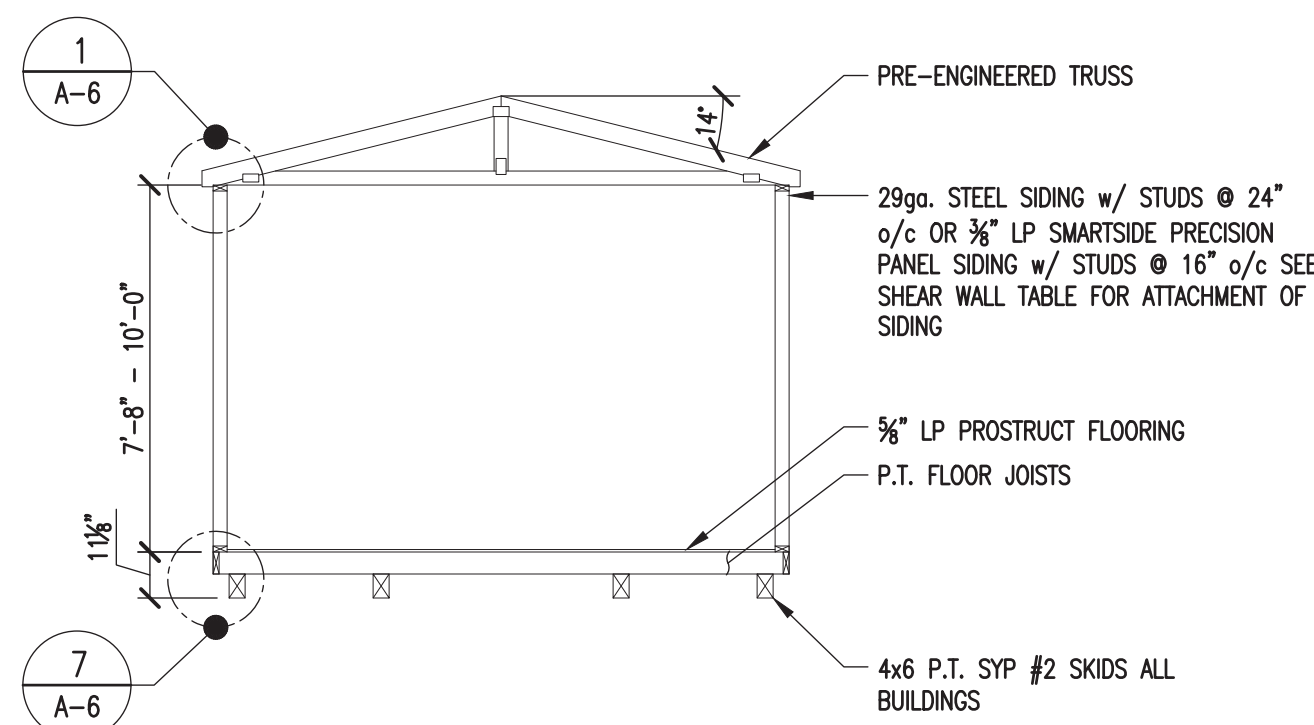


1 GABLE SECTION
SCALE: 1/4"=1'-0"

NOTES:
1. SEE NOTES ON SHEETS A-1 & C-2 FOR ANY INFORMATION NOT SHOWN.
2. SEE FASTENING SCHEDULE FOR ALL FASTENING NOT NOTED ON THIS SHEET.

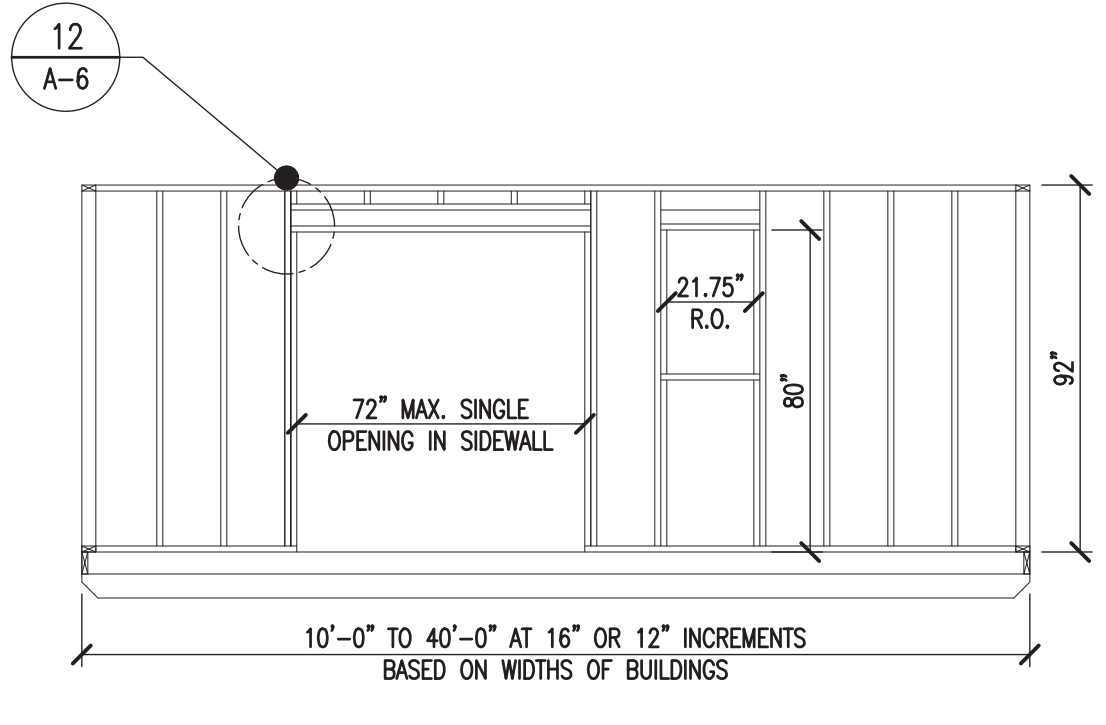


2 SIDEWALL FRAMING
SCALE: 1/4"=1'-0"

NOTES:
MAX. OPENING MAY BE INCREASED TO 9'-0" WITH HEADER PROVIDED THE BUILDING LENGTH IS OVER 16' IN LENGTH AND THE CRITERIA IN NOTE NUMBER 3 OF THE SHEARWALL CHART IS MET.

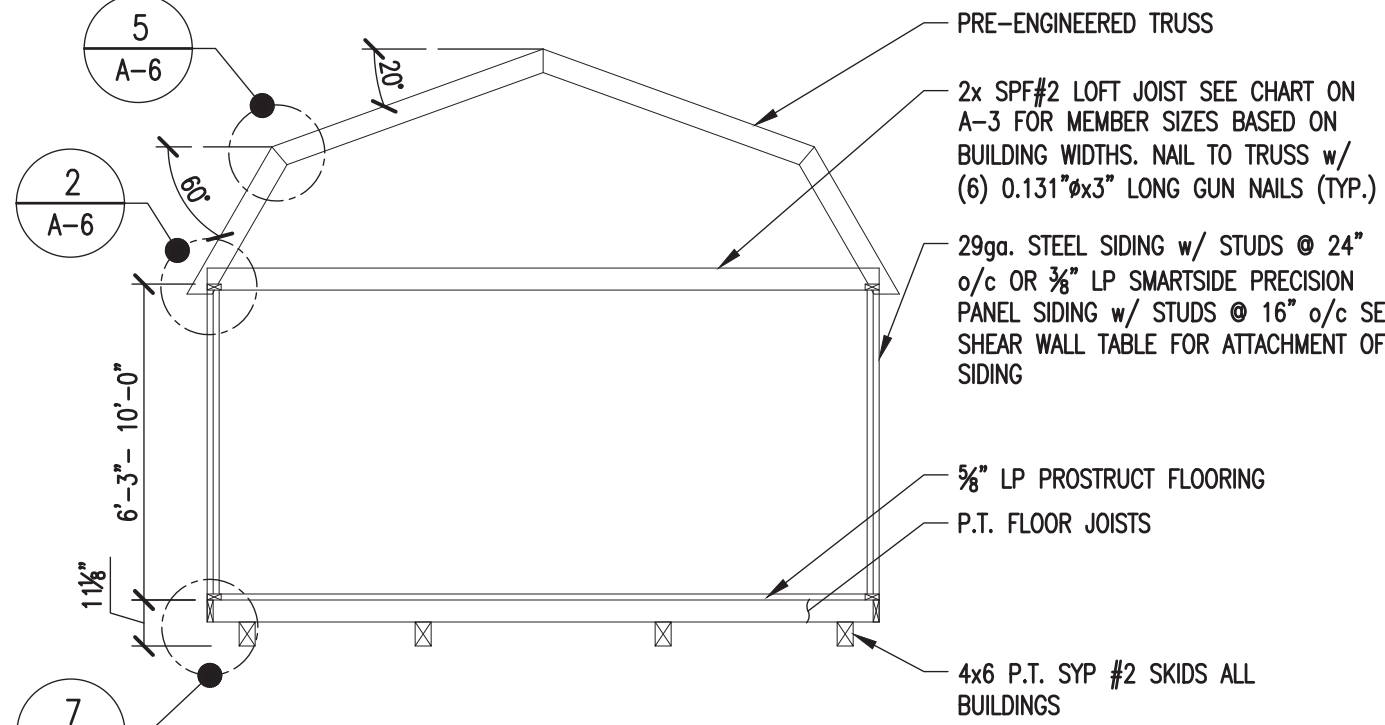


3 GAMBREL SECTION
SCALE: 1/4"=1'-0"

NOTES:
1. SEE NOTES ON SHEETS A-1 & C-2 FOR ANY INFORMATION NOT SHOWN.
2. SEE FASTENING SCHEDULE FOR ALL FASTENING NOT NOTED ON THIS SHEET.

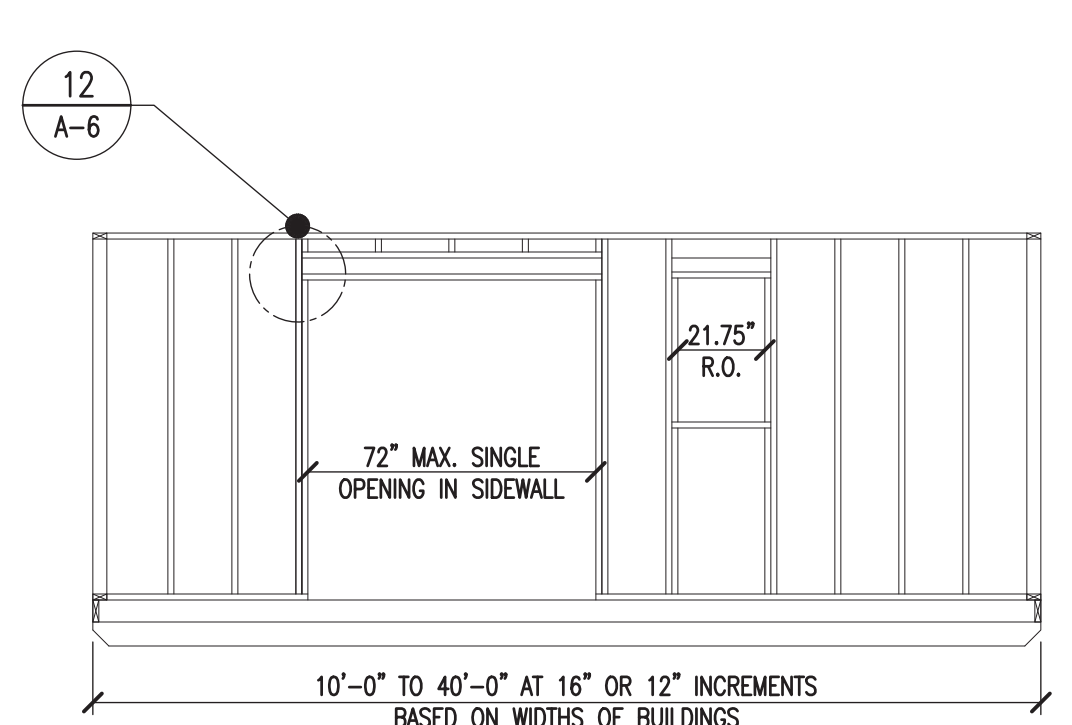


4 SIDEWALL FRAMING
SCALE: 1/4"=1'-0"

NOTES:
MAX. OPENING MAY BE INCREASED TO 9'-0" WITH HEADER PROVIDED THE BUILDING LENGTH IS OVER 16' IN LENGTH AND THE CRITERIA IN NOTE NUMBER 3 OF THE SHEARWALL CHART IS MET.

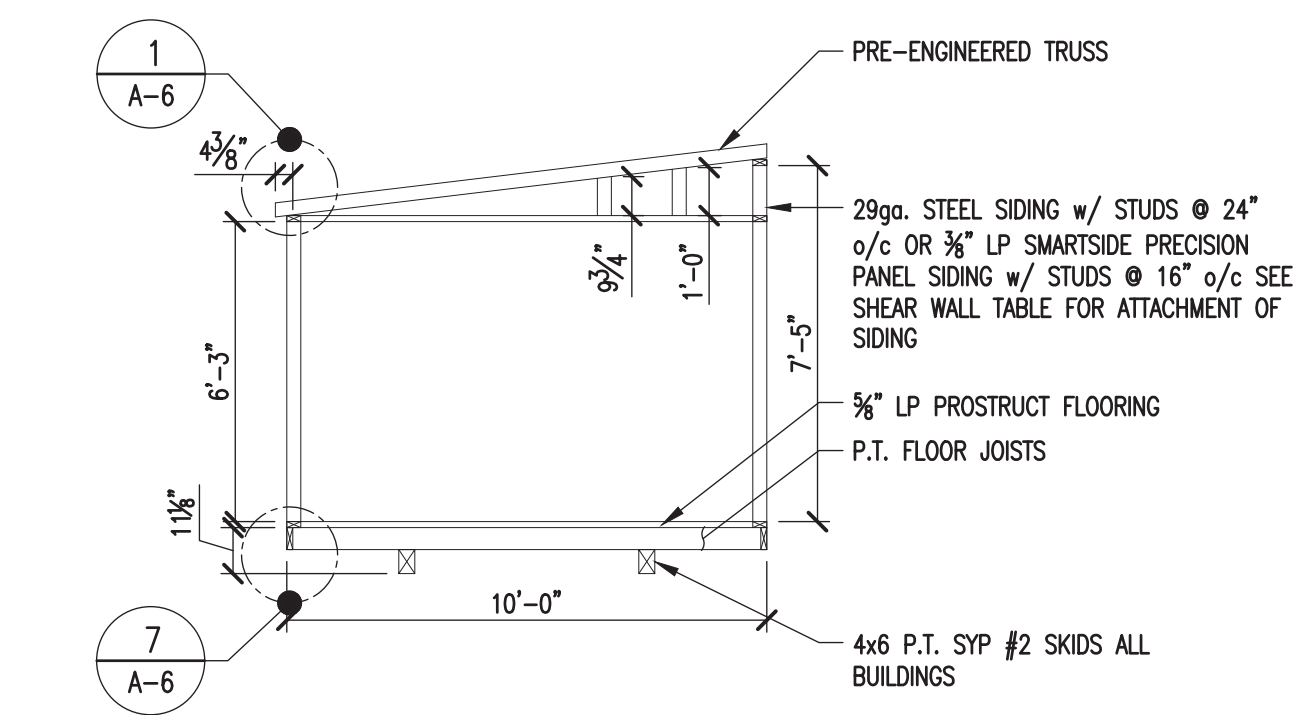


5 GARDEN SHED SECTION
SCALE: 1/4"=1'-0"

NOTES:
1. SEE NOTES ON SHEETS A-1 & A-2 FOR ANY INFORMATION NOT SHOWN.
2. SEE FASTENING SCHEDULE FOR ALL FASTENING NOT NOTED ON THIS SHEET.

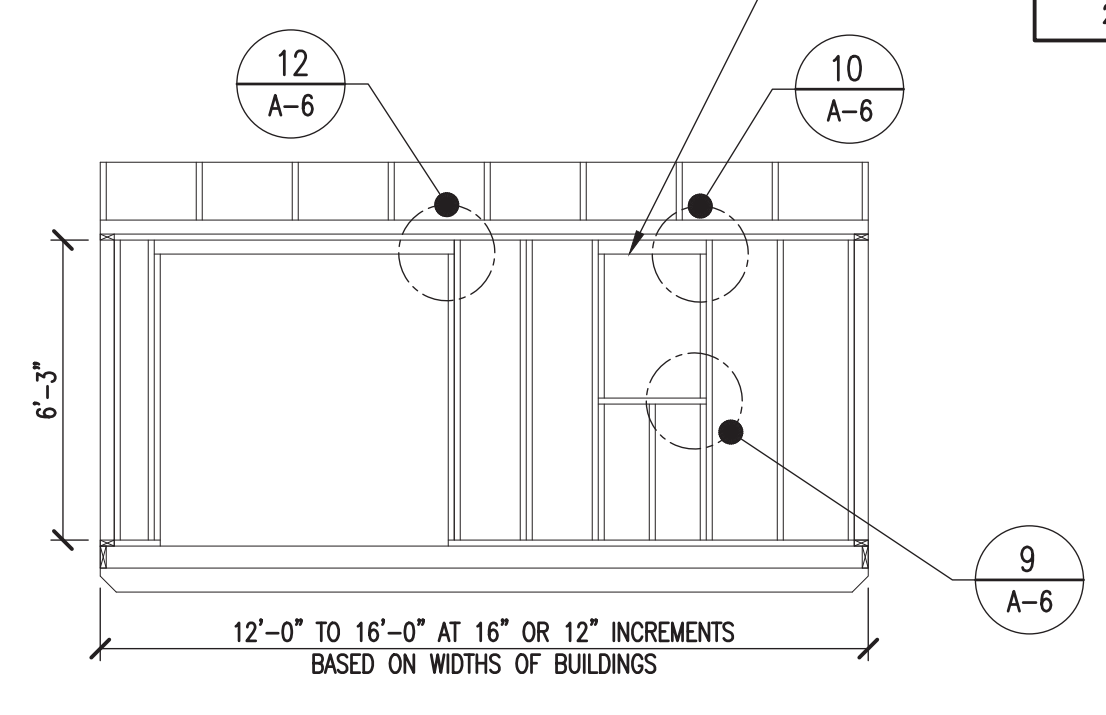


6 SIDEWALL FRAMING
SCALE: 1/4"=1'-0"

NOTES:
MAX. OPENING MAY BE INCREASED TO 9'-0" WITH HEADER 8/A-11 PROVIDED THE BUILDING LENGTH IS OVER 16' IN LENGTH AND THE CRITERIA IN NOTE NUMBER 3 OF THE SHEARWALL CHART IS MET.

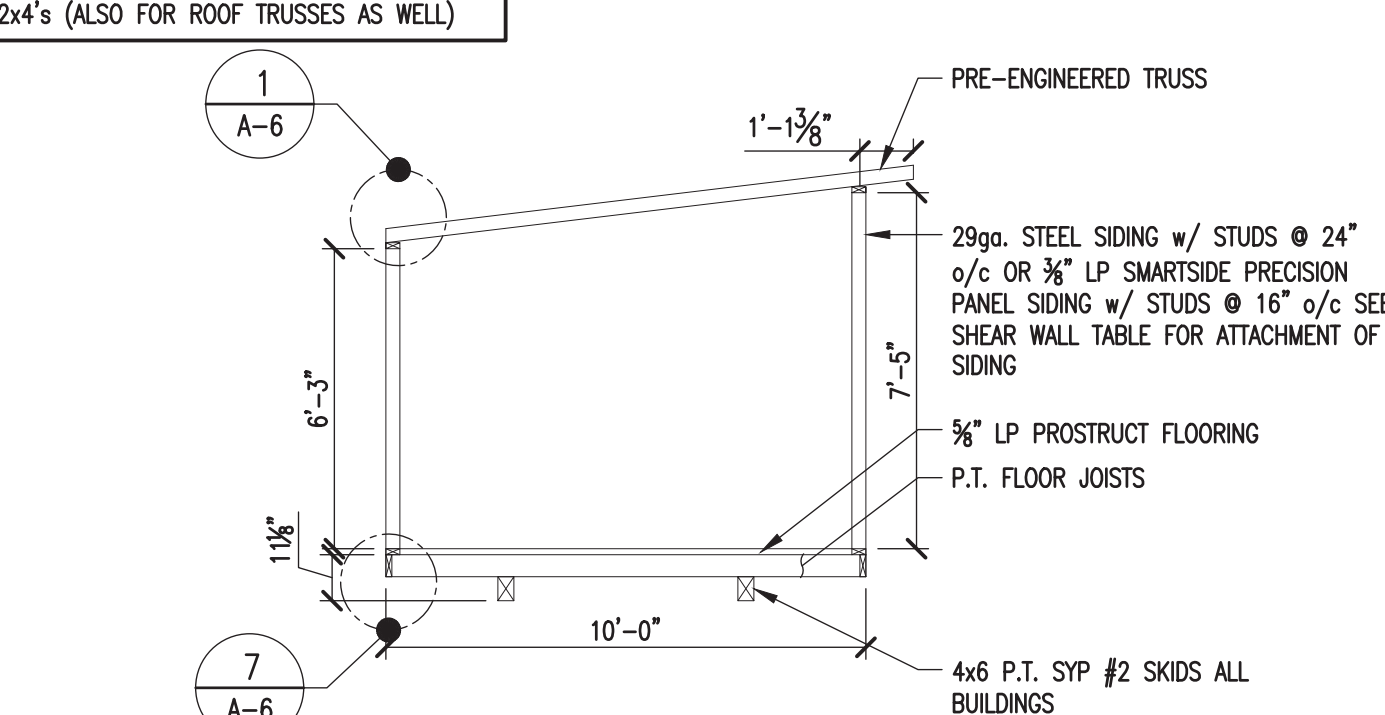


7 COTTAGE SHED SECTION
SCALE: 1/4"=1'-0"


NOTES:
1. SEE NOTES ON SHEETS A-1 & A-2 FOR ANY INFORMATION NOT SHOWN.
2. SEE FASTENING SCHEDULE FOR ALL FASTENING NOT NOTED ON THIS SHEET.

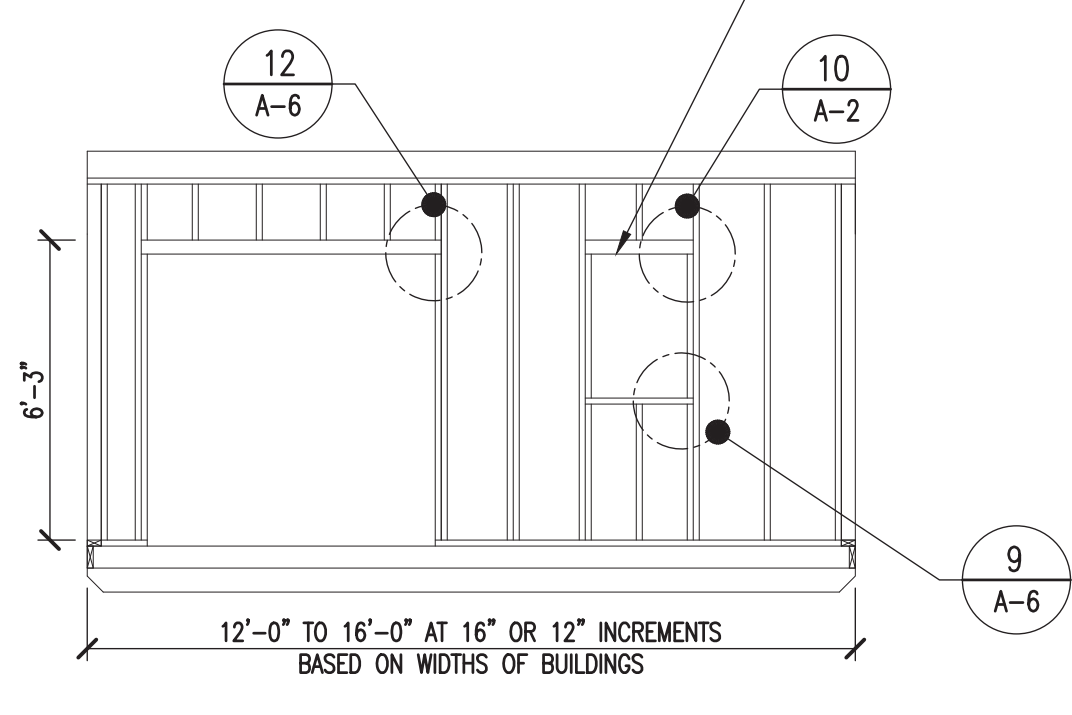


8 SIDEWALL FRAMING
SCALE: 1/4"=1'-0"

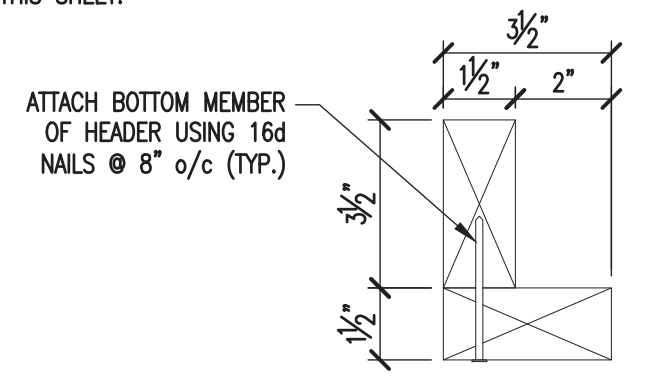


9 WINDOW HEADER DETAIL
SCALE: 3"=1'-0"

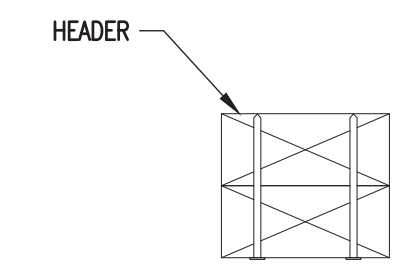

10 DOOR HEADER DETAIL
SCALE: 3"=1'-0"

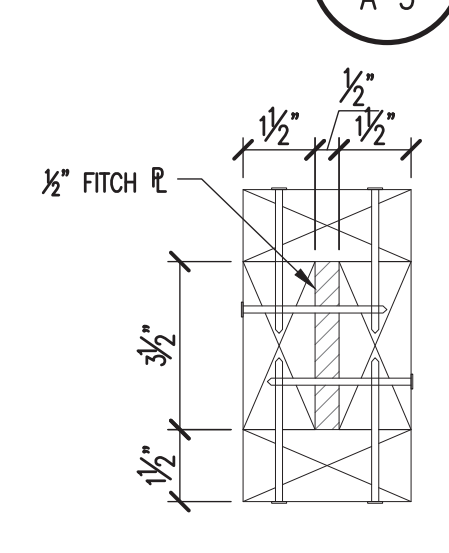

11 DOOR HEADER DETAIL
SCALE: 3"=1'-0"

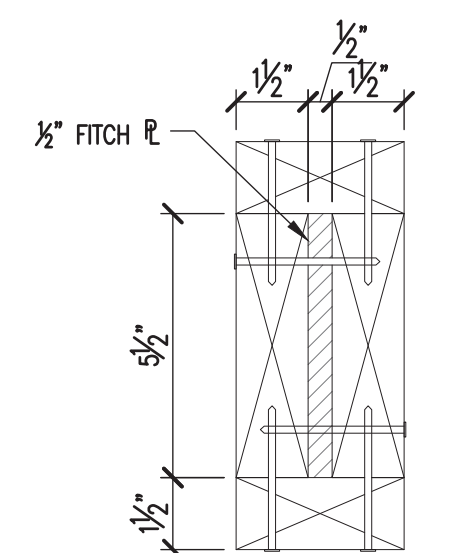


12 DOOR HEADER DETAIL
SCALE: 3"=1'-0"

NOTE:
1. SEE NOTES ON SHEETS A-1 & A-2 FOR ANY INFORMATION NOT SHOWN HERE.
2. SEE FASTENING SCHEDULE FOR ALL FASTENING NOT NOTED ON THIS SHEET.


NOTE:
1. 2x6 STUD FRAMING MAY BE USED IN LIEU OF 2x4's (ALSO FOR ROOF TRUSSES AS WELL)

NOTE:
1. 2x6 STUD FRAMING MAY BE USED IN LIEU OF 2x4's (ALSO FOR ROOF TRUSSES AS WELL)

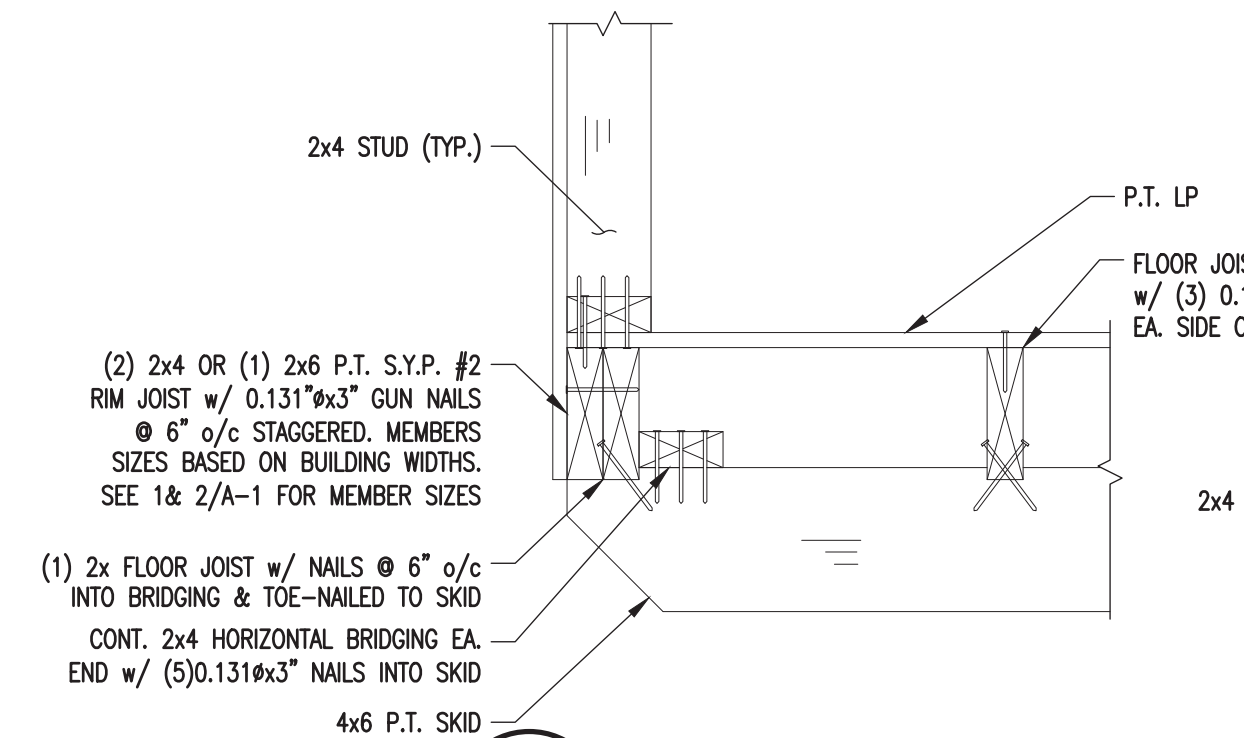


13 SKID TO JOIST DETAIL
SCALE: 1-1/2"=1'-0"


NOTES:
1. SEE NOTES ON SHEETS A-1 & C-2 FOR ANY INFORMATION NOT SHOWN HERE.
2. SEE FASTENING SCHEDULE FOR ALL FASTENING NOT NOTED ON THIS SHEET.

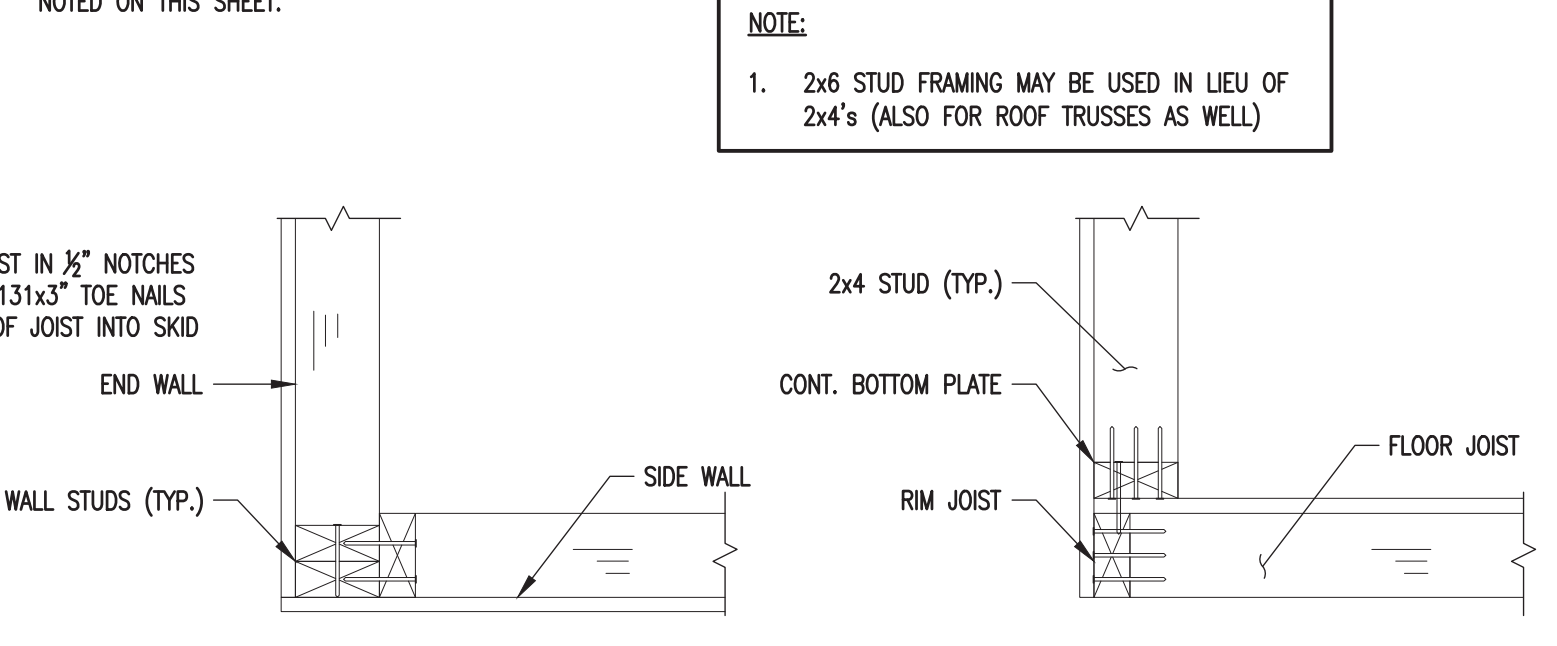


14 CORNER CONNECTION DETAIL
SCALE: 1-1/2"=1'-0"

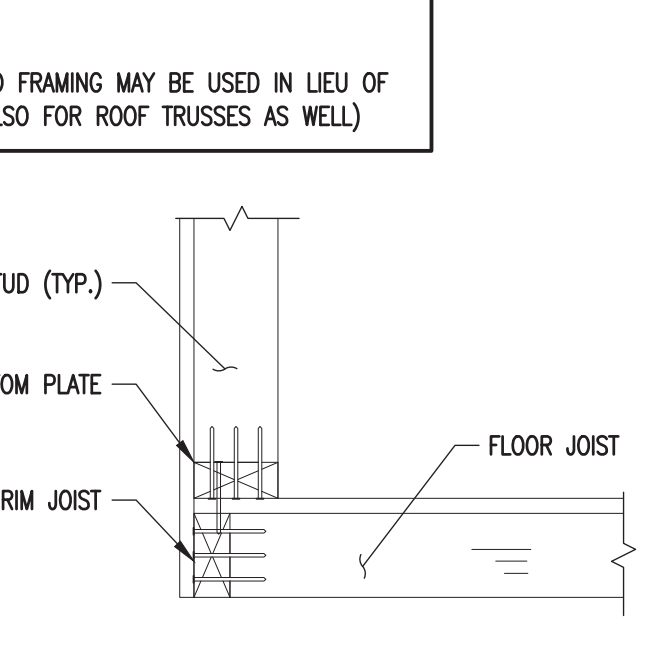

15 WALL TO RIM JOIST
SCALE: 1-1/2"=1'-0"

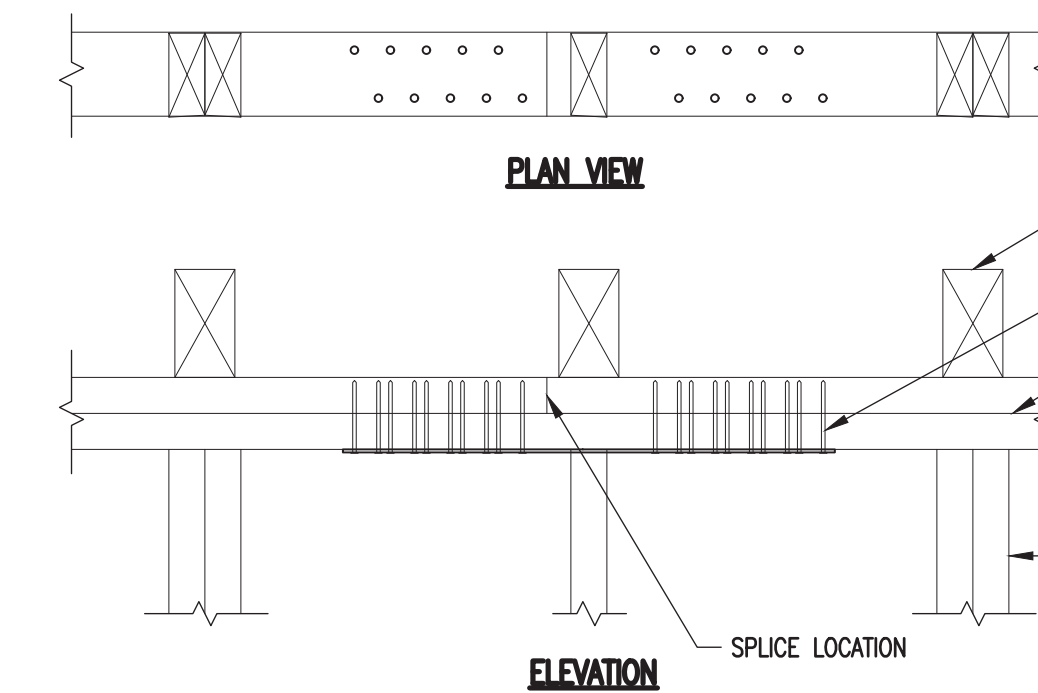

16 TOP PLATE SPLICE DETAIL
SCALE: 1-1/2"=1'-0"

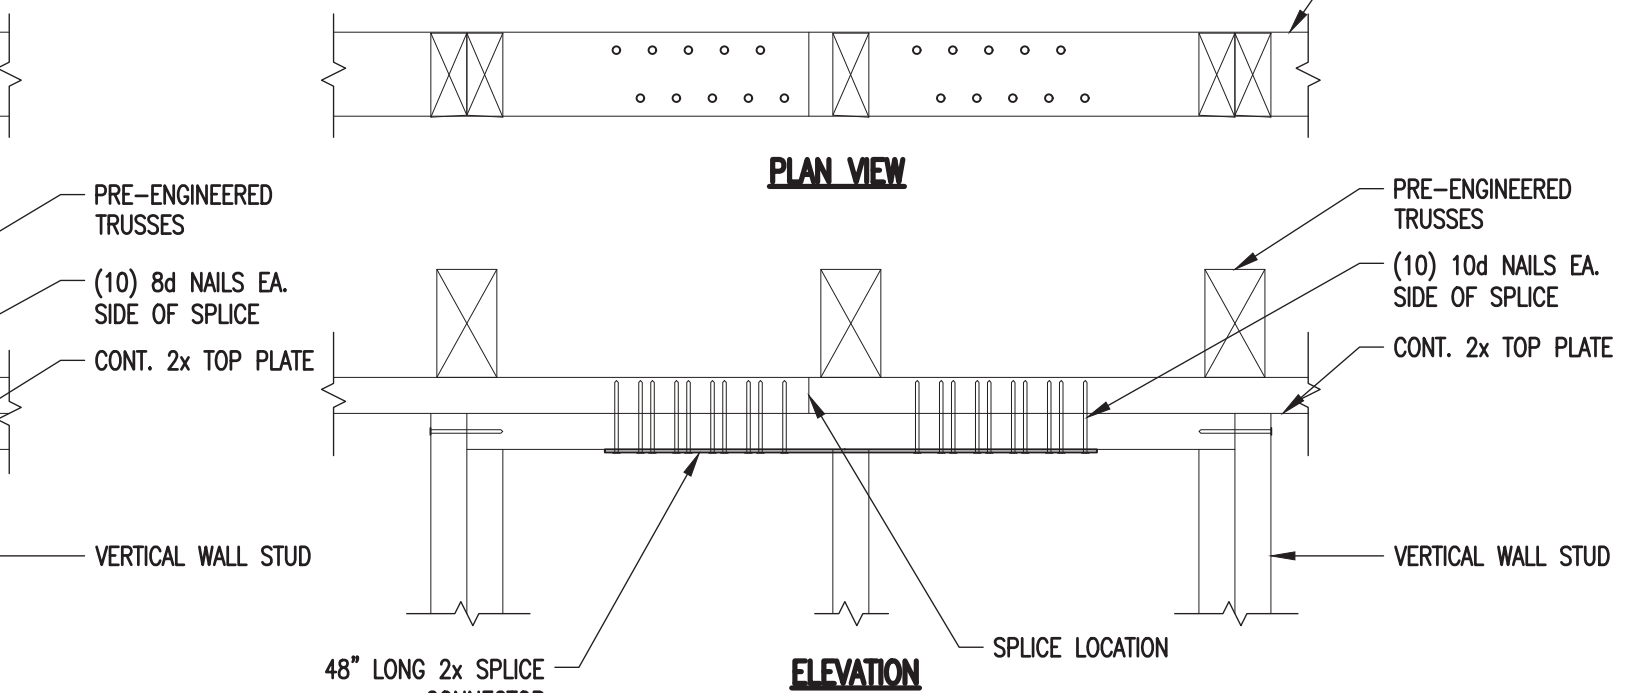

17 SPLICE CONNECTION DETAIL
SCALE: 1-1/2"=1'-0"

PROJECT: UTILITY SHED

TYPICAL DETAILS

DON VAN GERVE, P.E.
SPECIALTY STRUCTURAL ENGINEER












ENGINEERING SERVICES PROVIDED FOR:
PREMIER PORTABLE BUILDINGS
317 EAST STATE LINE ROAD
SOUTH FULTON, TN 38257
WWW.PREMIERBUILDINGS.US

REVISION	DESCRIPTION	DATE	BY
▲			
▲			
▲			

DATE: 6.30.24
PROJECT NO.: 18285
DRAWING BY: JH
CHK BY: DVG

DWG NO.: **A-5**

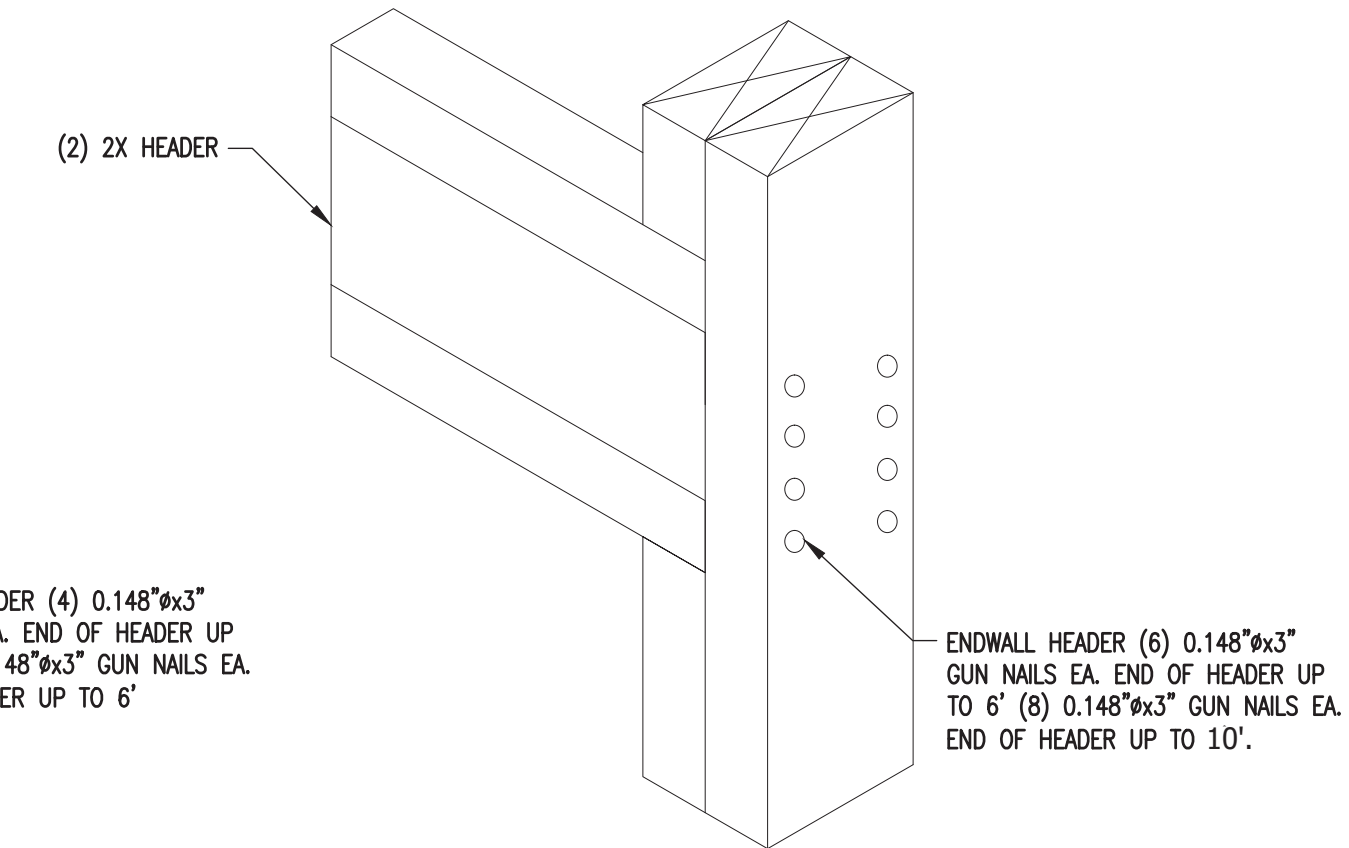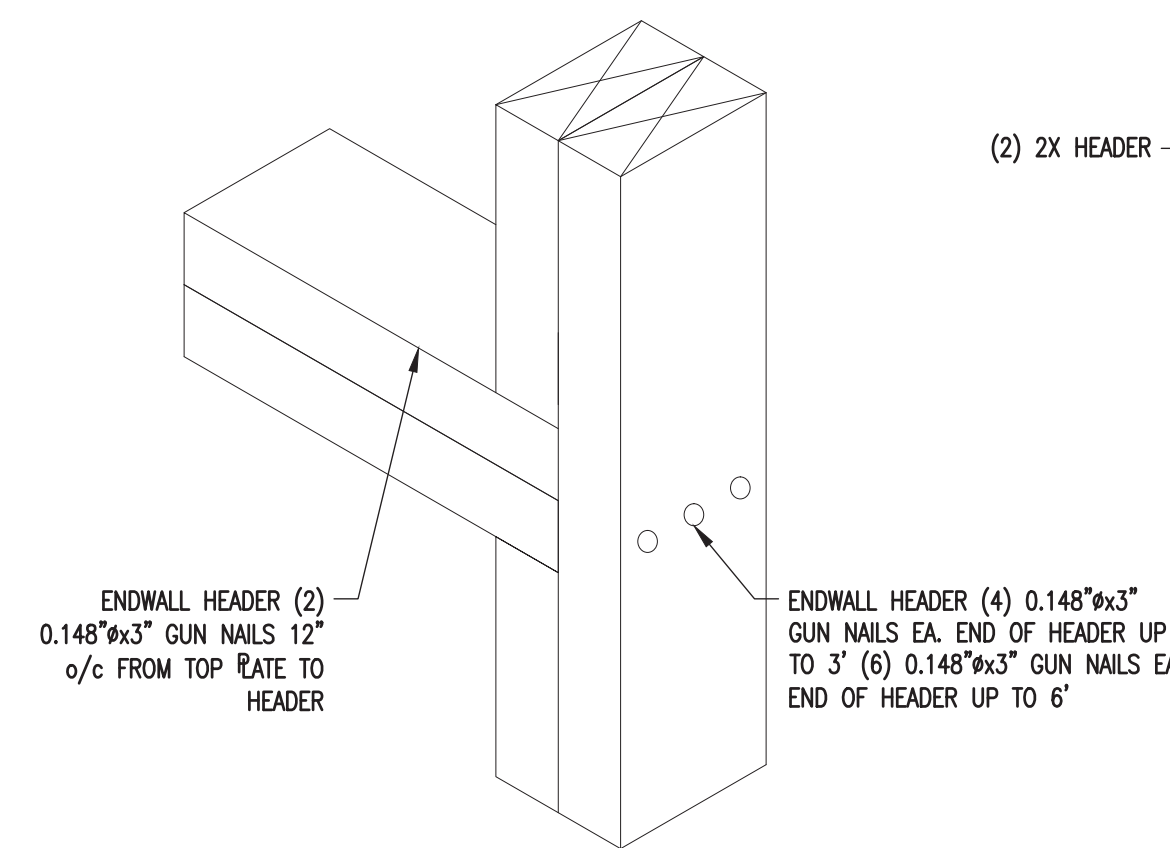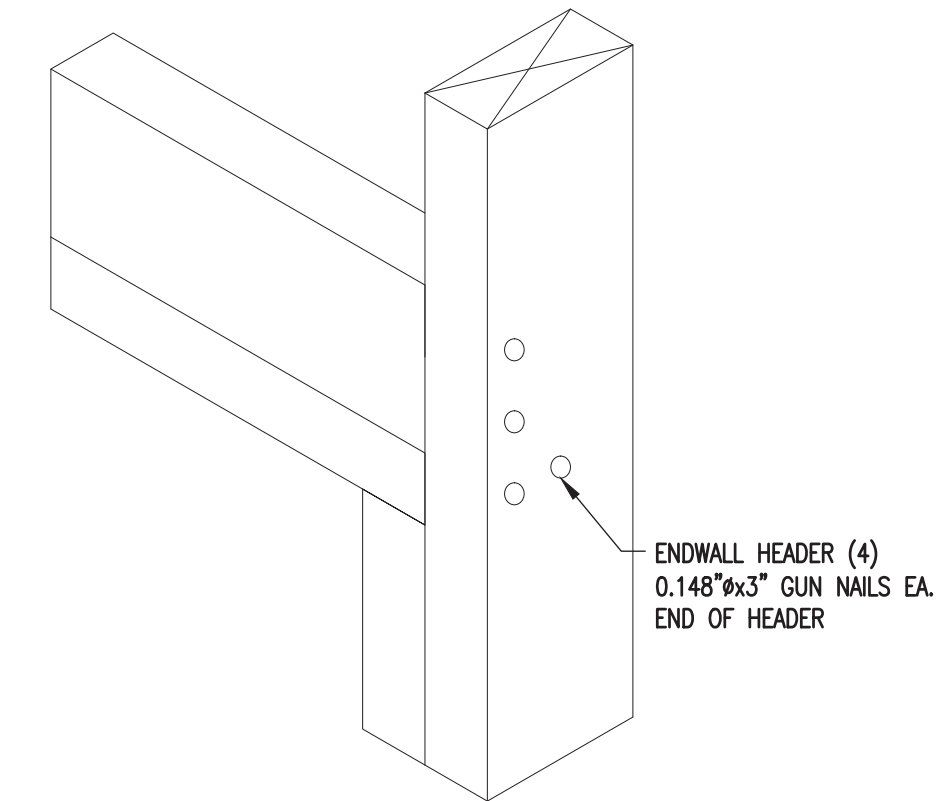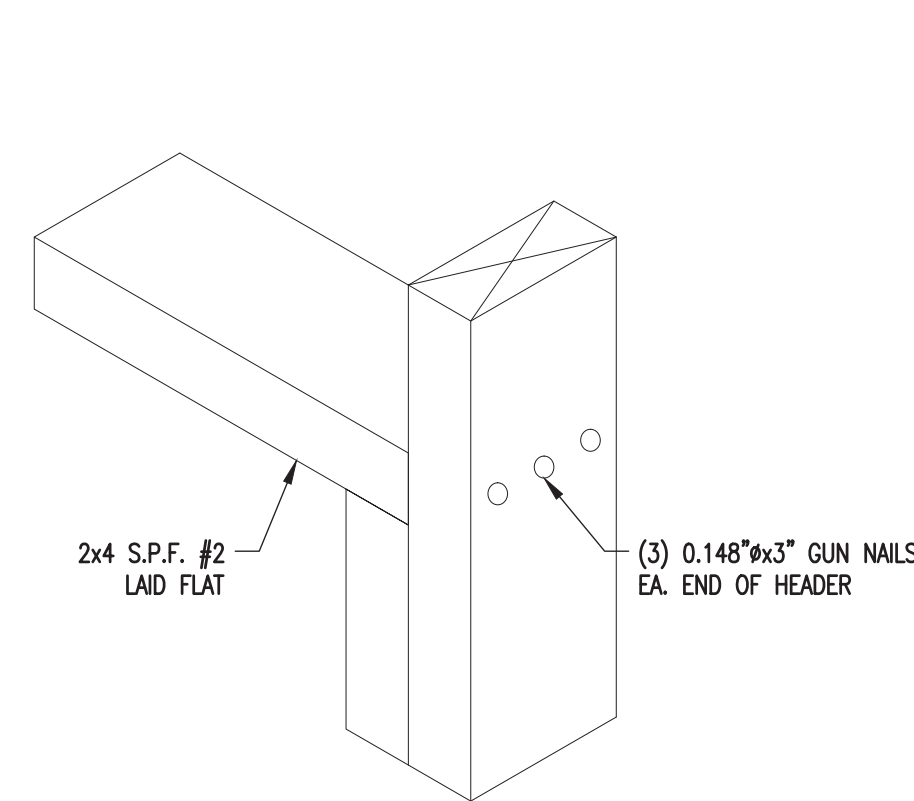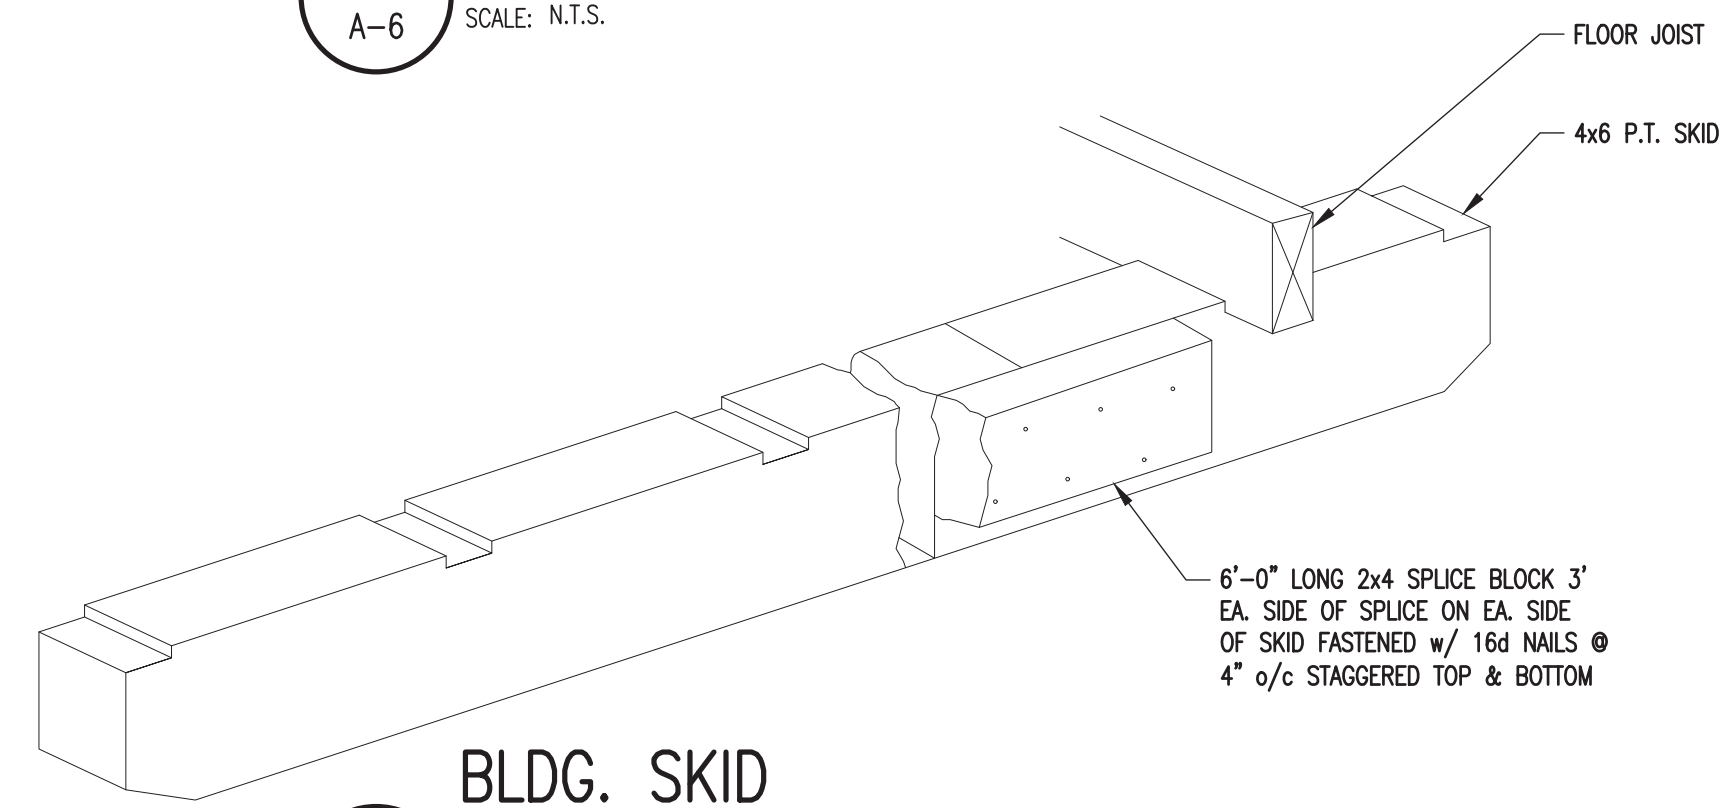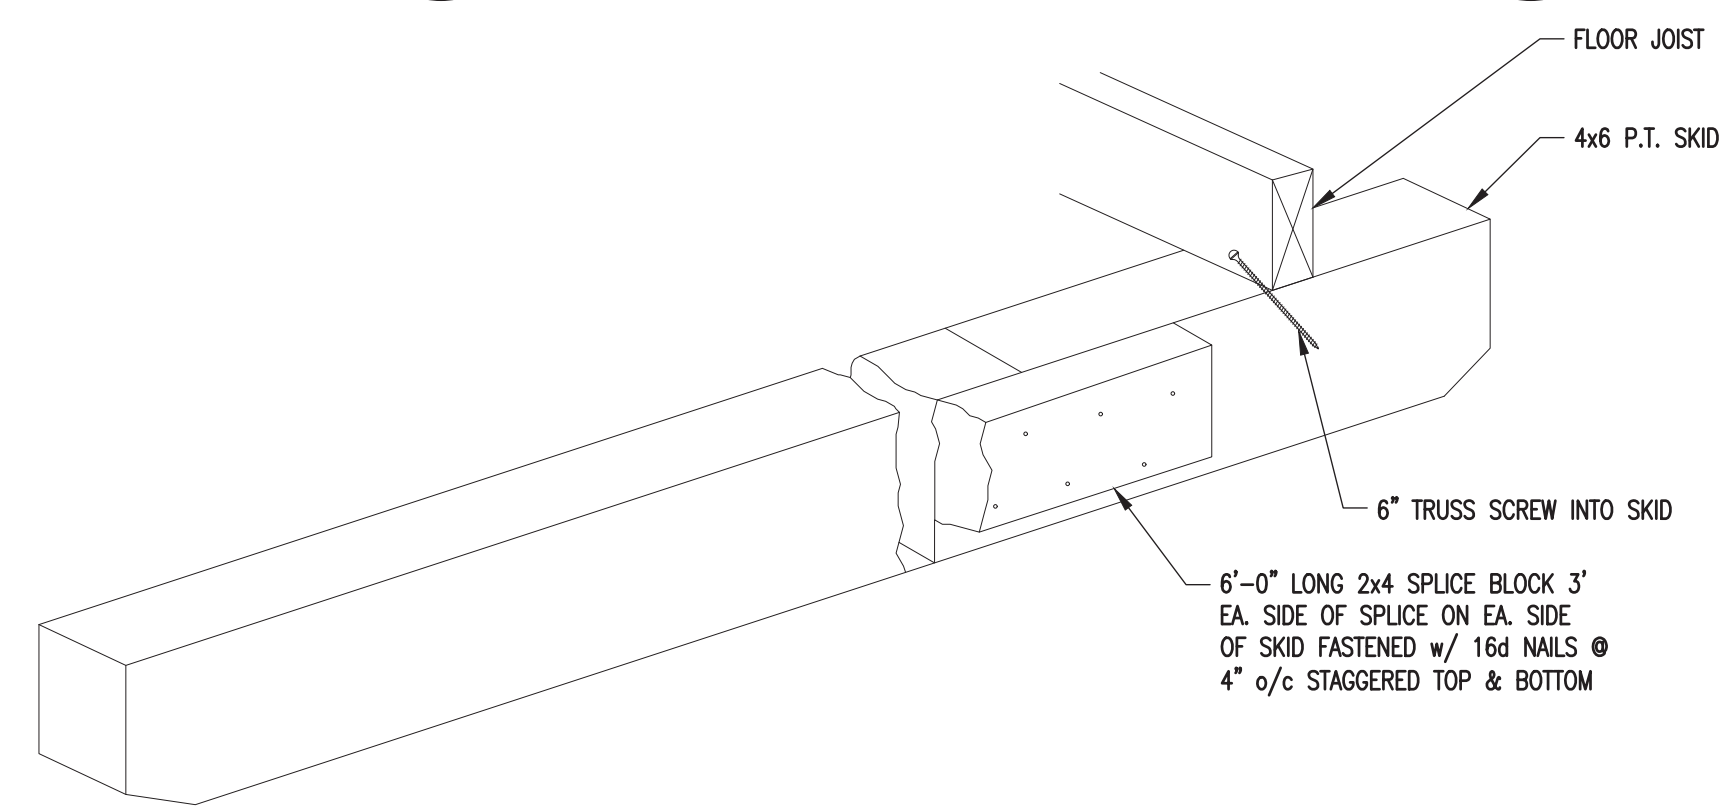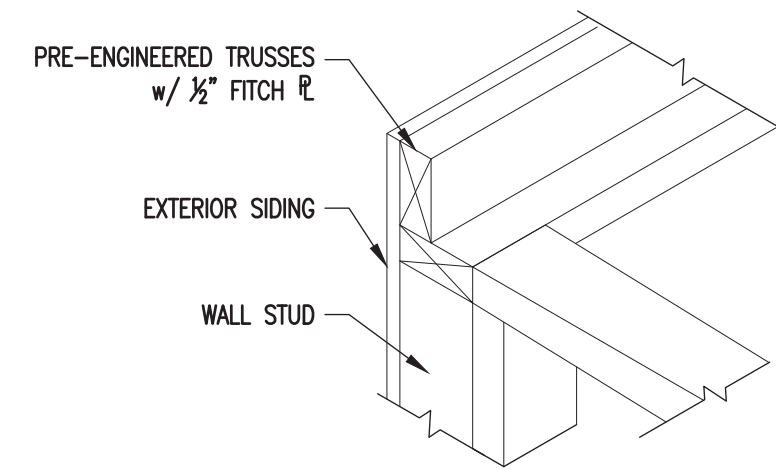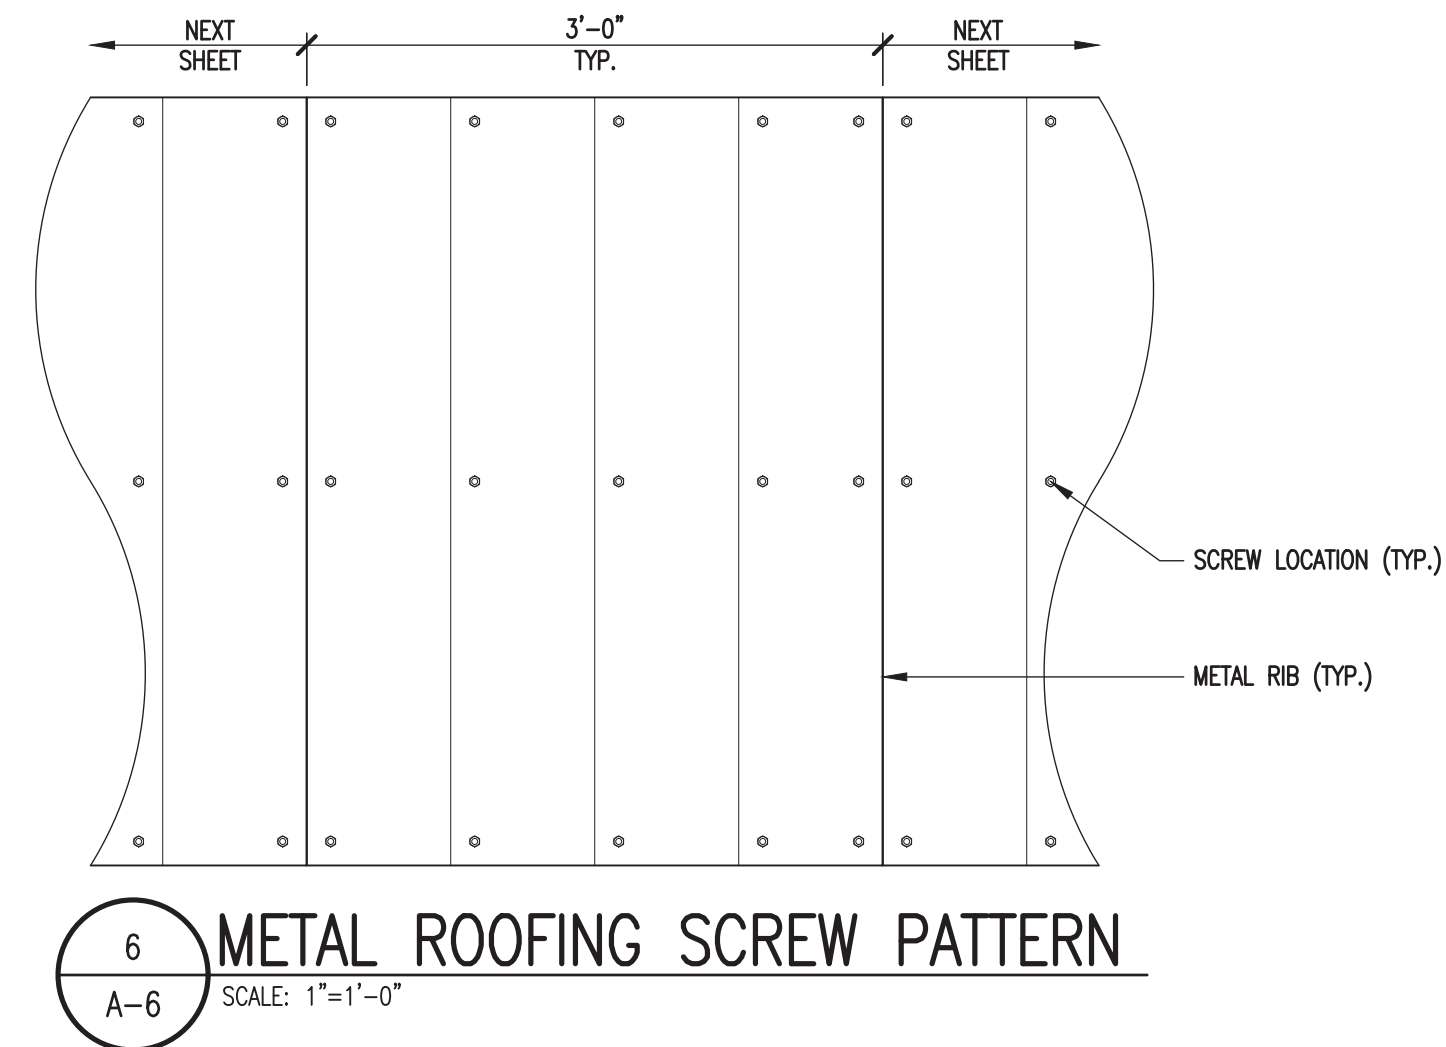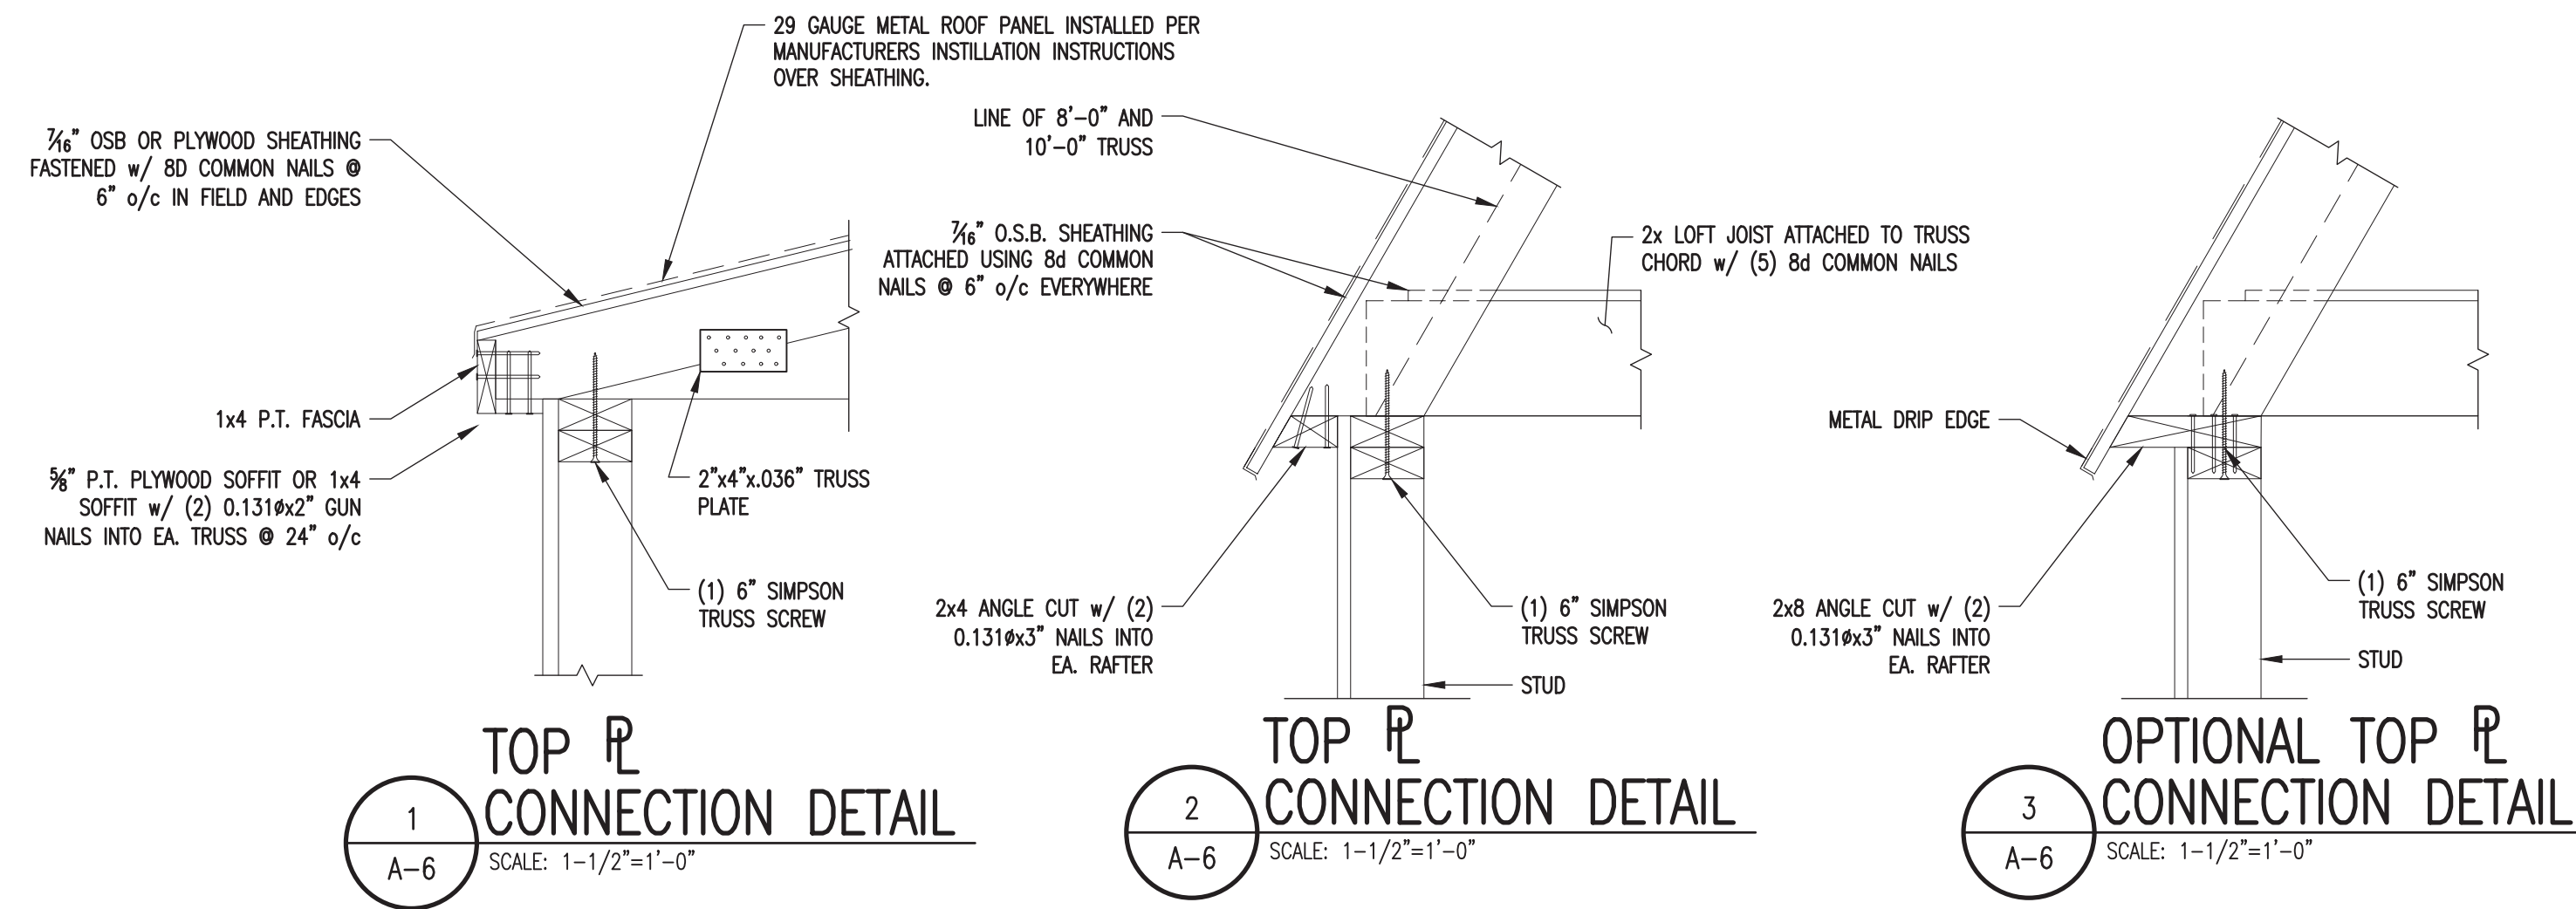

PROJECT: UTILITY SHED

TYPICAL DETAILS

DON VAN GERVE, P.E.
SPECIALTY STRUCTURAL ENGINEER




ENGINEERING SERVICES PROVIDED FOR:
PREMIER PORTABLE BUILDINGS
317 EAST STATE LINE ROAD
SOUTH FULTON, TN 38257
WWW.PREMIERBUILDINGS.US

REVISION	DESCRIPTION	DATE	BY
▲			
▲			
▲			
▲			


DATE: 6.30.24
PROJECT NO.: 18285
DRAWING BY: JH
CHK BY: DVG

DWG NO.: **A-6**


8 of 12

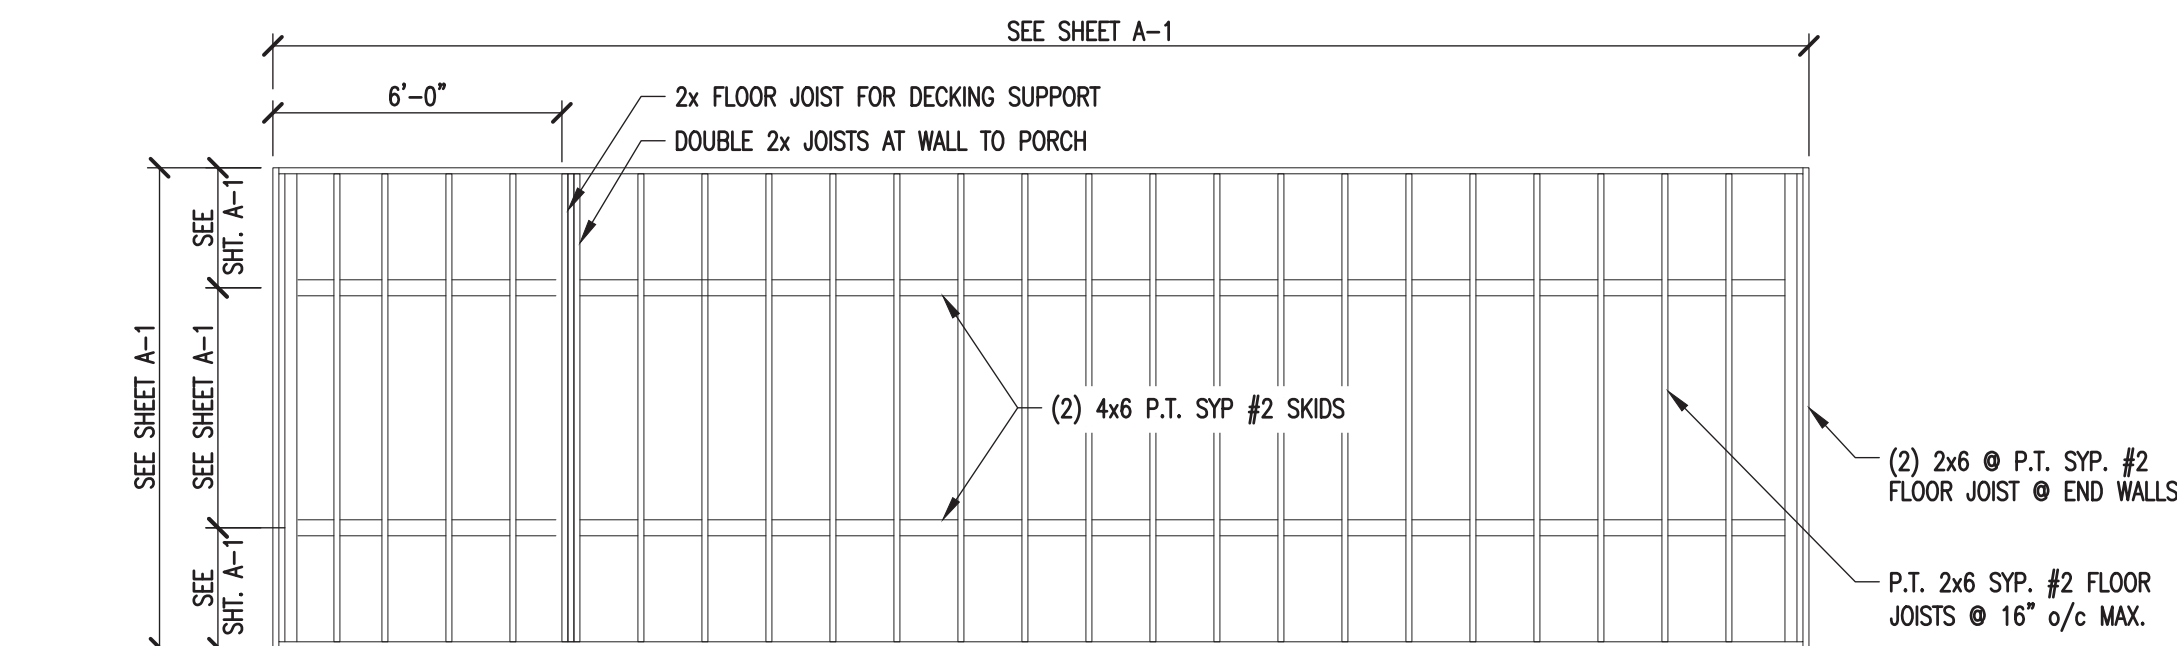


1 FLOOR FRAMING PLAN
SCALE: 1/4"=1'-0"
(DO NOT SCALE DRAWING)

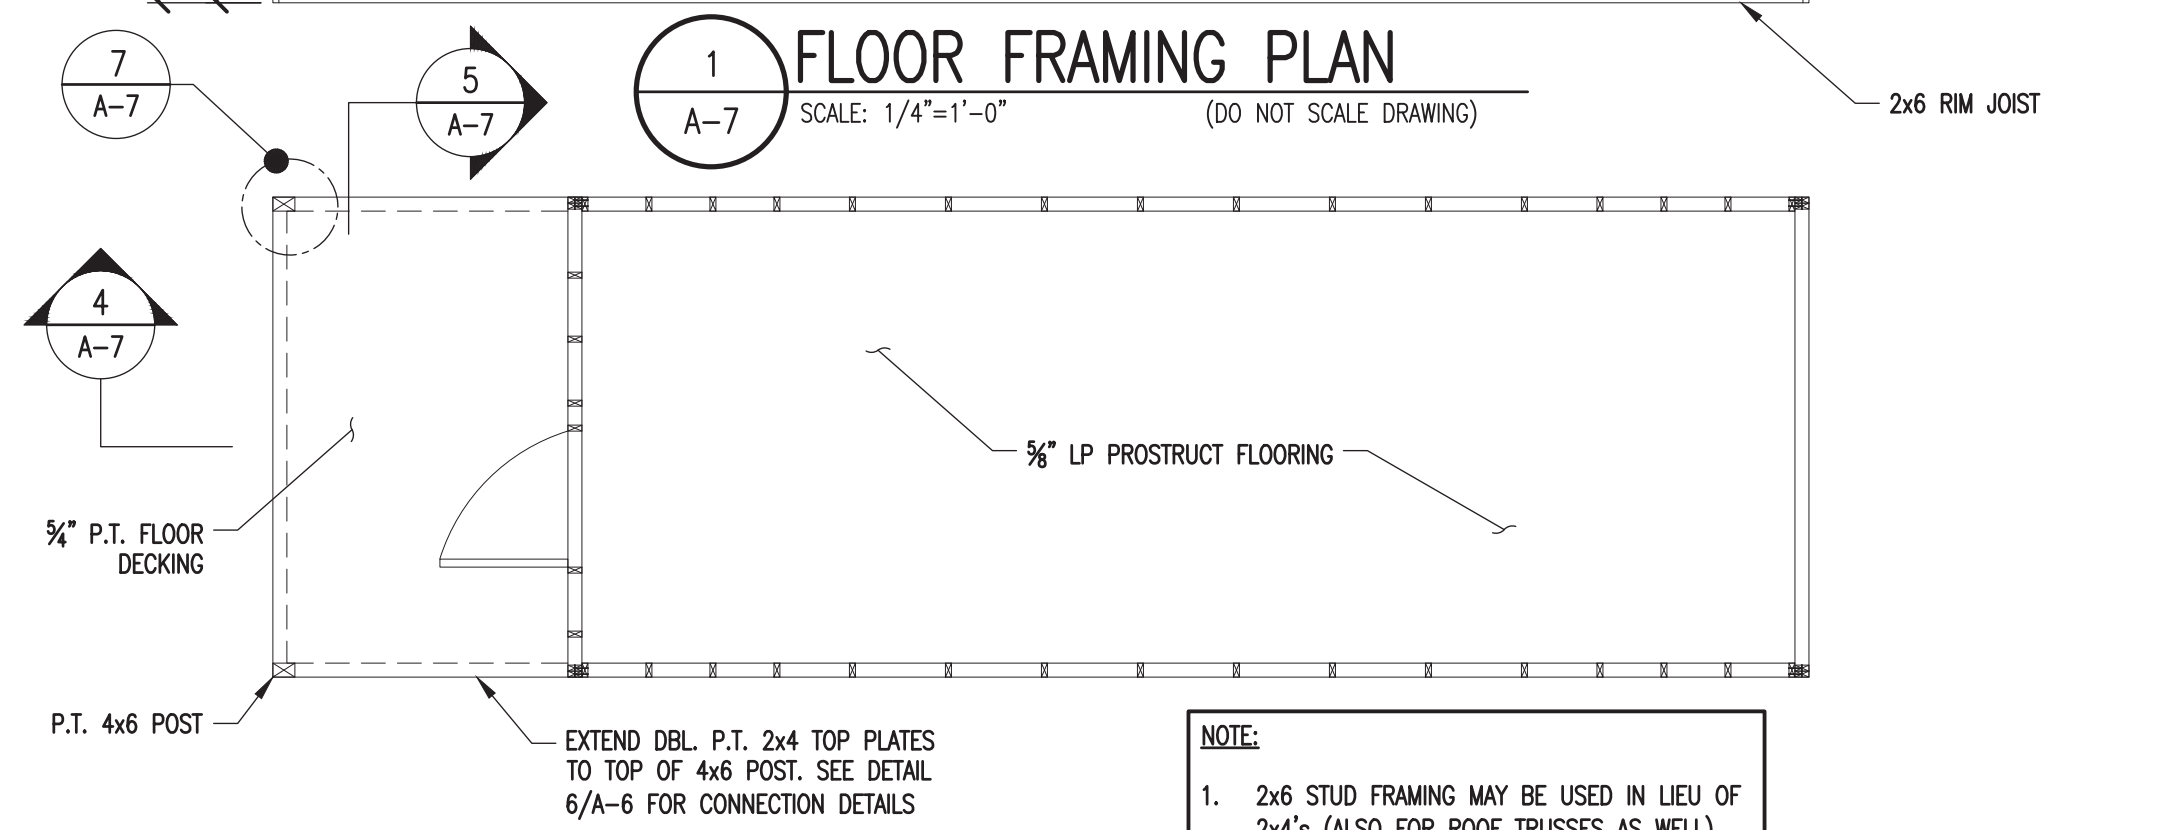


2 FLOOR FRAMING PLAN
SCALE: 1/4"=1'-0"
(DO NOT SCALE DRAWING)

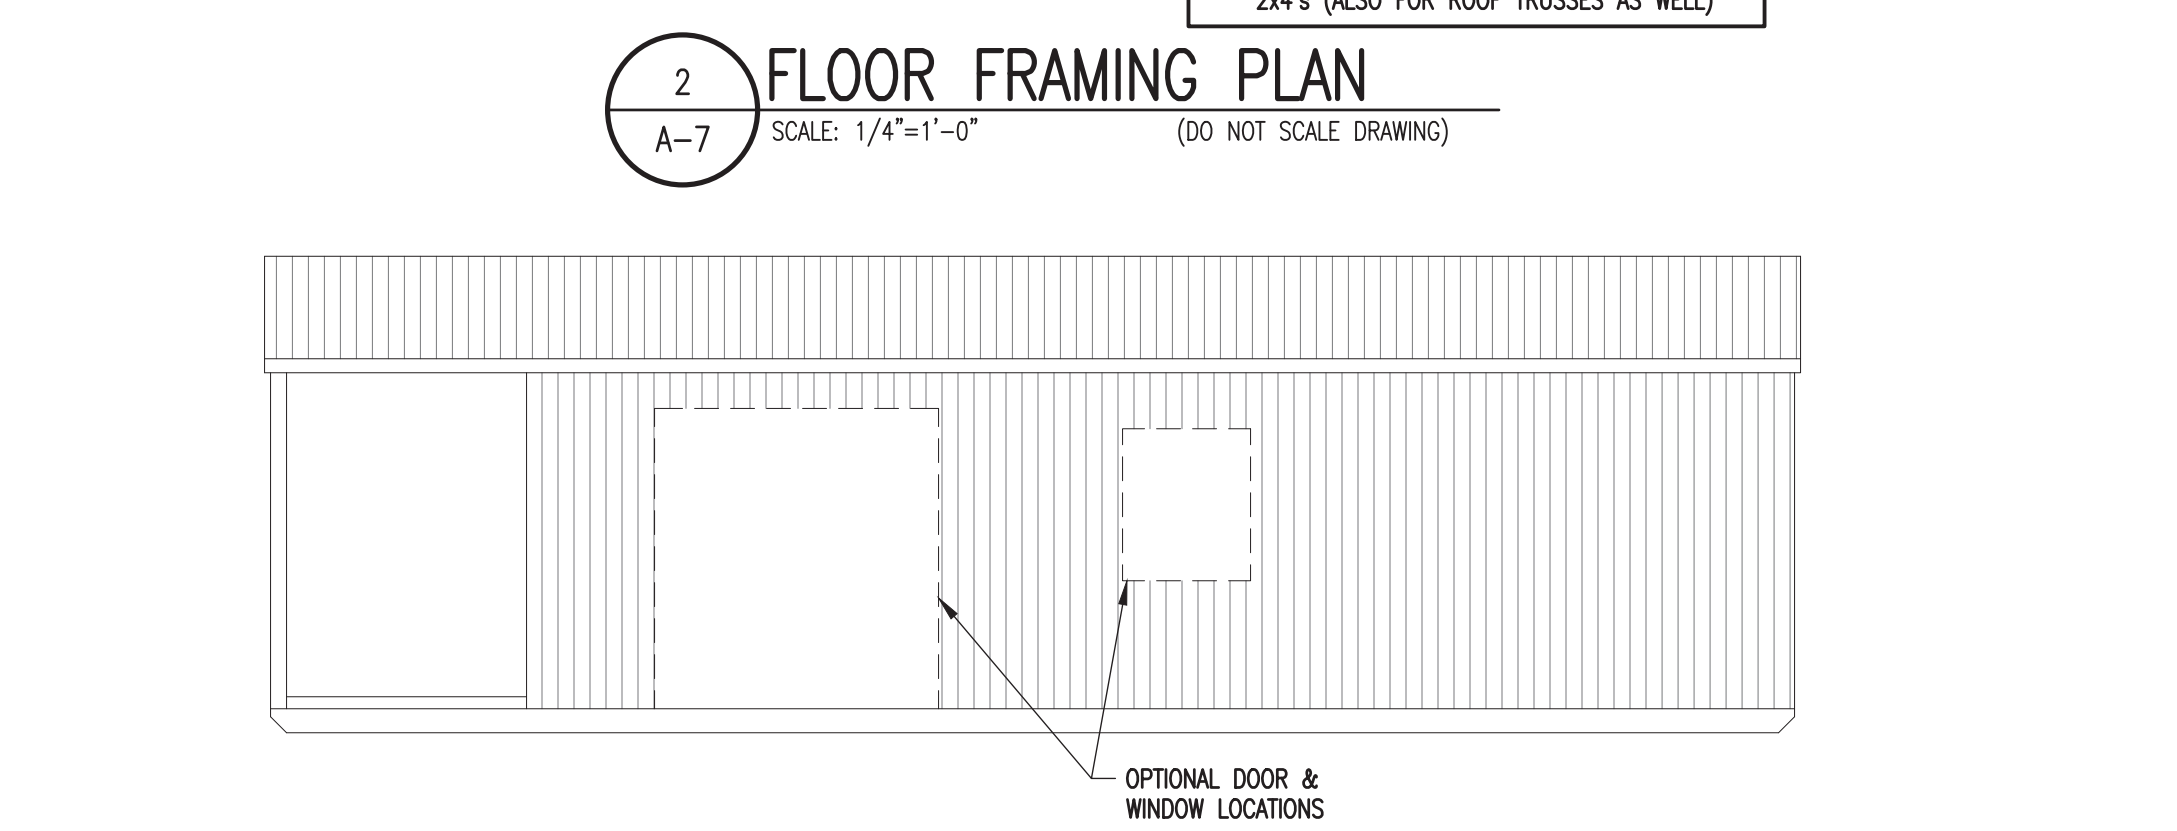


3 SIDEWALL ELEVATION
SCALE: 1/4"=1'-0"
(DO NOT SCALE DRAWING)

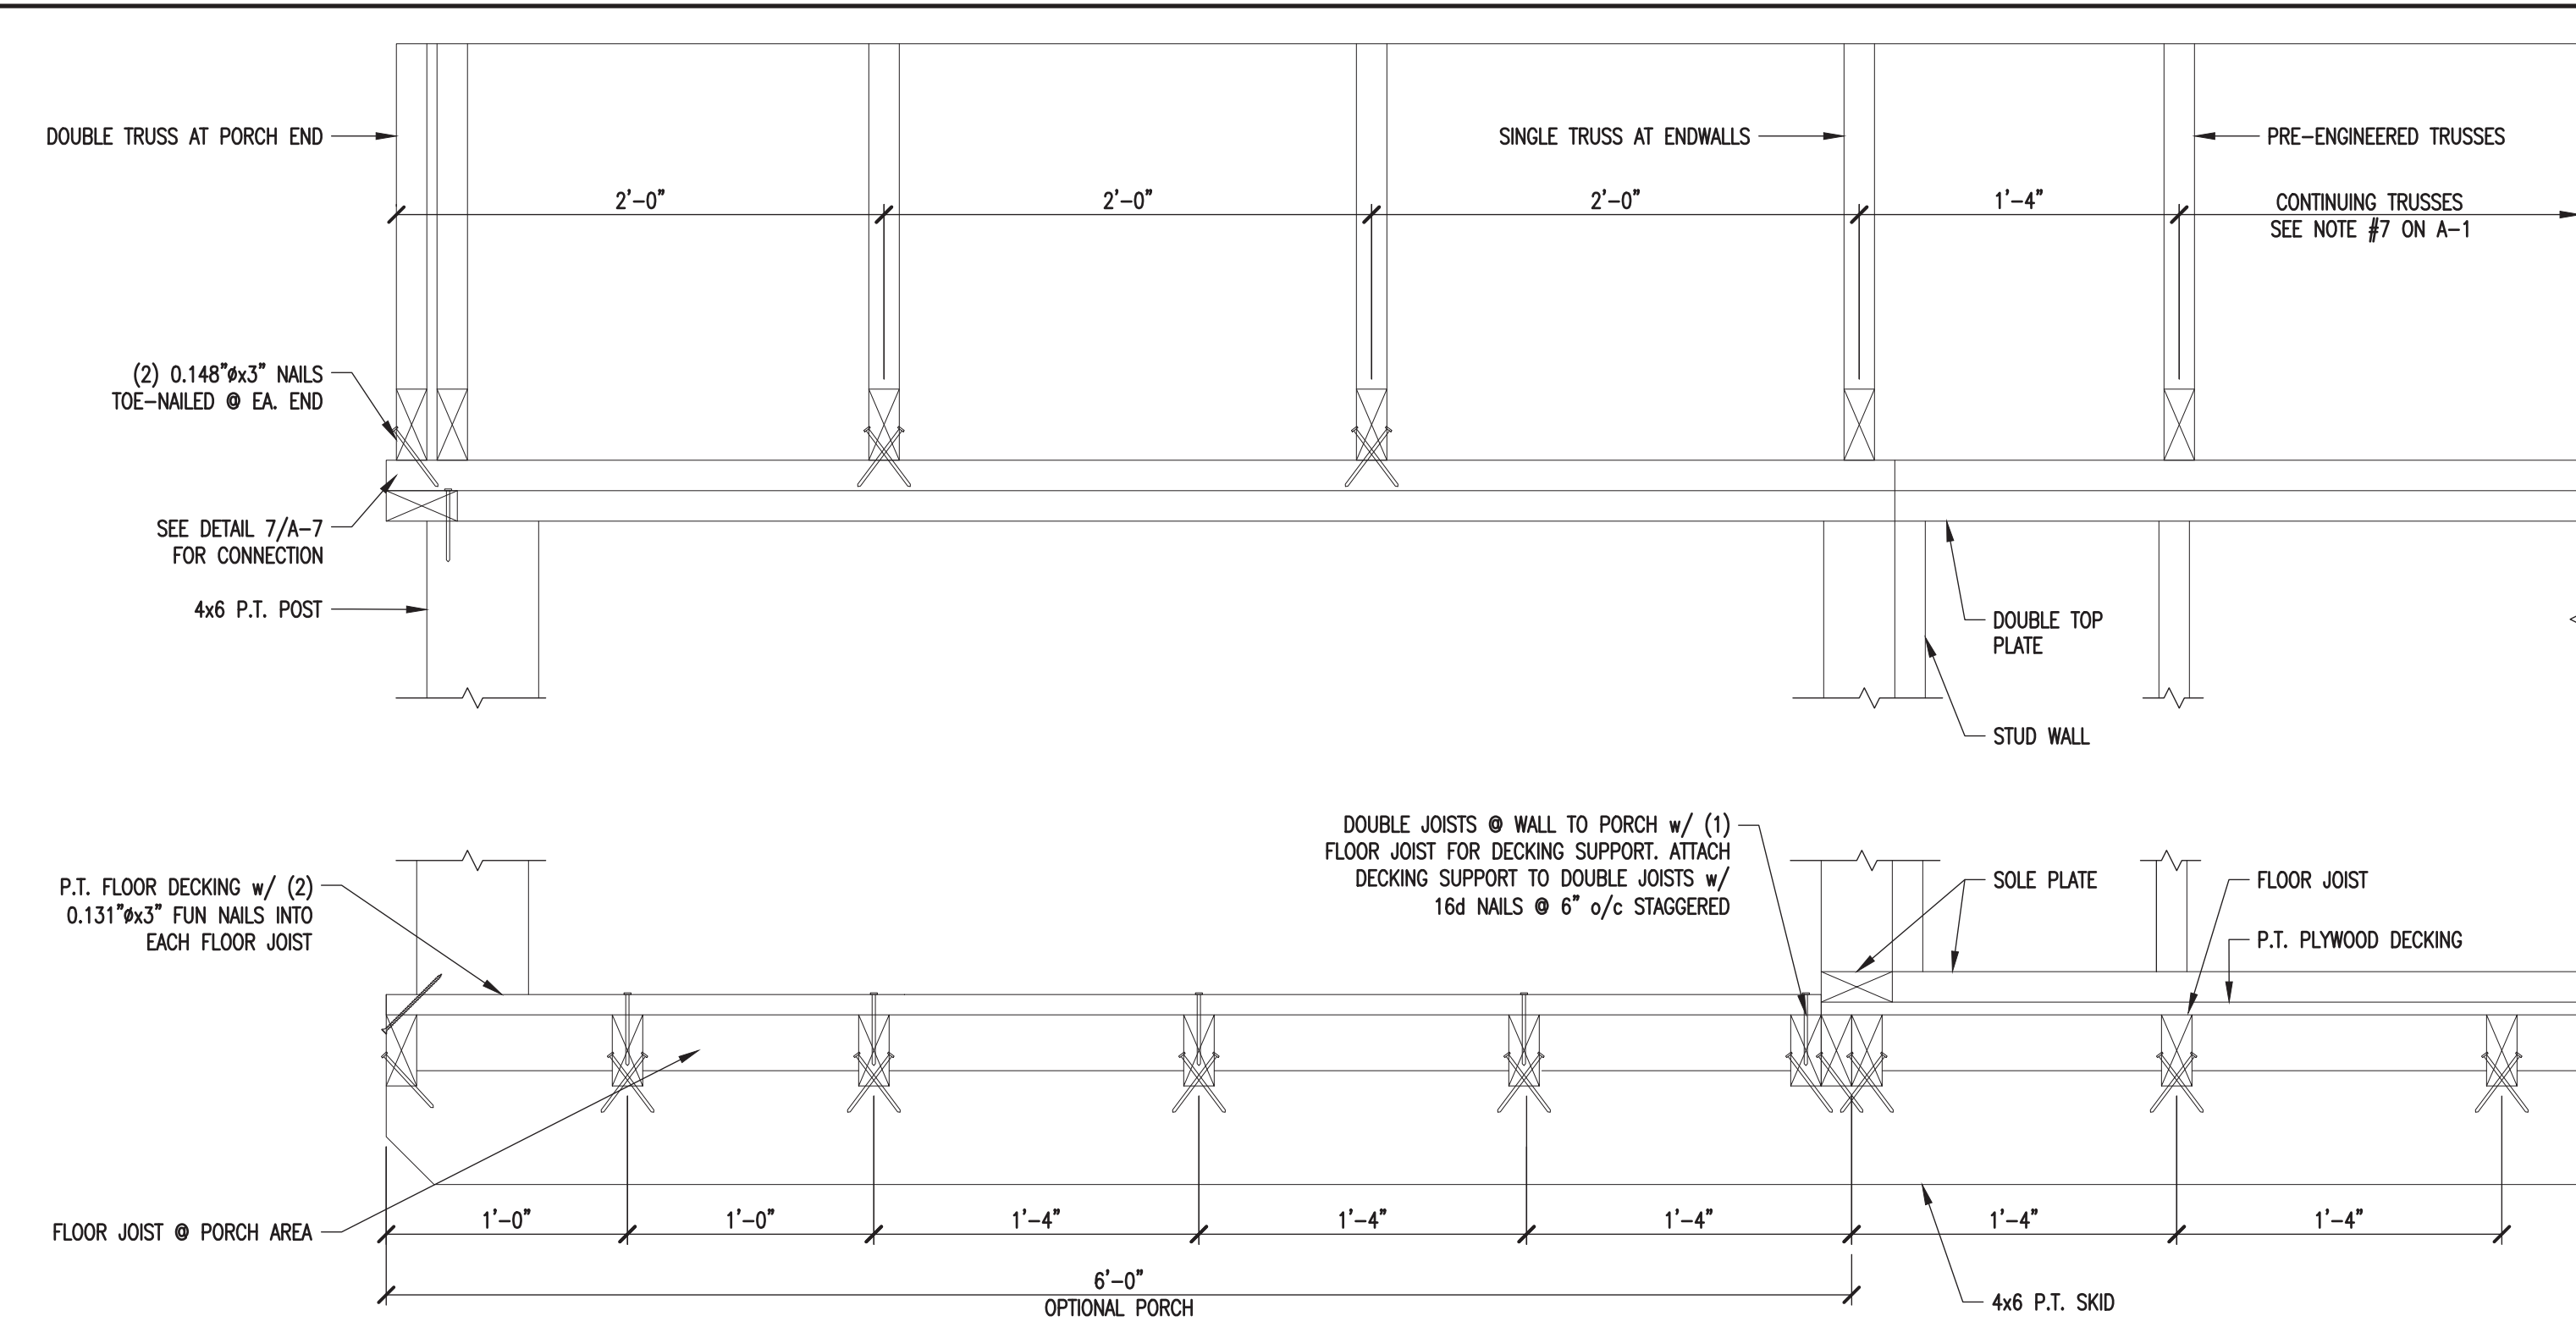


4 OPTIONAL PORCH SECTION DETAIL
SCALE: 1-1/2"=1'-0"
(DO NOT SCALE DRAWING)

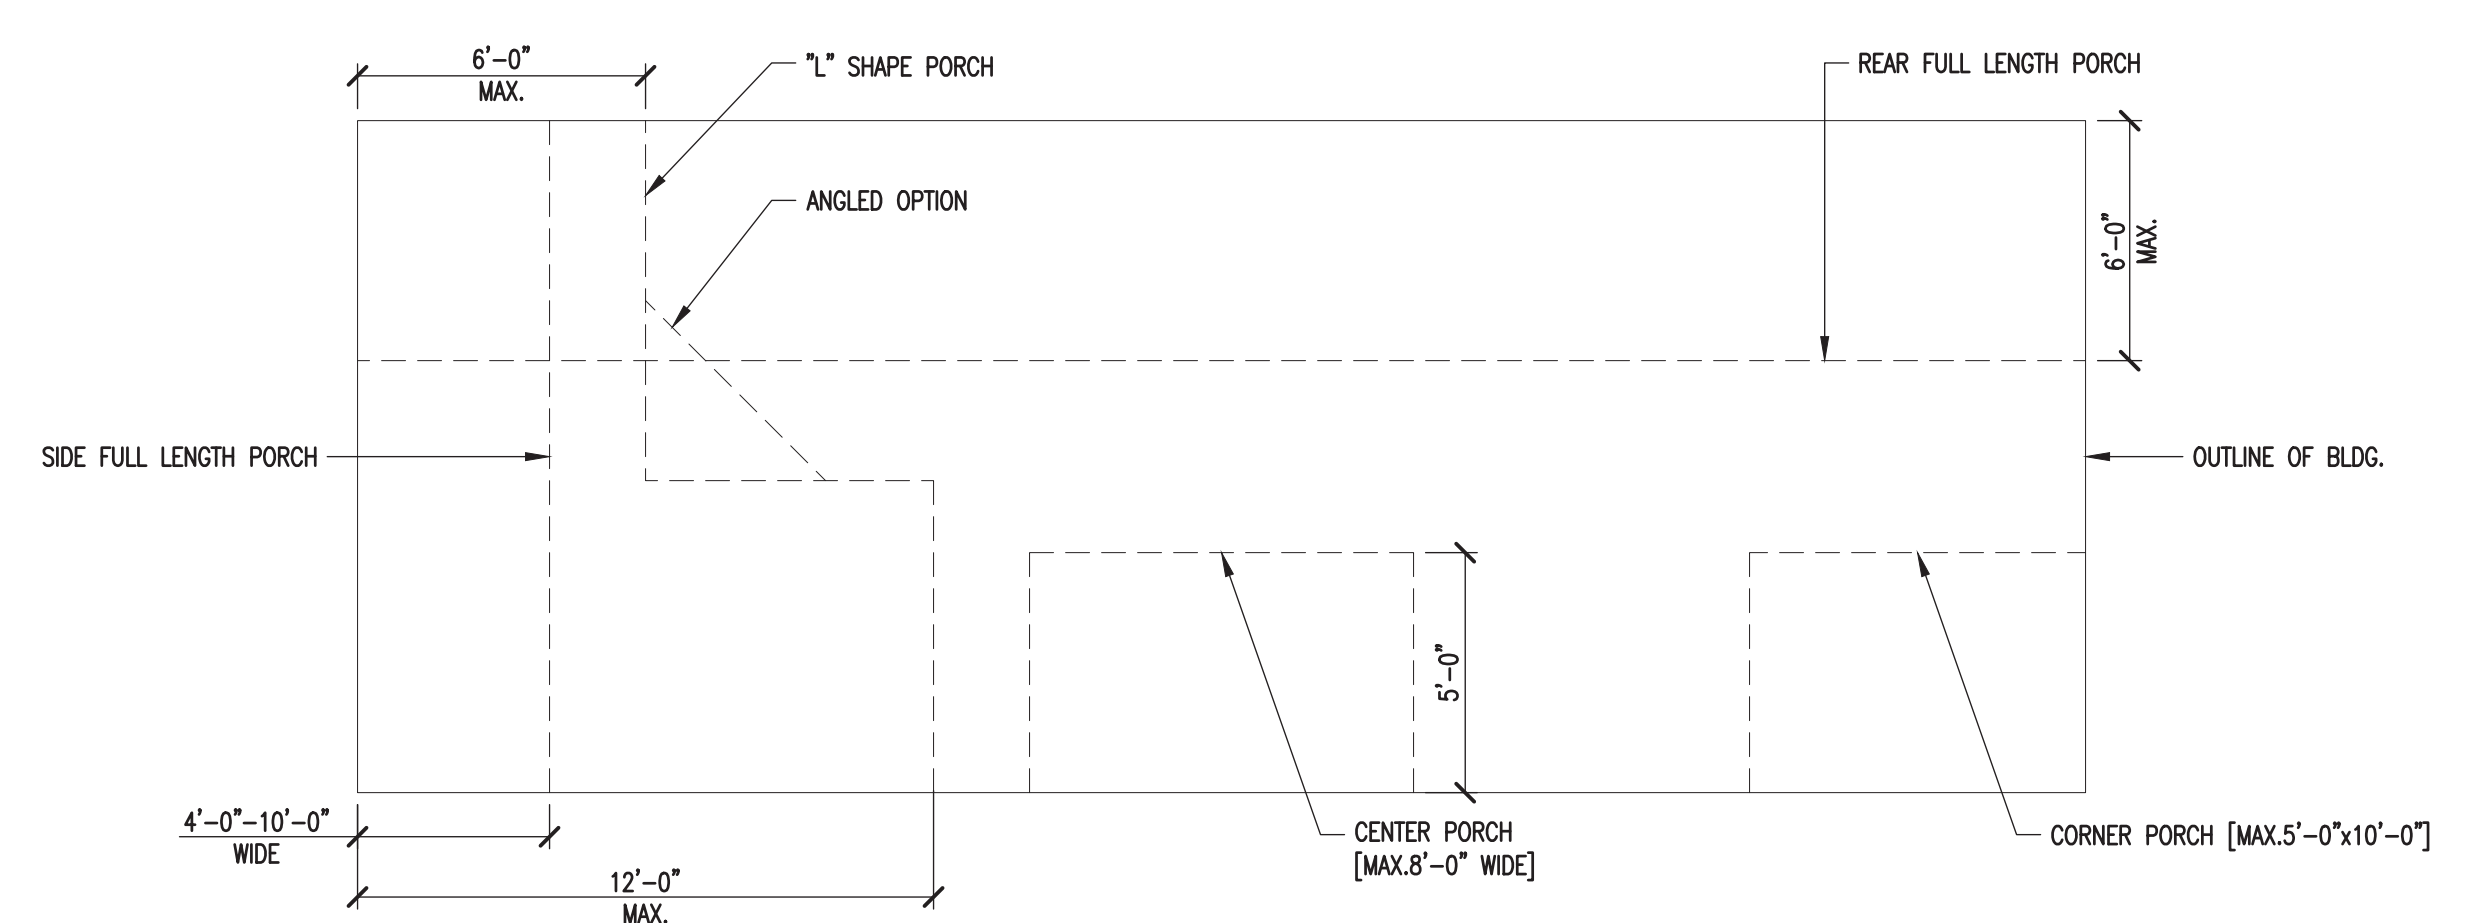


8 BUILDING PORCH OPTIONS
SCALE: 1/4"=1'-0"
(DO NOT SCALE DRAWING)

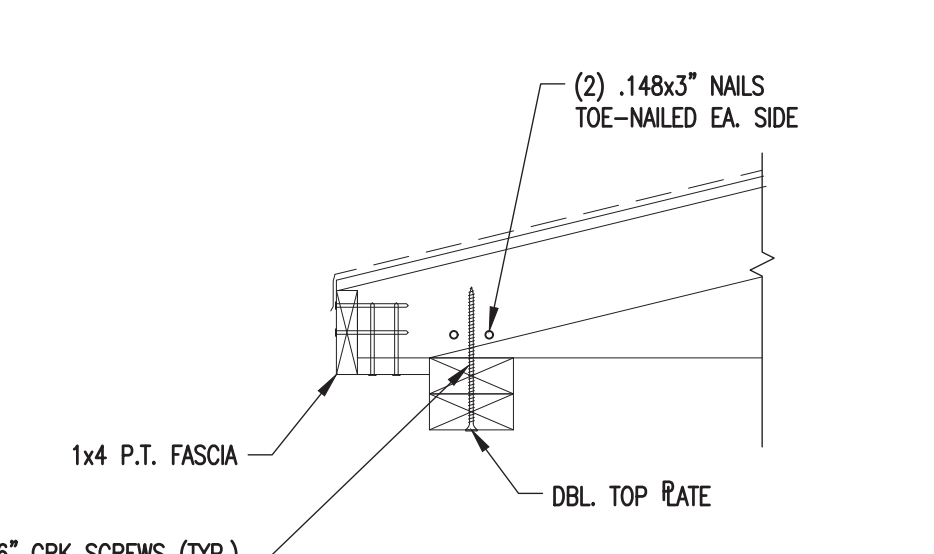


5 PORCH TOP PLATE DETAIL
SCALE: 1-1/2"=1'-0"
(DO NOT SCALE DRAWING)

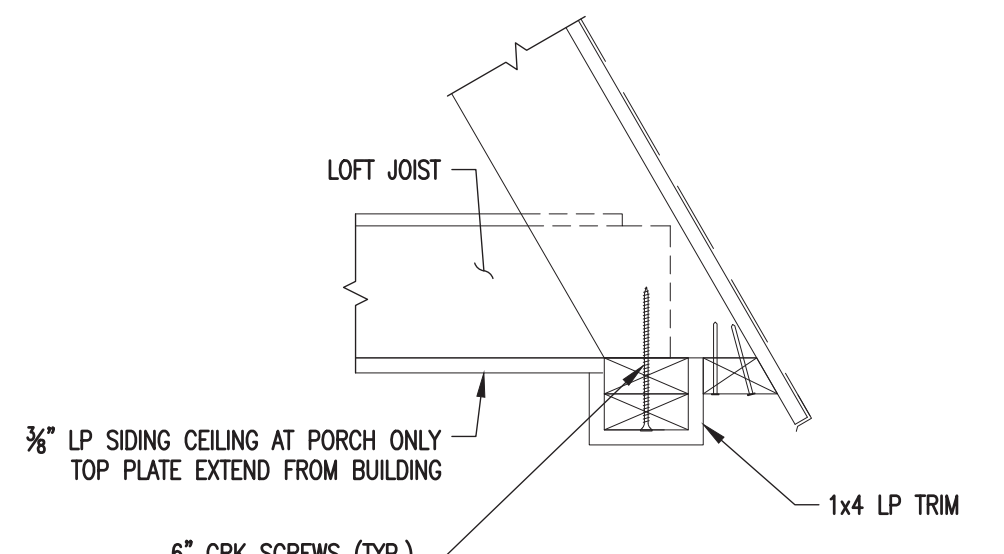


5A PORCH TOP PLATE DETAIL
SCALE: 1-1/2"=1'-0"
(DO NOT SCALE DRAWING)

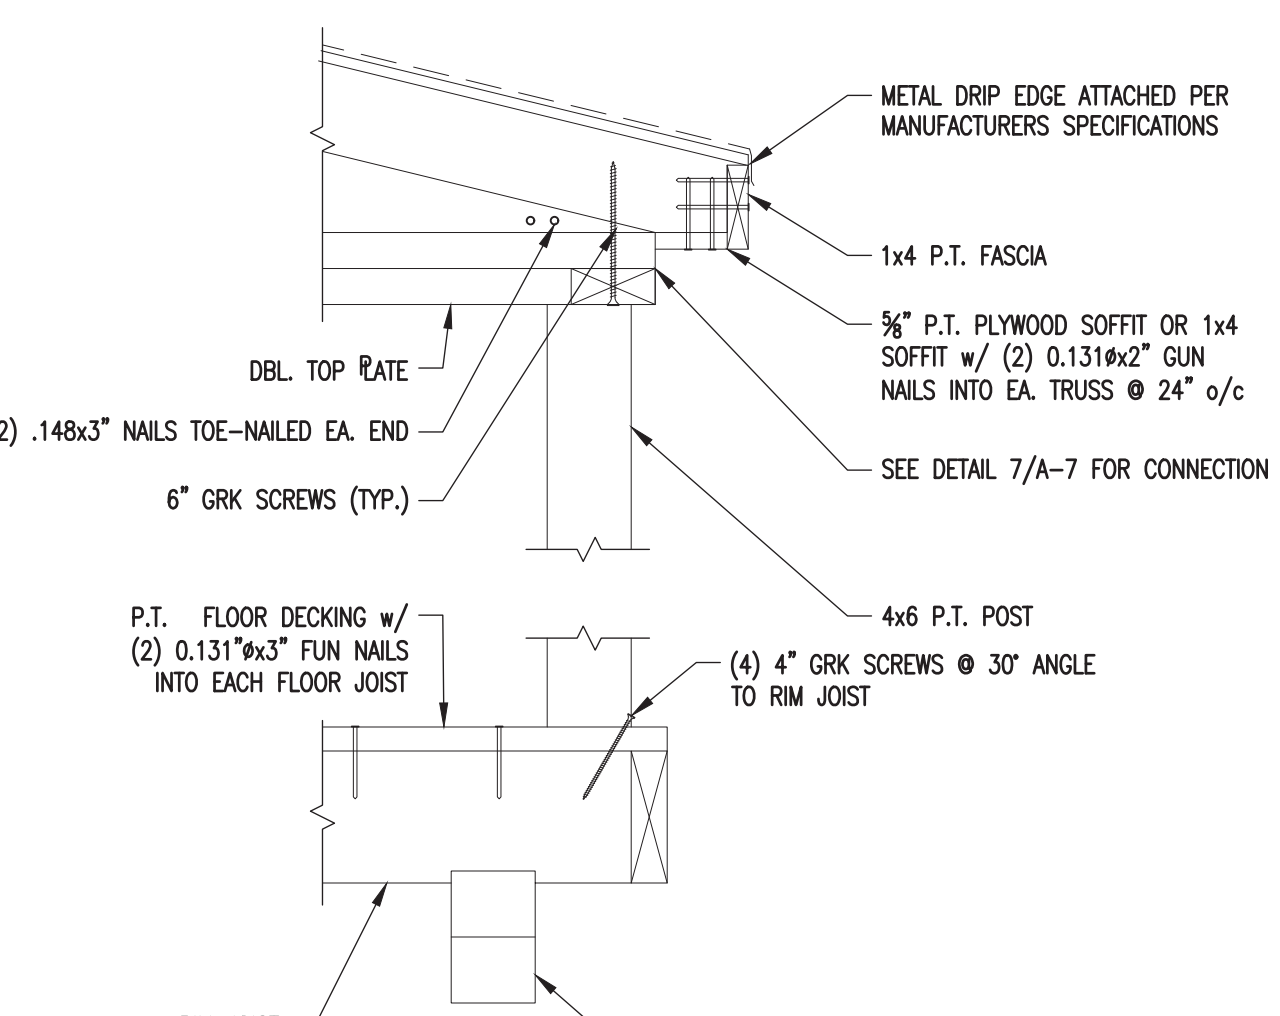

6 POST TO RIM JOIST DETAIL
SCALE: 1-1/2"=1'-0"
(DO NOT SCALE DRAWING)

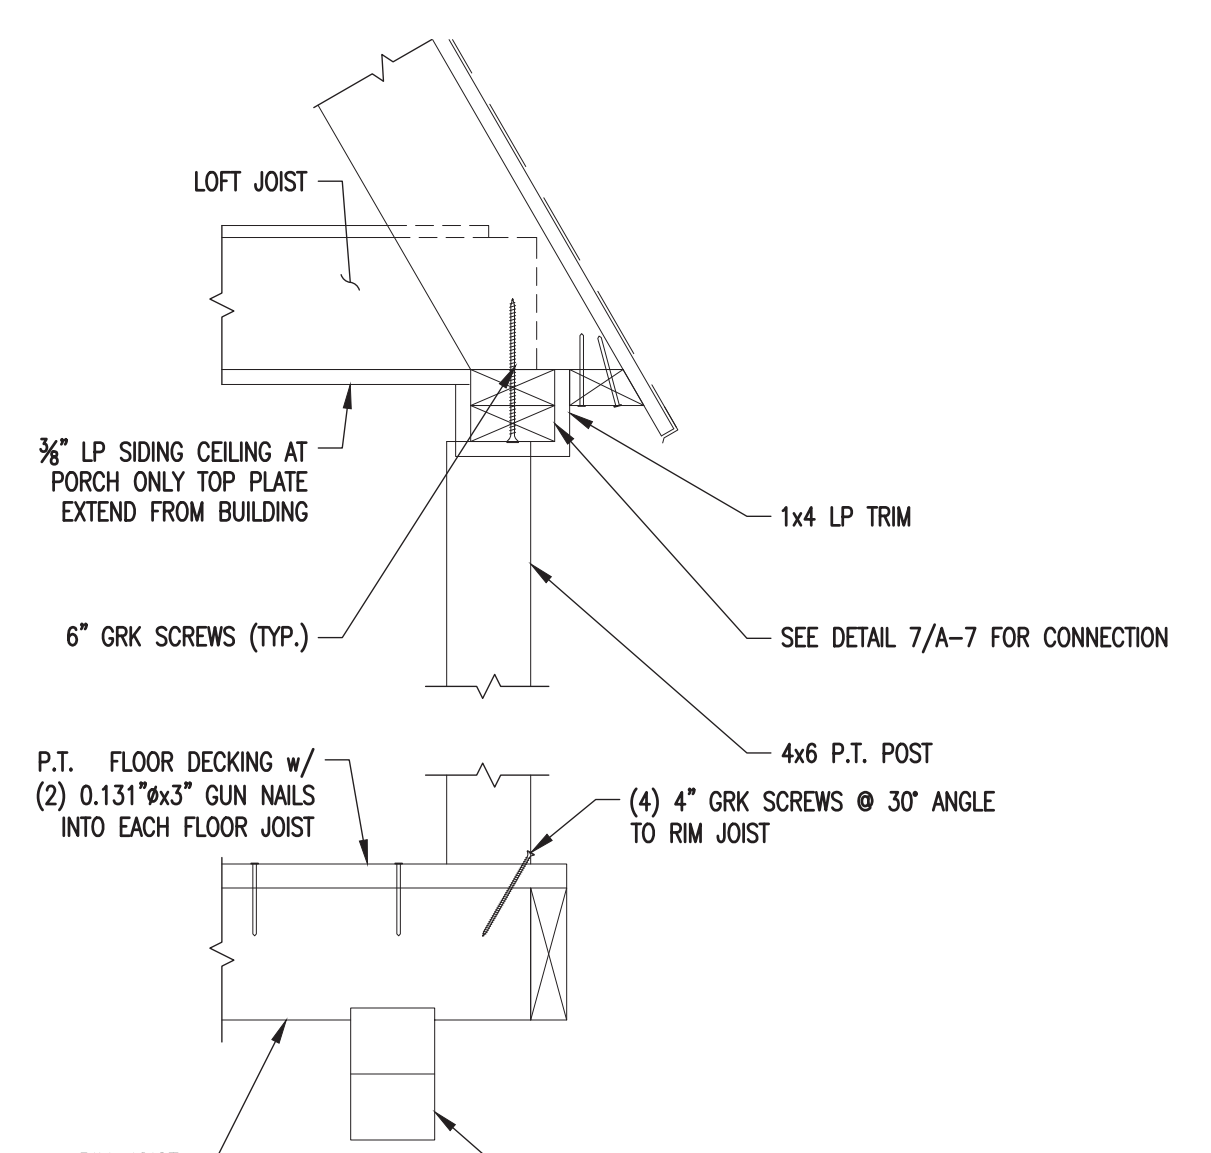

6A POST TO RIM JOIST DETAIL
SCALE: 1-1/2"=1'-0"
(DO NOT SCALE DRAWING)

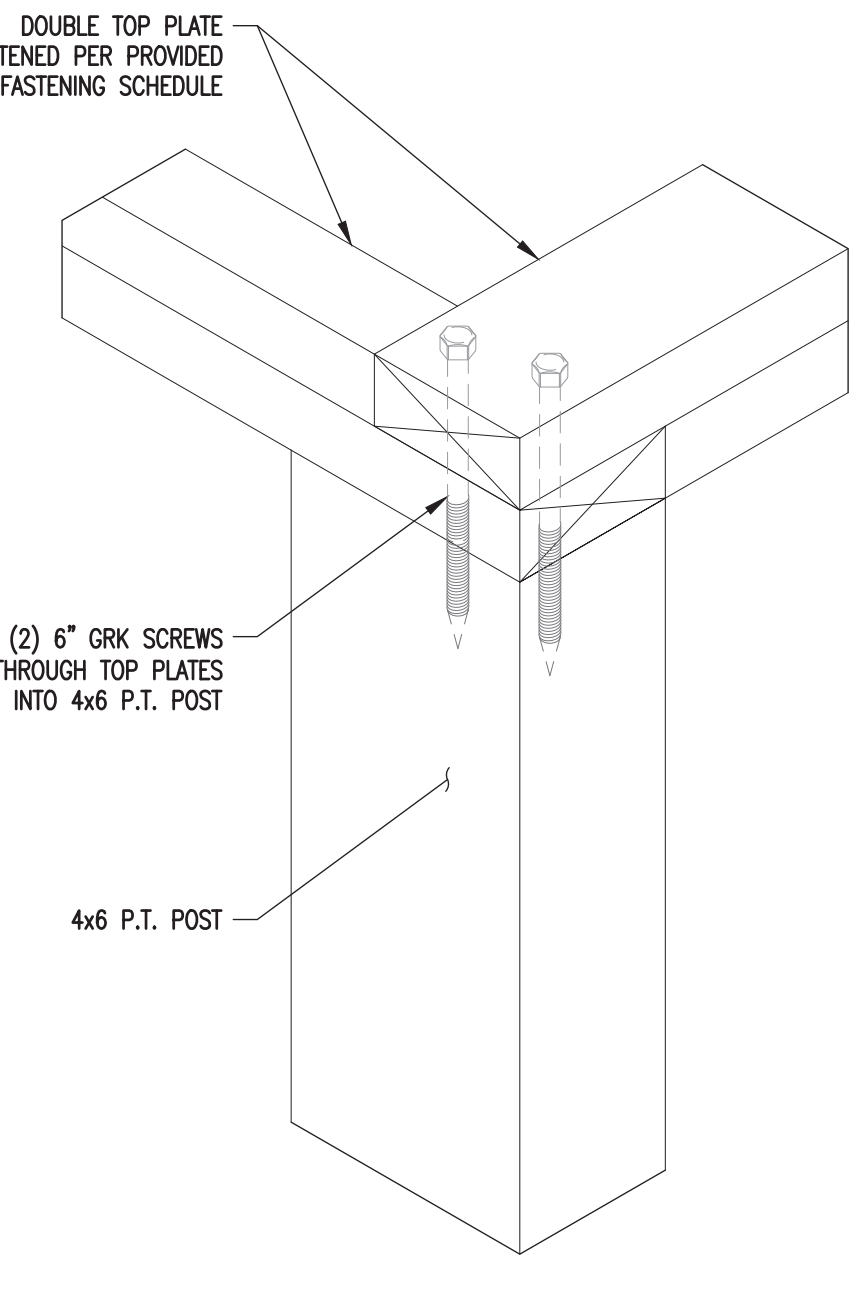

7 OPTIONAL PORCH POST TO TOP PLATE DETAIL
SCALE: N.T.S.
(DO NOT SCALE DRAWING)

PROJECT: UTILITY SHED

OPTIONAL PORCH PLANS, SECTIONS & DETAILS


DON VAN GERVE, P.E.
SPECIALTY STRUCTURAL ENGINEER

ADS ALTERNATE DESIGN SOLUTIONS
STRUCTURAL ENGINEERING DESIGN & CONSTRUCTION SERVICES
PHONE: 215.355.4684
WWW.ALTERNATEDESIGNSOLUTIONS.COM

ENGINEERING SERVICES PROVIDED FOR:
PREMIER PORTABLE BUILDINGS
317 EAST STATE LINE ROAD
SOUTH FULTON, TN 38257
WWW.PREMIERBUILDINGS.US

REVISION	DESCRIPTION	DATE	BY
▲			
▲			
▲			

DATE: 6.30.24
PROJECT NO.: 18285
DRAWING BY: JH
CHK BY: DVG
DWG NO.: **A-7**

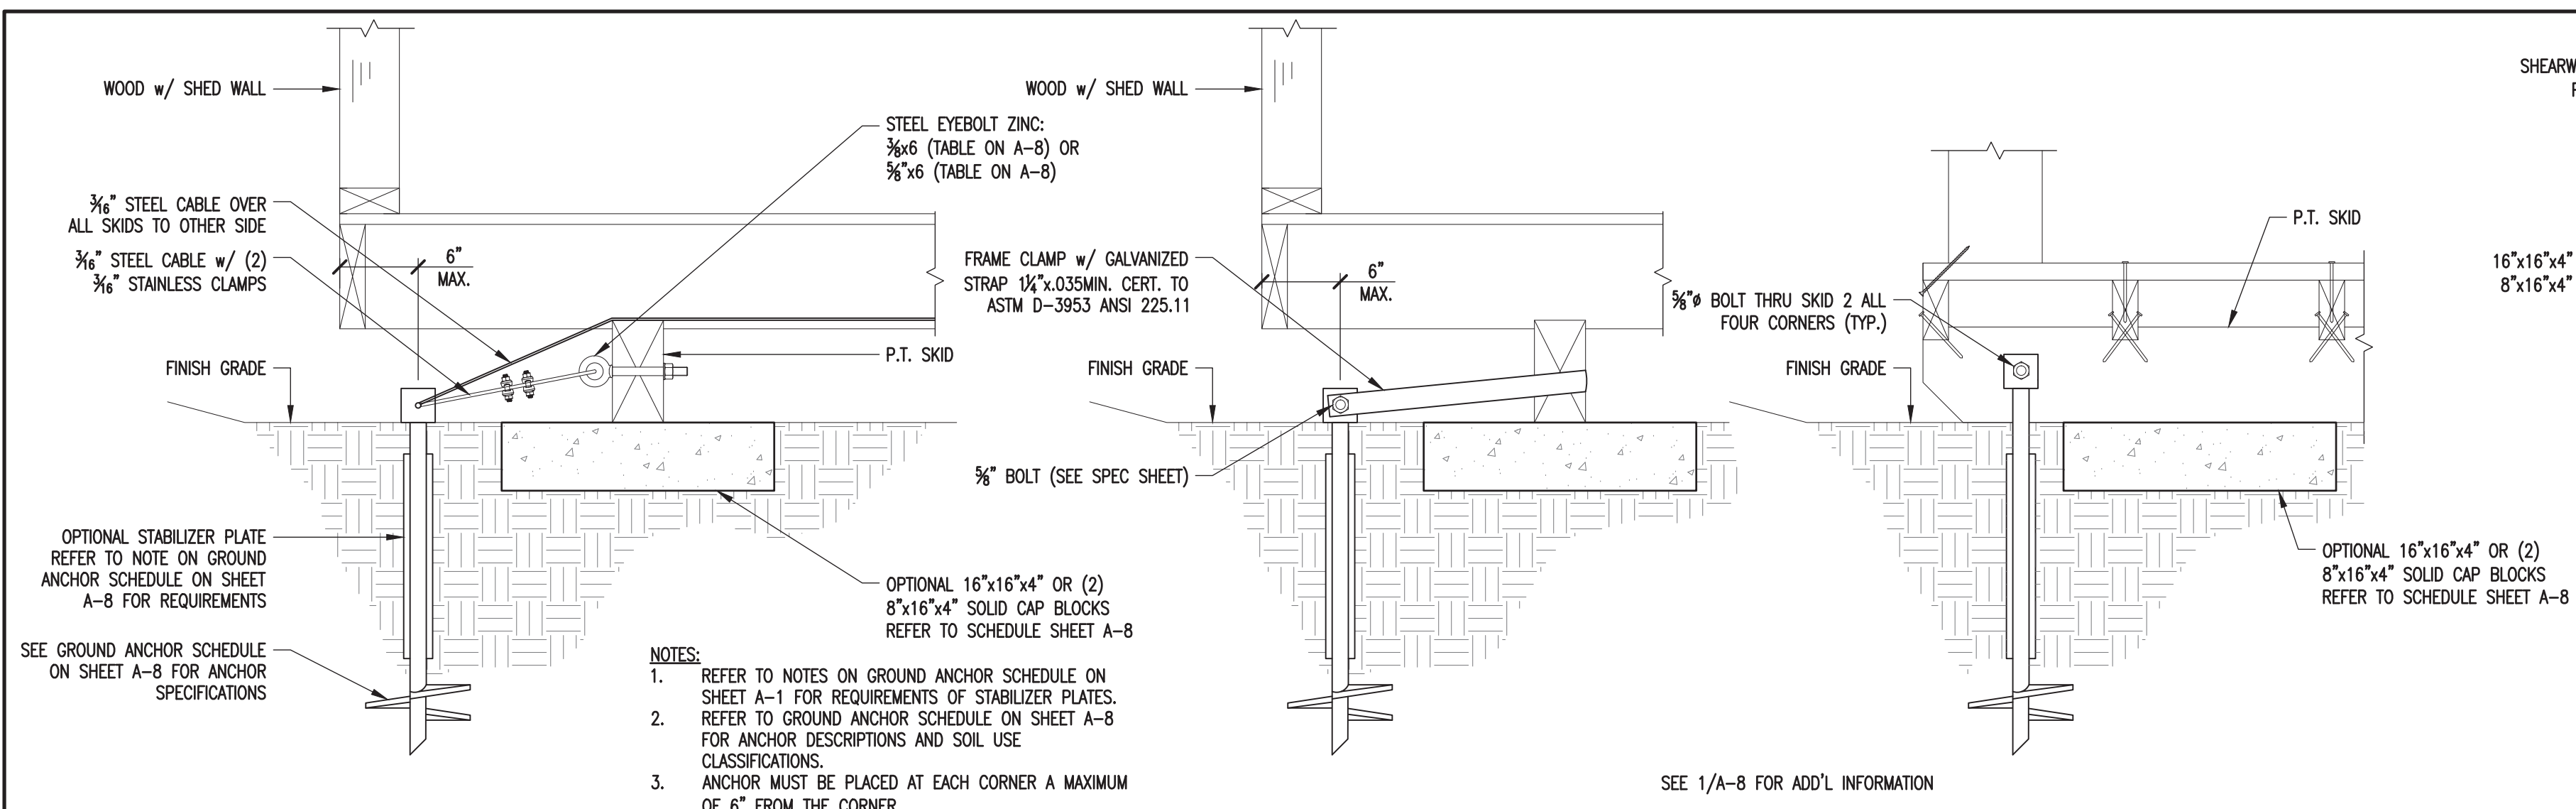


1 HELIX ANCHOR DETAIL
SCALE: 1-1/2"=1'-0"

2 OPTIONAL ANCHOR DETAIL
SCALE: 1-1/2"=1'-0"

3 ANCHOR DETAIL
SCALE: 1-1/2"=1'-0"

4 FLOOR FRAMING PLAN
SCALE: 1/4"=1'-0" (DO NOT SCALE DRAWING)

- NOTES:
- CONCRETE PADS ARE OPTIONAL.
 - DIMENSIONS SHOWN ARE NOMINAL.
 - ANCHORS ARE REQUIRED MIN. (4) PER BUILDING, (1) @ EACH CORNER SHEARWALL (SW-#).
 - REFER TO SCHEDULES ON SHEET A-8 FOR ANCHOR SPACING & OPTIONAL PAD LOCATION.
 - SPACE OPTIONAL PADS EQUALLY.

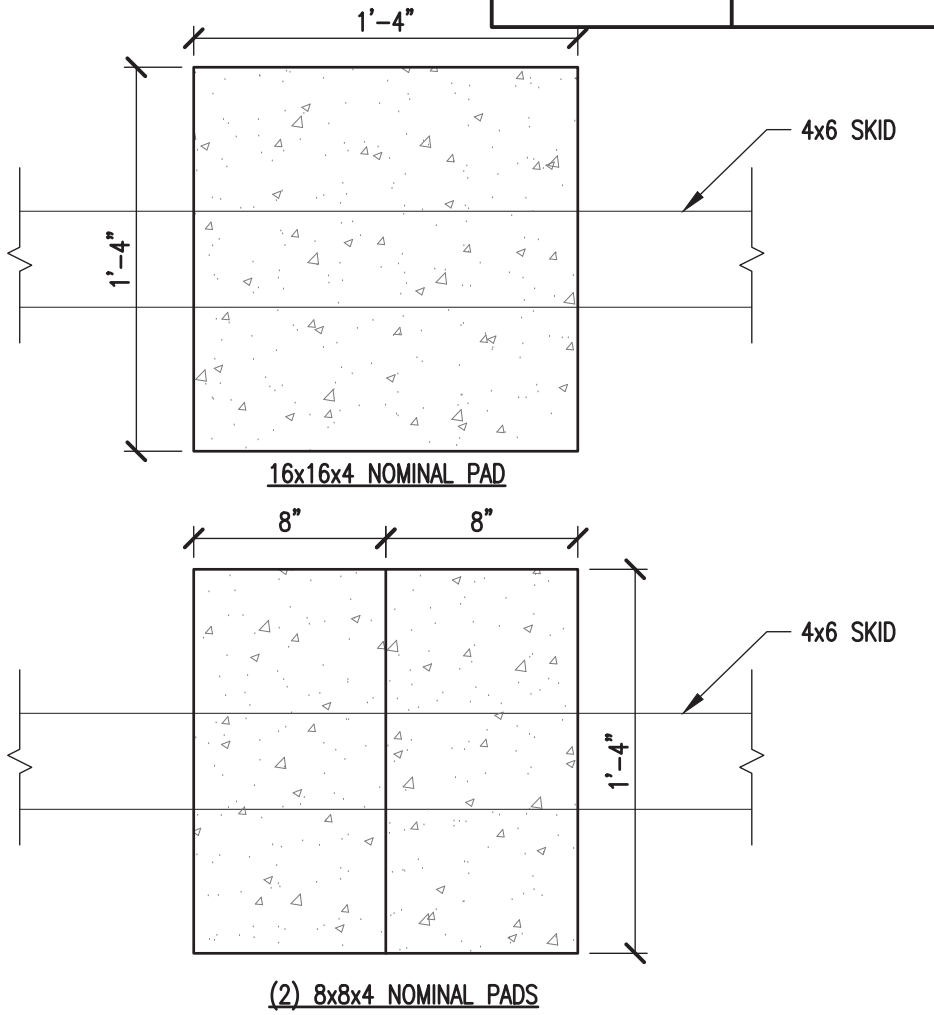

5 PAD DETAILS
SCALE: 1-1/2"=1'-0"

GENERAL NOTES:

- THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING ALL EXISTING CONDITIONS.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING ARCHITECTURAL, STRUCTURAL, MECHANICAL, AND ELECTRICAL DETAIL AND DIMENSIONS. ANY DISCREPANCIES BETWEEN SUCH DETAILS AND DIMENSIONS SHALL BE REPORTED TO THE ENGINEER PRIOR TO PROCEEDING WITH THE WORK.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR ERECTION PROCEDURE AND SEQUENCE TO INSURE THE INTEGRITY OF THE BUILDING AND ITS COMPONENT PARTS DURING CONSTRUCTION.
- THESE PLANS HAVE BEEN PREPARED PER REGULATIONS OF THE 2015 CANADA BUILDING CODE. THE WORK OF ALL CONTRACTORS SHALL COMPLY WITH THE REQUIREMENTS SET FORTH IN THE AFORESAID CODE. NO DEVIATIONS FROM THE WORK SHOWN OR REASONABLY IMPLIED SHALL BE UNDERTAKEN WITHOUT THE ENGINEER'S WRITTEN CONSENT - A COPY OF WHICH WILL BE FILLED WITH THE CONSTRUCTION OFFICIAL.
- ANY CHANGES TO OR DEVIATIONS FROM THESE DRAWINGS SHALL NOT BE MADE WITHOUT WRITTEN CONSENT FROM THE ENGINEER.
- THESE DRAWINGS ARE THE PROPERTY OF THE ENGINEER AND SHALL NOT BE USED WITHOUT HIS CONSENT. DRAWINGS SHALL NOT BE USED FOR ISSUE OF BUILDING PERMIT UNLESS SIGNED AND SEALED BY THE ENGINEER.
- THE OWNER AND CONTRACTOR SHALL HOLD HARMLESS THE ENGINEER FROM AND AGAINST ALL LIABILITY CLAIMS, DAMAGES, LOSSES AND EXPENSES INCLUDING LEGAL FEES ARISING OUT OF OR RESULTING FROM ERRORS OR OMISSIONS IN THE PERFORMANCE OF THE WORK BY THE CONTRACTOR. ALL WORK AND MATERIAL SHALL MEET THE REQUIREMENTS OF ALL LOCAL AND STATE BUILDING CODES. THE DRAWING SHOW THE GENERAL ARRANGEMENTS AND EXTENT OF THE WORK. AS THE WORK PROGRESSES, THE OWNER AND THE CONTRACTOR, AT NO EXTRA COSTS, SHALL MAKE MODIFICATIONS TO MAKE THE PARTS ALIGN.
- CONTRACTORS SHALL CHECK AND VERIFY ALL PLAN DIMENSIONS AND CONDITIONS BEFORE PROCEEDING CONSTRUCTION. HE SHALL REPORT ANY DISCREPANCIES TO THE ENGINEER FOR CORRECTION PRIOR TO BEGINNING ANY WORK. THE DISCOVERY OF DISCREPANCIES AFTER THE BEGINNING OF WORK WILL BE EVIDENCE OF FAULTY WORK AND SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR. DO NOT SCALE DRAWINGS. ALL WRITTEN DIMENSIONS GOVERN.
- THE CONTRACTOR FOR THIS PROJECT SHALL INCLUDE ALL MATERIALS AND LABOR REQUIRED TO COMPLETE THE TOTAL PROJECT. THE CONTRACTOR SHALL FURNISH AND PAY FOR ALL MATERIALS, TOOLS, EQUIPMENT, LABOR, MACHINERY, TRANSPORTATION, HEAT, WATER, UTILITIES, AND ALL OTHER FACILITIES AND SERVICES REQUIRED FOR THE SAFE AND PROPER EXECUTION AND COMPLETION OF THE WORK. THE ENGINEER SHALL BE THE INTERPRETER OF THE CONTRACT DOCUMENTS.
- THE DOCUMENTS SHOWN AN OVERVIEW OF THE WORK REQUIRED UNDER THIS CONTRACT AND RELATED REQUIREMENTS AND CONDITIONS THAT WILL IMPACT THE PROJECT. ALL DRAWINGS ARE COMPLEMENTARY. THE DRAWINGS GENERALLY SHOW THE INTENT OF THE OVERALL COMPLEXITY AND CONCEPTS OF THE PROJECT, AND DO NOT NECESSARILY SHOW ALL DETAILS AND CONDITIONS.
- ALL NEW INTERIOR CONCRETE SLABS AND FOUNDATION WALLS AND FOOTING SHALL HAVE SOLID POISONING UNDER NEW WORK AND SHALL BE INSTALLED BY A LICENSED CONTRACTOR. ALL WORK SHALL BE COMPLETED IN ACCORDANCE WITH ALL STATE AND DEPARTMENT OF AGRICULTURE, STRUCTURAL PEST CONTROL DIVISION REGULATIONS, RULES, DEFINITIONS AND REQUIREMENTS.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING AND MAINTAINING ALL EXISTING SETBACKS, EASEMENTS, AND ANY DEED RESTRICTIONS.
- THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR FINAL CLEANUP AND SHALL INCLUDE THE SITE, AND THE BUILDING. THE ENTIRE PROJECT SHALL BE LEFT IN A NEW, CLEAN CONDITION.

GROUND ANCHOR SCHEDULE				
MODEL #	PART #	DESCRIPTION	SOIL CLASS	
M12H5/8	59080 / 59081	48" x 5/8" ROD w/ (1) 6" HELIX	4A	
M12H3/4	59085 / 59094	48" x 3/4" ROD w/ (1) 6" HELIX	4A	
M1423/4	59128	42" x 3/4" ROD w/ (2) 4" HELIX	4A	
M1483/4	59086	48" x 3/4" ROD w/ (2) 4" HELIX	4A	
M12H64	59250	36" x 3/4" ROD w/ (1) 4" HELIX & (1) 6" HELIX	4A	
N/A	59065	EYE ANCHOR - 48" X 5/8" w/ (1) 6" HELIX	4A	
N/A	59045	EYE ANCHOR - 48" X 3/4" w/ (1) 6" HELIX	4A	
M607	59099	60" X 3/4" w/ (1) 7" HELIX	4B	
N/A	59040	EYE ANCHOR 60" X 3/4" w/ (1) 8" HELIX	4B	

OPTIONAL PAD SCHEDULE FOR ALL WIND SPEEDS AND EXPOSURES

BUILDING WIDTH	NUMBER OF PADS BY LENGTH UNDER EACH SKID																		
	10'-0"	12'-0"	14'-0"	16'-0"	18'-0"	20'-0"	22'-0"	24'-0"	26'-0"	28'-0"	30'-0"	32'-0"	34'-0"	36'-0"	38'-0"	40'-0"	50'-0"	60'-0"	
8'-0"	3	3	3	3	3	4	4	4	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
10'-0"	3	3	3	4	4	4	4	5	5	5	5	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
11'-2"	2	2	3	3	3	3	3	3	3	4	4	4	N/A	N/A	N/A	N/A	N/A	N/A	N/A
12'-0"	2	2	3	3	3	3	3	3	4	4	4	4	4	4	N/A	N/A	N/A	N/A	N/A
14'-0"	2	3	3	3	3	3	3	4	4	4	4	4	4	5	5	5	6	7	
16'-0"	2	3	3	3	3	3	3	4	4	4	4	4	5	5	5	5	6	7	

ANCHORING FOR 115 M.P.H. WIND SPEED, EXPOSURE "C" - 3/8" ANCHOR BOLT

BUILDING WIDTH	MAX. SPACING OVERTURN	NUMBER OF ANCHORS EACH SIDE WALL																	
		10'-0"	12'-0"	14'-0"	16'-0"	18'-0"	20'-0"	22'-0"	24'-0"	26'-0"	28'-0"	30'-0"	32'-0"	34'-0"	36'-0"	38'-0"	40'-0"	50'-0"	60'-0"
8'-0"	3.15	4	4	4	5	5	7	7	7	7	7	9	9	9	13	11	12	13	14
10'-0"	3	4	4	4	5	5	7	7	7	7	7	9	9	9	14	11	12	13	14
11'-2"	3.98	3	3	3	4	4	6	6	6	6	6	8	8	8	11	10	10	11	12
12'-0"	4.01	3	3	3	4	4	5	5	5	5	5	8	8	8	10	10	10	10	11
14'-0"	4.10	3	3	3	4	4	5	5	5	5	5	8	8	8	10	9	9	10	11
16'-0"	4.18	3	3	3	4	4	5	5	5	5	5	8	8	8	10	9	9	10	11

ANCHORING FOR 115 M.P.H. WIND SPEED, EXPOSURE "C" - 5/8" ANCHOR BOLT

BUILDING WIDTH	MAX. SPACING OVERTURN	NUMBER OF ANCHORS EACH SIDE WALL																	
		10'-0"	12'-0"	14'-0"	16'-0"	18'-0"	20'-0"	22'-0"	24'-0"	26'-0"	28'-0"	30'-0"	32'-0"	34'-0"	36'-0"	38'-0"	40'-0"	50'-0"	60'-0"
8'-0"	4.61	4	4	5	5	5	6	6	6	6	6	7	8	8	8	8	8	9	10
10'-0"	4.30	4	4	5	5	6	6	6	6	6	6	7	8	8	8	8	8	9	10
11'-2"	5.84	3	4	4	4	5	5	6	6	6	6	7	7	7	7	7	7	8	9
12'-0"	5.88	3	4	4	4	4	5	5	5	5	5	6	7	7	7	7	7	8	8
14'-0"	6.01	3	3	4	4	4	5	5	5	5	5	6	6	6	6	6	6	7	8
16'-0"	6.13	3	3	4	4	4	5	5	5	5	5	6	6	6	6	6	6	7	8

PROJECT: UTILITY SHED

FASTENING SCHEDULE / WIND LOADING

DON VAN GERVE, P.E.
SPECIALTY STRUCTURAL ENGINEER

ENGINEERING SERVICES PROVIDED FOR:
PREMIER PORTABLE BUILDINGS
317 EAST STATE LINE ROAD
SOUTH FULTON, TN 38257
WWW.PREMIERBUILDINGS.US

REVISION	DESCRIPTION	DATE	BY
▲			
▲			
▲			

DATE: 6.30.24
PROJECT NO.: 18285
DRAWING BY: JH
CHK BY: DVG

DWG NO.: **A-8**

VIRAG HARENDRARAY BHACHECH (P.Eng.)
 "PREMVILLA" 78-SLEIGHTHOLME CRESCENT BRAMPTON ON. L6P-3E7 TEL/FAX : 905-794-3385.

TO:
 Premier Portable Buildings
 Manitoba


Date: 18th April -2023

PROJECT: Use of SPF - Structural


Dear Sir:

As per Wood Design Manual, the specified strengths & Modulus of Elasticity are substantially higher for SPF – Structural wood, so they are suitable to use as a Structural floor Joists and skids.


Regards
 Virag Bhachech (P.Eng)

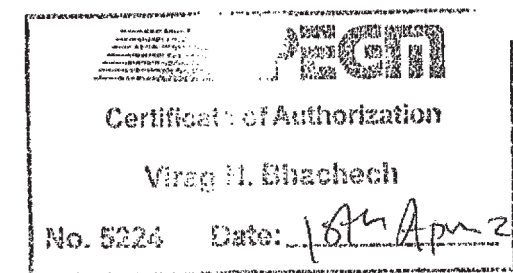


**HP21
 SINGLE SLOT
 BUCKLE**

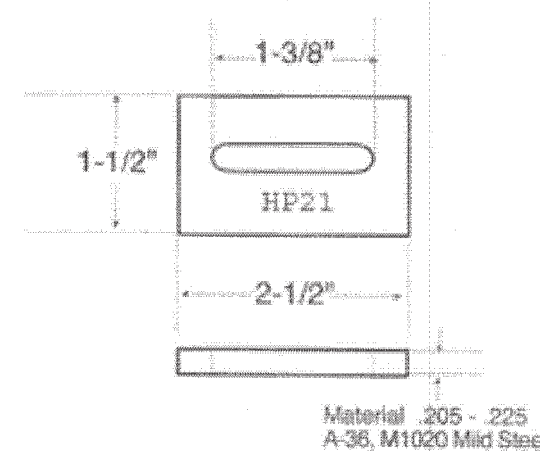

**HP21-(6 thru 15)
 SINGLE BUCKLE
 W/STRAP**

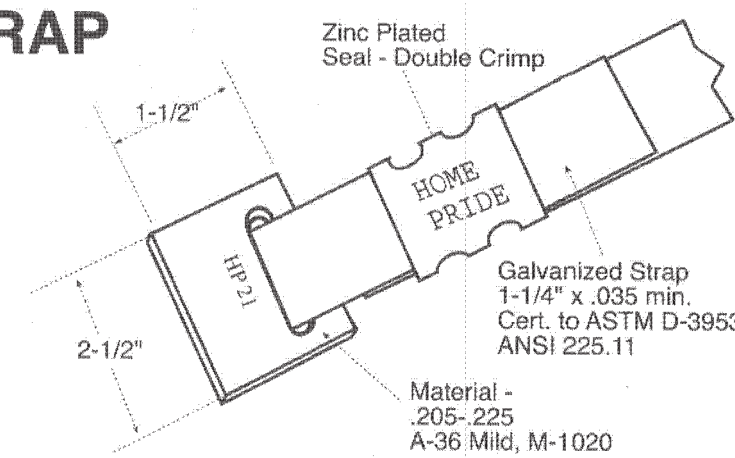


**HP22
 FRAME
 CLAMP**

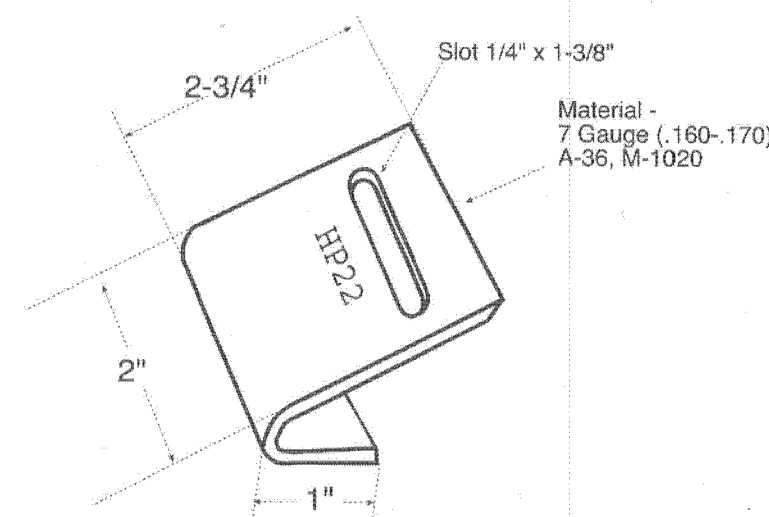


8


**HP22-(6 thru 15)
 FRAME CLAMP
 W/STRAP**

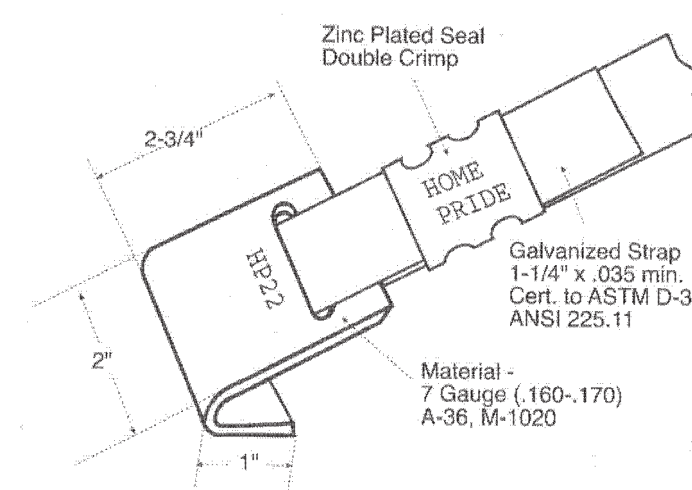

**HPAB
 ANCHOR
 BOLT & NUT**

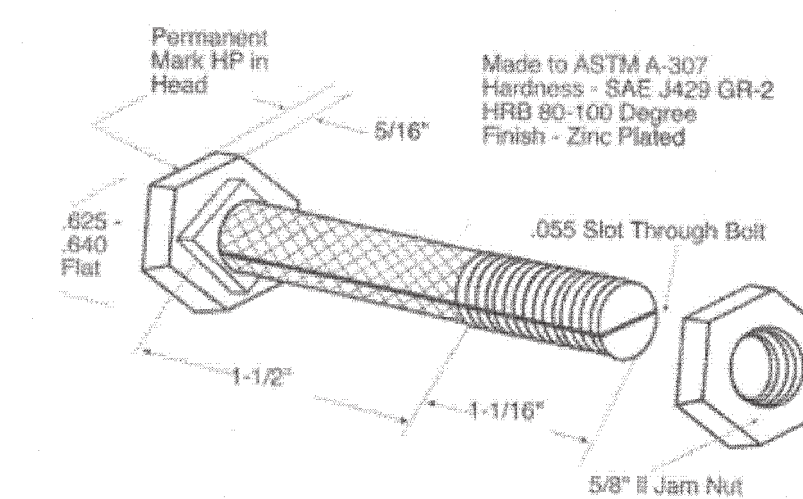

**HPSS
 STRAP SEAL**

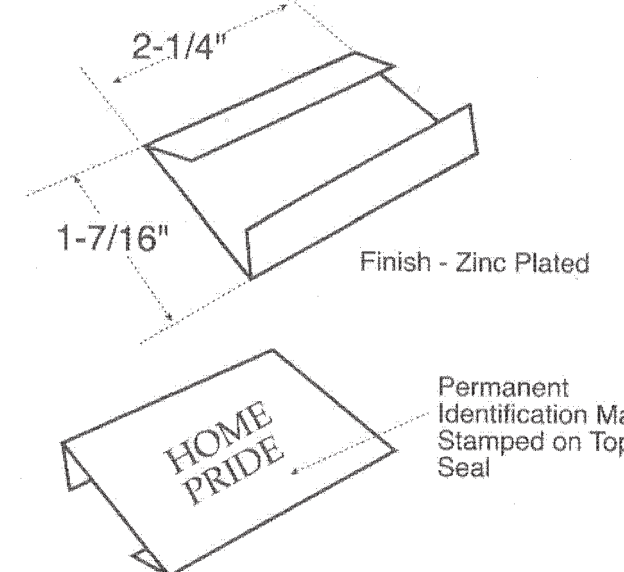

INSTALLATION INSTRUCTIONS:
 When using seals to extend the strap:
 1. Overlap a minimum of 8".
 2. Use two seals placed together.
 3. Crimp each seal twice.

9

AREA FOR APPROVAL STAMPS

PROJECT: UTILITY SHED

PRODUCT CUT SHEETS

DON VAN GERVE, P.E.
 SPECIALTY STRUCTURAL ENGINEER




ENGINEERING SERVICES PROVIDED FOR:
 PREMIER PORTABLE BUILDINGS
 317 EAST STATE LINE ROAD
 SOUTH FULTON, TN 38257
 WWW.PREMIERBUILDINGS.US


REVISION	DESCRIPTION	DATE	BY
▲			
▲			
▲			
▲			

DATE: 6.30.24
 PROJECT NO.: 18285
 DRAWING BY: JH
 CHK BY: DVG


A-9

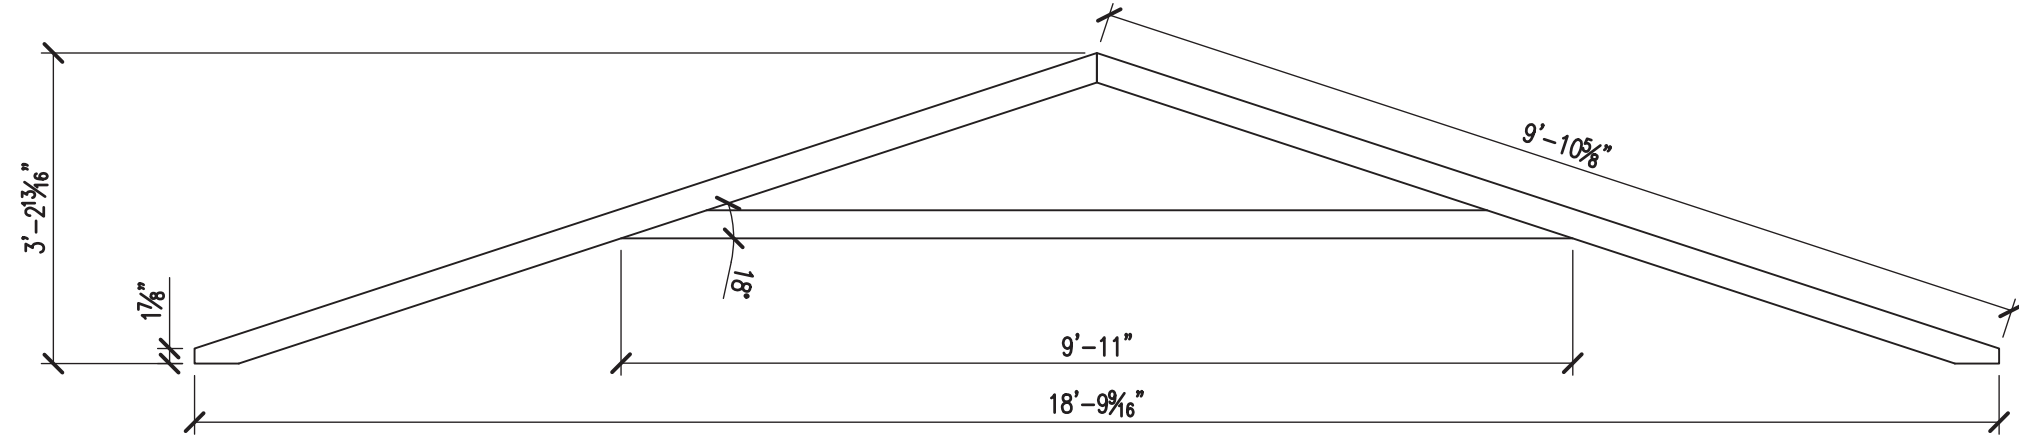


18' UTILITY TRUSS

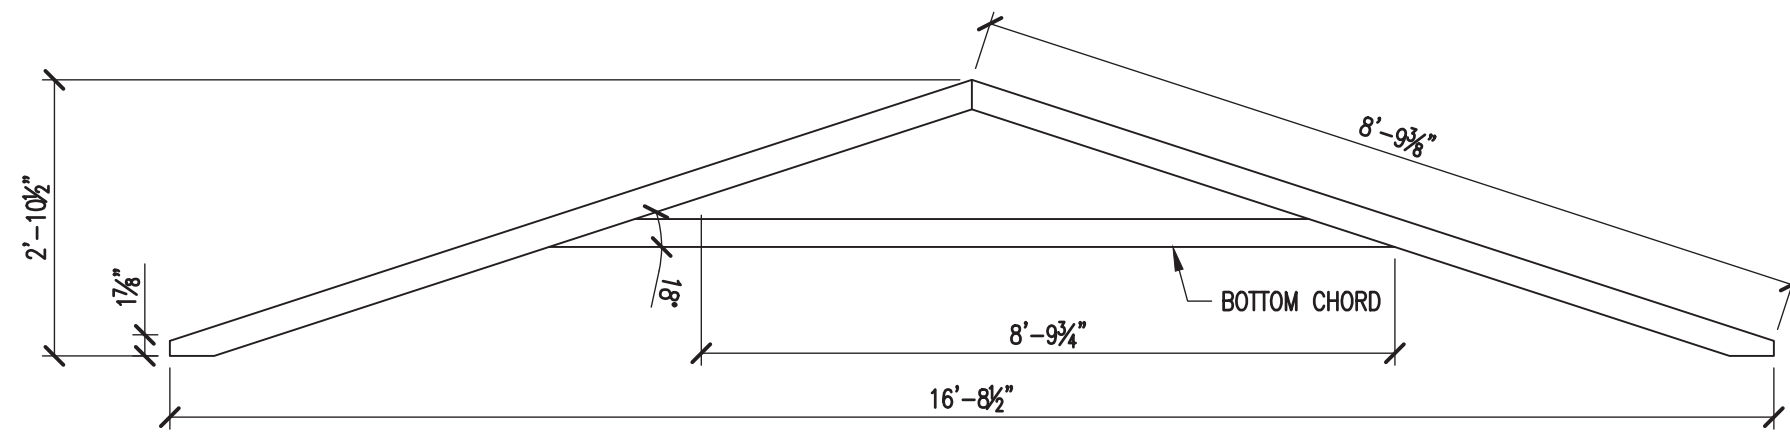


16' UTILITY TRUSS

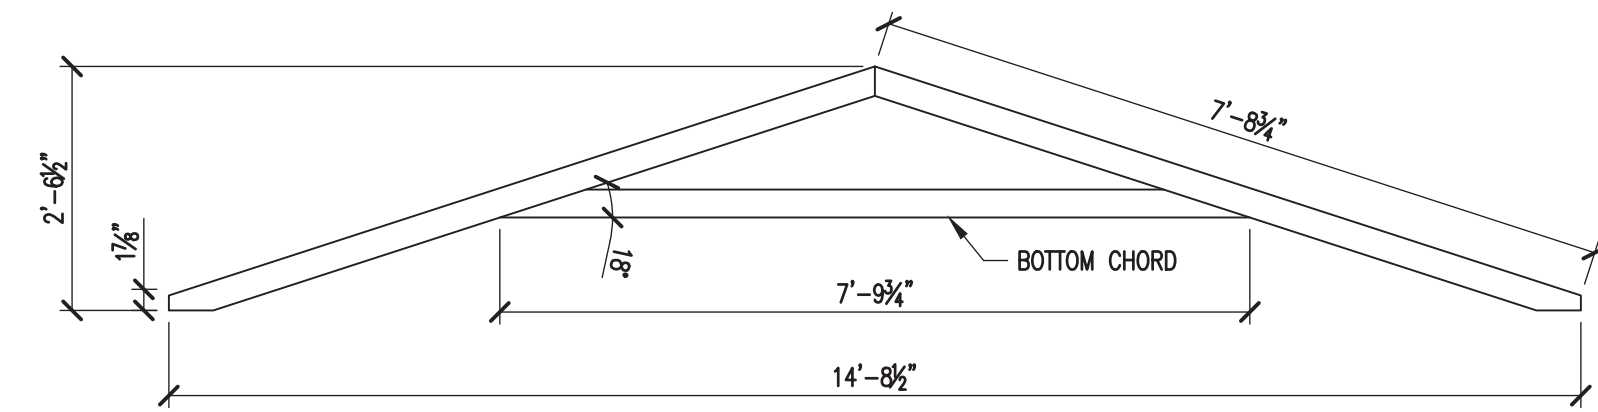


14' UTILITY TRUSS

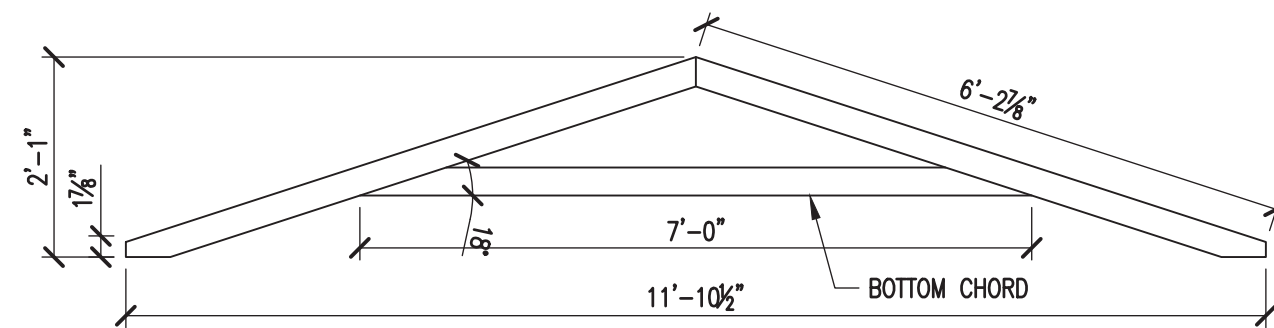


12' UTILITY TRUSS

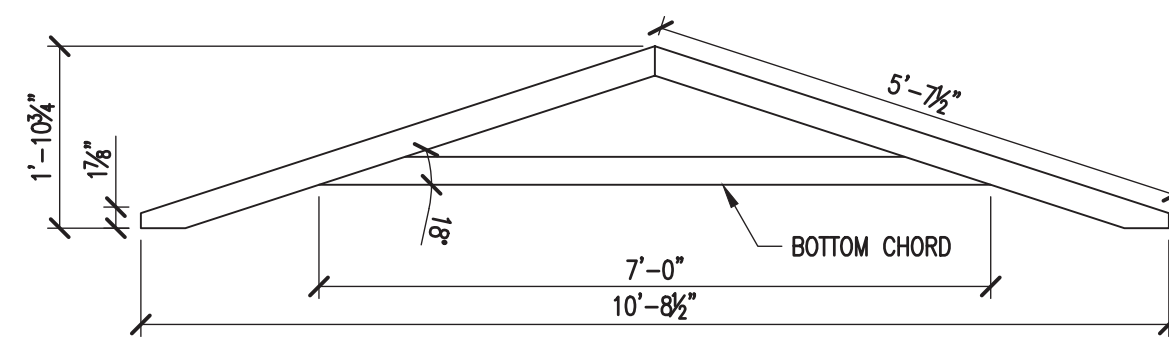


10' UTILITY TRUSS

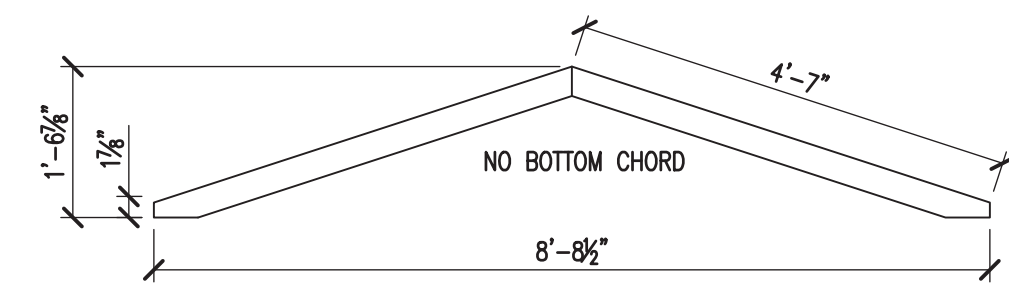


8' UTILITY TRUSS

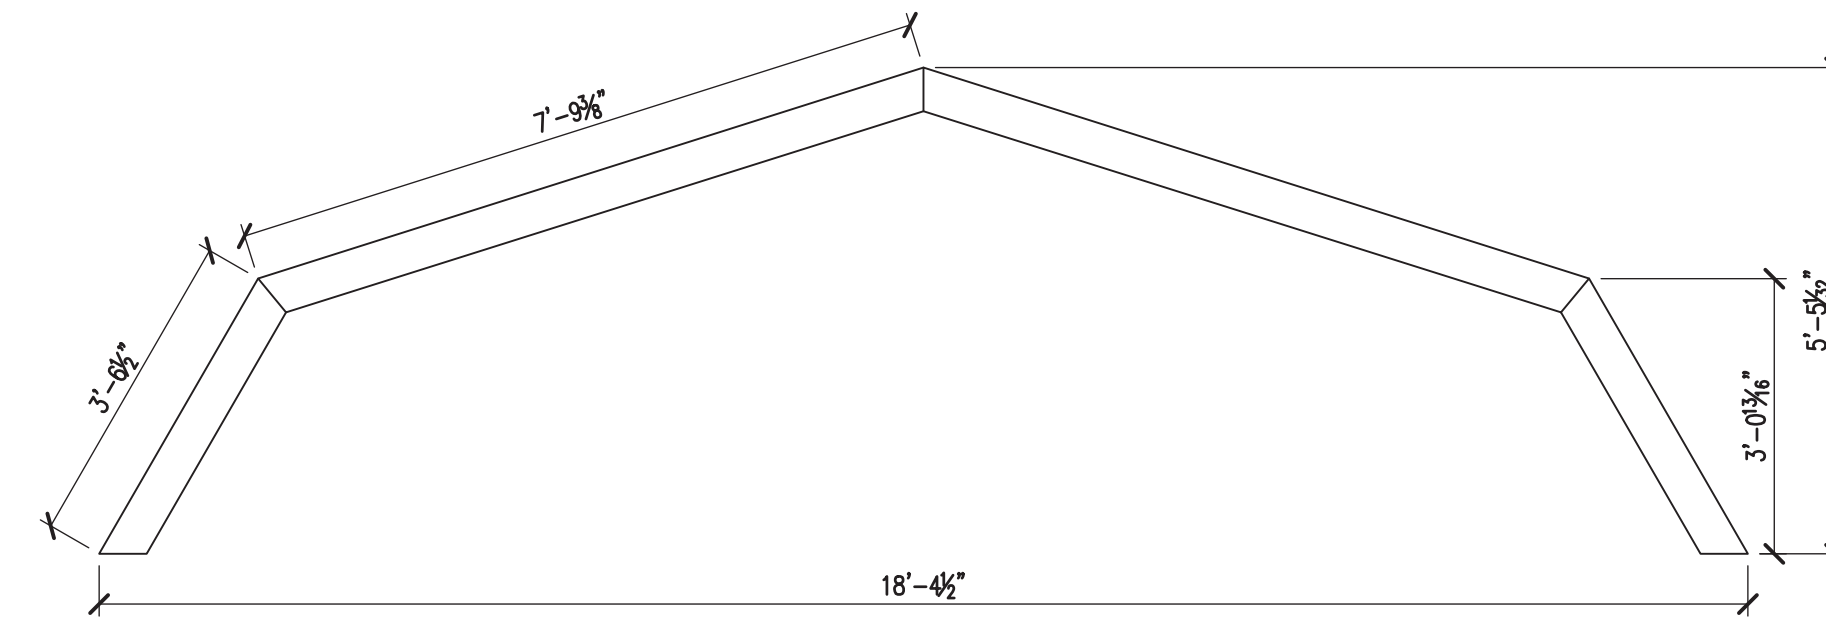


18' LOFTED TRUSS

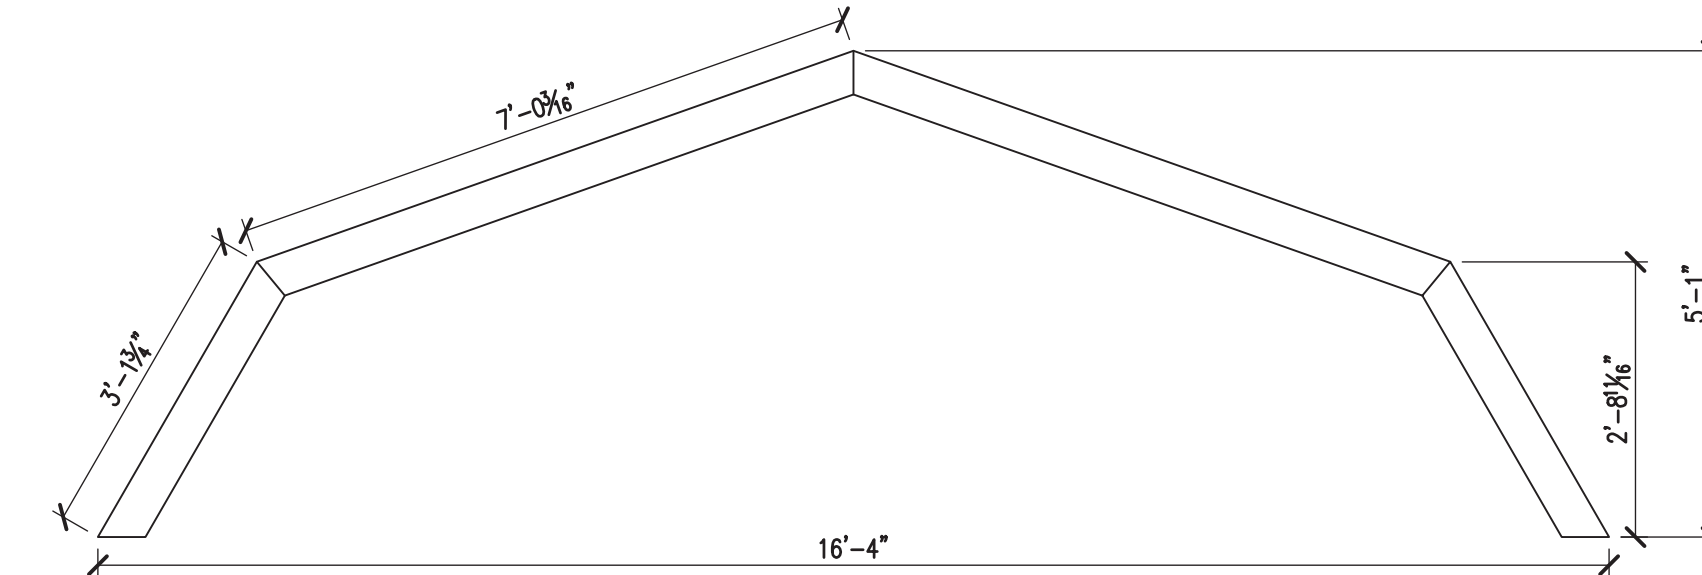


16' LOFTED TRUSS

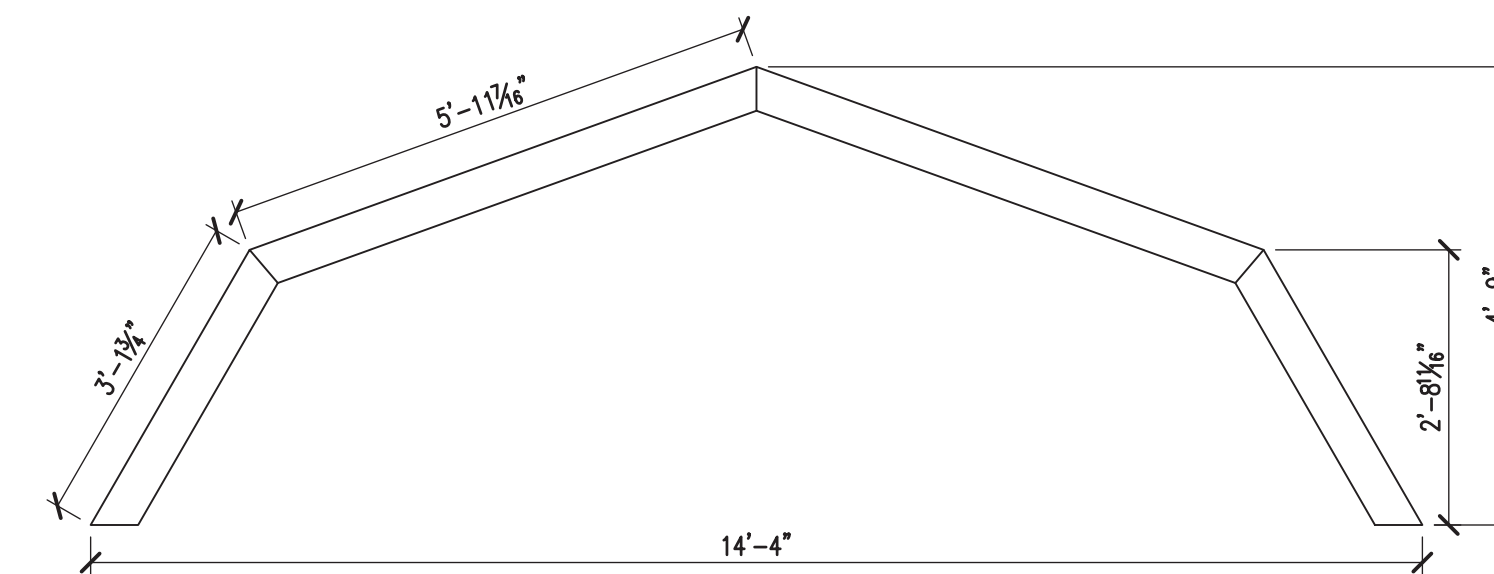


14' LOFTED TRUSS

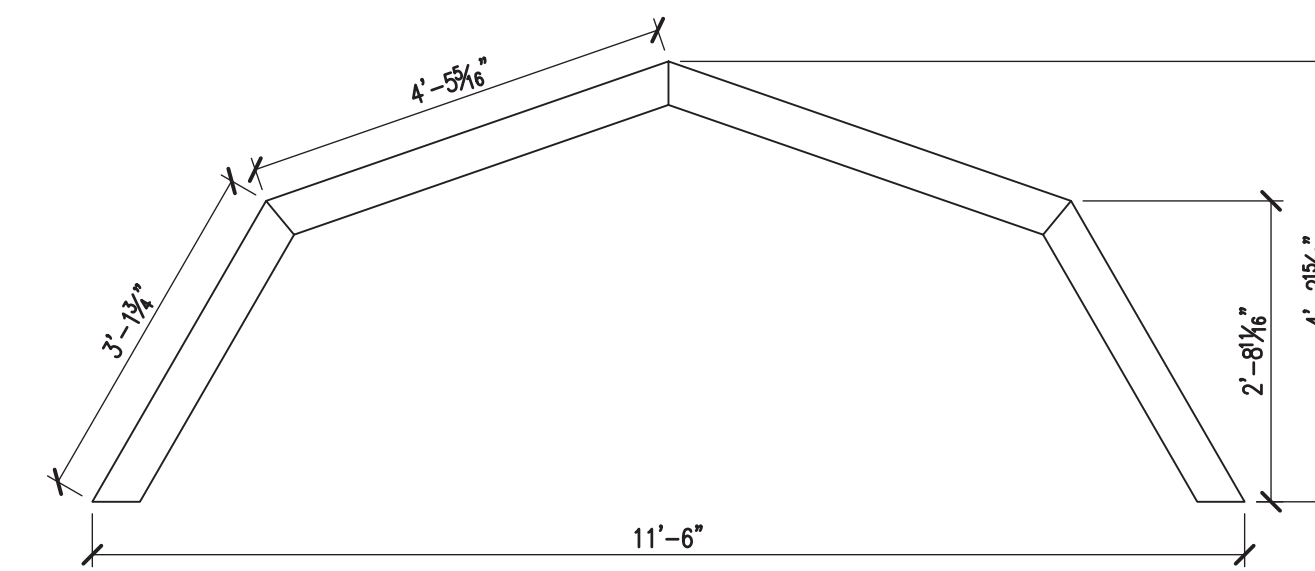

12' LOFTED TRUSS

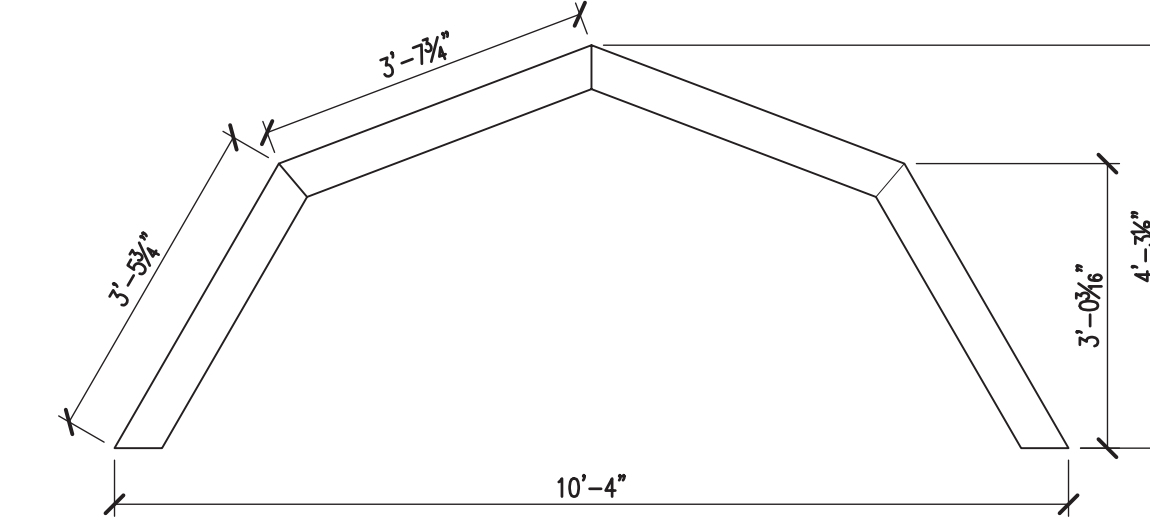

10' LOFTED TRUSS

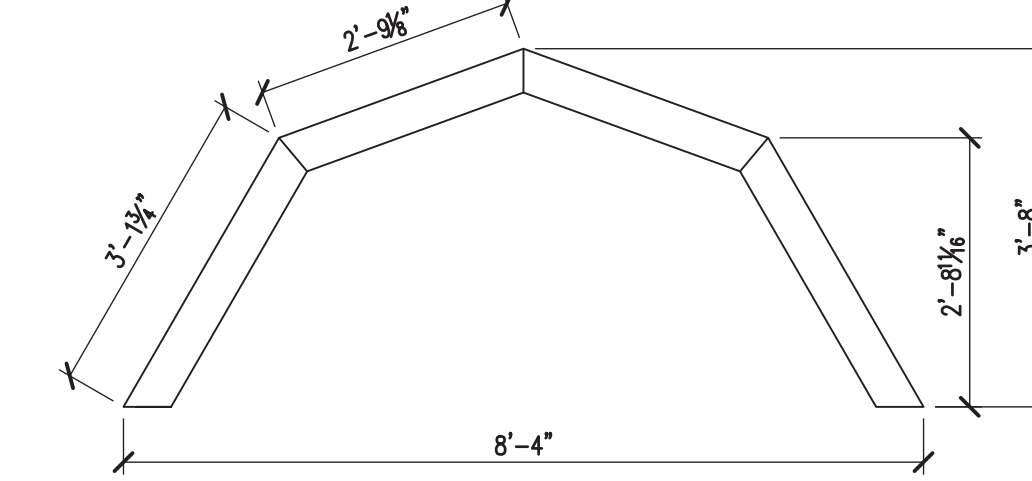

8' LOFTED TRUSS

TRUSS DESIGN: LRFD V=180mph
 ASCE 7-22 83 psf uplift x 0.85(Kd) x 0.85(Kh expC) = 60 psf uplift.
 add internal pressure 18% = 71 psf design (LRFD)
 Utility: Lmax=5.25 ft. 2x4@24"; w=142 plf
 $M = wL^2/8 \times 12 = 5871$ in-lbs; $s = 3.06$ in³; fb=1919psi
 Fb(LRFD)=3000 psi - this value is met by lumber.

Lofted: Lmax=7.01 ft; 16' truss@16" o/c; w= 95 plf;
 M=7002 in-lbs; fb= 2288 psi < 3000 psi LRFD

Wall Calculations: 5/8" LP nailed 6" edges, 10" interior, 2x4x7ft@16"o/c;
 Pressure= 58.1 psfExternal= 10.5 psfInternal Total p= 68.6 psf
 $I = 18.74$ in⁴ per 16" o/c; S=6.03 in³.

$M = 68.6(1.33)(7^2)/8 \times (12) = 6657.1$ in-lbs;
 fb= 1104 psi < 3000 psi LRFD OK

PROJECT: UTILITY SHED

TRUSS DETAILS

DON VAN GERVE, P.E.
 SPECIALTY STRUCTURAL ENGINEER



ENGINEERING SERVICES PROVIDED FOR:
 PREMIER PORTABLE BUILDINGS
 317 EAST STATE LINE ROAD
 SOUTH FULTON, TN 38257
 WWW.PREMIERBUILDINGS.US

REVISION	DESCRIPTION	DATE	BY
▲			
▲			
▲			
▲			

DATE: 6.30.24
 PROJECT NO.: 18285
 DRAWING BY: JH
 CHK BY: DVG
 DWG NO.: A-10